




OIL ANALYSIS REPORT

Machine Id
Hancock CAT 3 (S/N 3RC00176)
 Component
Biogas Engine
 Fluid
CHEVRON HDAX 9500 GAS ENGINE OIL 40 (95 GAL)

Sample Rating Trend

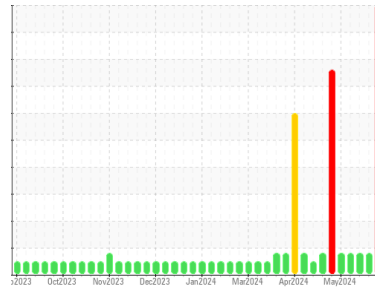

DIAGNOSIS

▲ Recommendation

We recommend that you drain the oil and perform a filter service on this component if not already done. We advise that you inspect for the source(s) of wear. We recommend an early resample to monitor this condition.

▲ Wear

The tin level is severe.

▲ Contamination

Elemental level of silicon (Si) above normal.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0898206	WC0898198	WC0898197
Sample Date	Client Info		10 Jul 2024	04 Jun 2024	31 May 2024
Machine Age	hrs	Client Info	77046	76189	76094
Oil Age	hrs	Client Info	854	1140	1045
Oil Changed	Client Info		Not Chngd	Not Chngd	Not Chngd
Sample Status			SEVERE	ABNORMAL	ABNORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Water	WC Method	>.11	NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2	
PQ	ASTM D8184	>21	▲ 22	---	---	
Iron	ppm	ASTM D5185m	>15	5	1	0
Chromium	ppm	ASTM D5185m	>4	0	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>6	3	3	2
Lead	ppm	ASTM D5185m	>9	0	<1	0
Copper	ppm	ASTM D5185m	>6	2	4	4
Tin	ppm	ASTM D5185m	>4	▲ 8	▲ 5	▲ 5
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		57	73	92
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		2	5	4
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m		25	43	42
Calcium	ppm	ASTM D5185m		1878	2127	1929
Phosphorus	ppm	ASTM D5185m		454	463	437
Zinc	ppm	ASTM D5185m		633	628	584
Sulfur	ppm	ASTM D5185m		5248	4629	4094

CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>181	▲ 205	171	157
Sodium	ppm	ASTM D5185m	>21	1	2	<1
Potassium	ppm	ASTM D5185m	>20	<1	<1	0


INFRA-RED

	method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844		0.1	0.1	0.1
Nitration	Abs/cm	*ASTM D7624		5.4	7.0	7.1
Sulfation	Abs/.1mm	*ASTM D7415		22.8	23.0	22.9




OIL ANALYSIS REPORT


Non-ferrous Metals

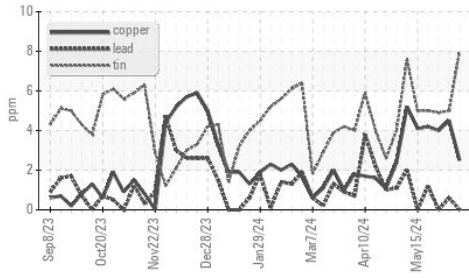


PQ

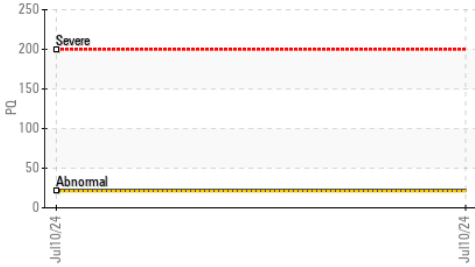


FT-IR (Direct Trend)

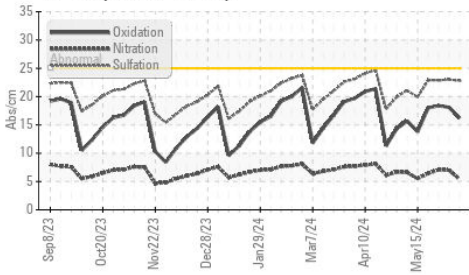

Acid Number

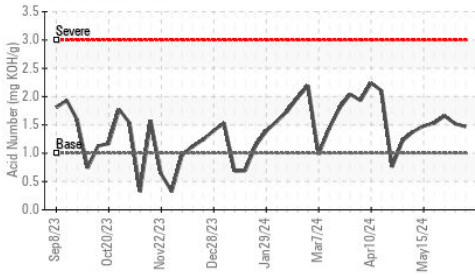

Acid Number

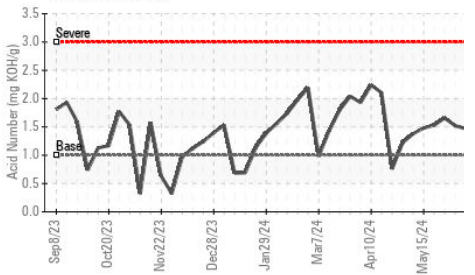

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs./1mm	*ASTM D7414	16.2	18.1	18.4
Acid Number (AN)	mg KOH/g	ASTM D8045	1.47	1.52	1.66
Base Number (BN)	mg KOH/g	ASTM D2896	3.54	3.98	4.22

VISUAL


	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.11	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG

FLUID PROPERTIES


	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.4	15.2	15.2

GRAPHS


Iron (ppm)

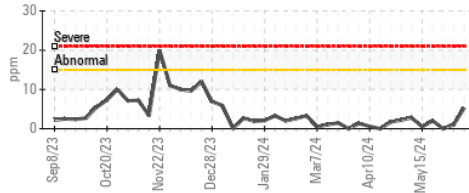


Aluminum (ppm)

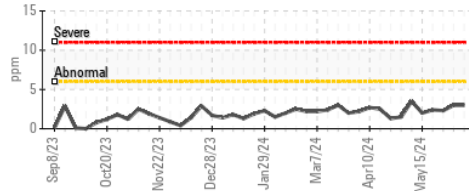


Copper (ppm)

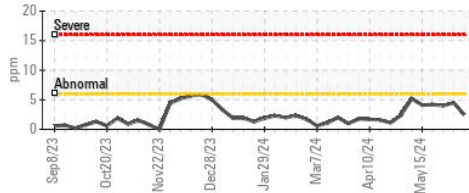


Viscosity @ 100°C

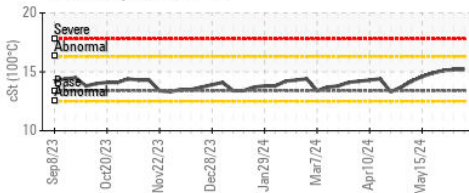


Lead (ppm)

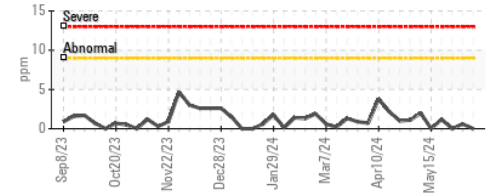


Chromium (ppm)

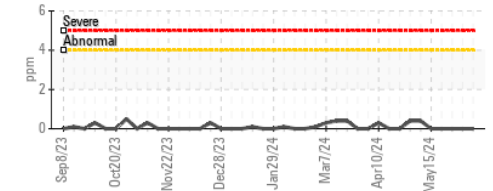

Silicon (ppm)

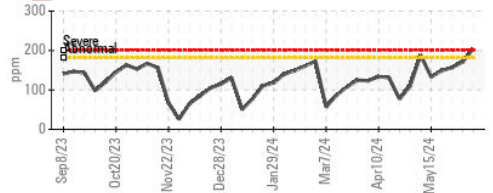

Base Number

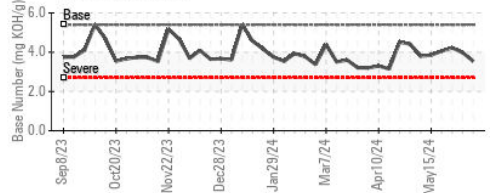

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0898206

Lab Number : 06235111

Unique Number : 11123945

Test Package : MOB 2 (Additional Tests: PQ)

Received : 12 Jul 2024

Tested : 15 Jul 2024

Diagnosed : 15 Jul 2024 - Sean Felton

EDL NA Recips-Hancock County

HANCOCK COUNTY POWER STATION, 3574 TOWNSHIP ROAD 142

FINDLAY, OH

US 45840

Contact: TIM CUSICK

tim.cusick@edlenergy.com

T:

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)