




OIL ANALYSIS REPORT

Sample Rating Trend

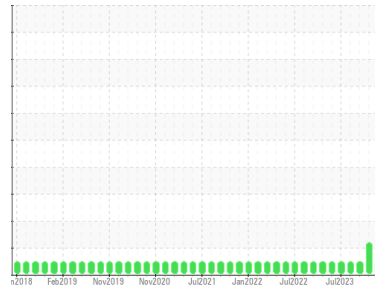

NORMAL



Machine Id
1933 (S/N 99737H)
 Component
Air Compressor
 Fluid
 {not provided} (12 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0708407	WC0708405	WC0708404
Sample Date	Client Info			26 Jun 2024	11 May 2024	26 Feb 2024
Machine Age	hrs	Client Info		150299	149231	148504
Oil Age	hrs	Client Info		1079	1235	1458
Oil Changed	Client Info			Not Chngd	N/A	Changed
Sample Status				NORMAL	ATTENTION	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.6	NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	2	2	0
Chromium	ppm	ASTM D5185m	>4	<1	0	0
Nickel	ppm	ASTM D5185m	>4	<1	0	0
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m		0	<1	0
Aluminum	ppm	ASTM D5185m	>10	2	<1	0
Lead	ppm	ASTM D5185m	>20	<1	0	0
Copper	ppm	ASTM D5185m	>40	<1	<1	0
Tin	ppm	ASTM D5185m	>5	<1	0	<1
Vanadium	ppm	ASTM D5185m		0	<1	<1
Cadmium	ppm	ASTM D5185m		<1	0	0


ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	<1
Barium	ppm	ASTM D5185m		0	4	0
Molybdenum	ppm	ASTM D5185m		<1	<1	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m		<1	0	0
Calcium	ppm	ASTM D5185m		0	<1	0
Phosphorus	ppm	ASTM D5185m		0	15	12
Zinc	ppm	ASTM D5185m		0	5	0
Sulfur	ppm	ASTM D5185m		16	244	84

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2	4	1
Sodium	ppm	ASTM D5185m		1	2	2
Potassium	ppm	ASTM D5185m	>20	1	0	0


FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	7299	14723	---
Particles >6µm		ASTM D7647	>2500	488	2851	---
Particles >14µm		ASTM D7647	>320	19	79	---
Particles >21µm		ASTM D7647	>80	6	13	---
Particles >38µm		ASTM D7647	>20	1	1	---
Particles >71µm		ASTM D7647	>4	0	1	---
Oil Cleanliness		ISO 4406 (c)	>20/18/15	20/16/11	21/19/13	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.22	0.25	0.163


Particle Trend

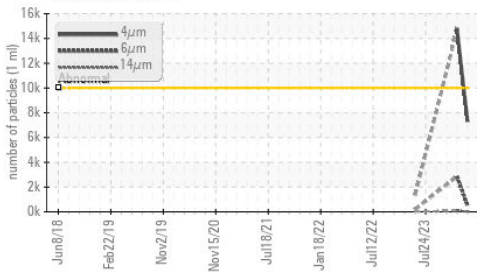


Acid Number

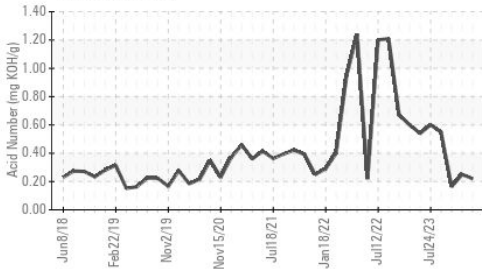

Viscosity @ 40°C

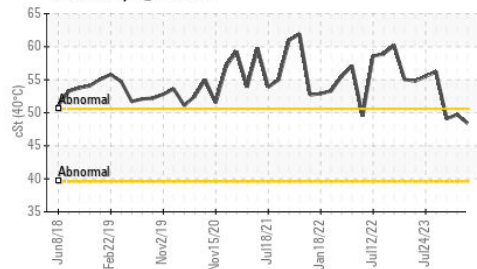

Particle Trend

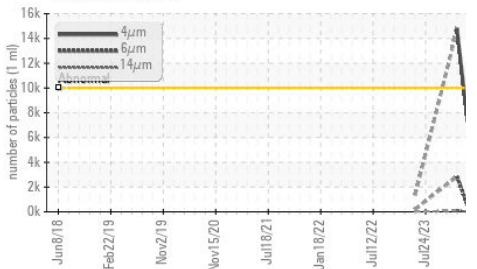


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.6	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	48.4	49.7	49.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color

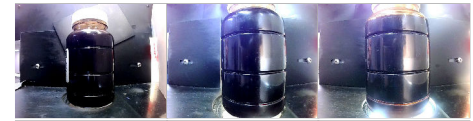


Bottom




GRAPHS


Ferrous Alloys

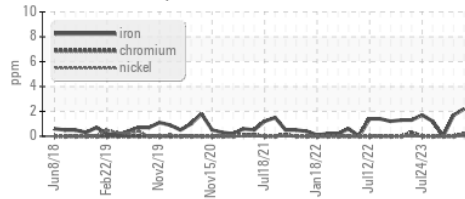


Non-ferrous Metals

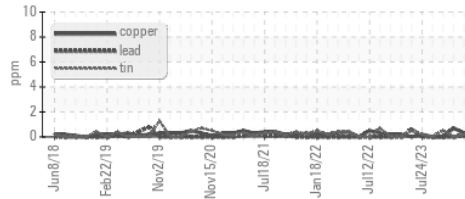


Viscosity @ 40°C

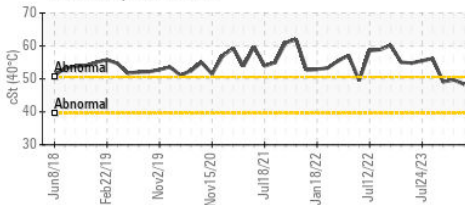

Particle Count

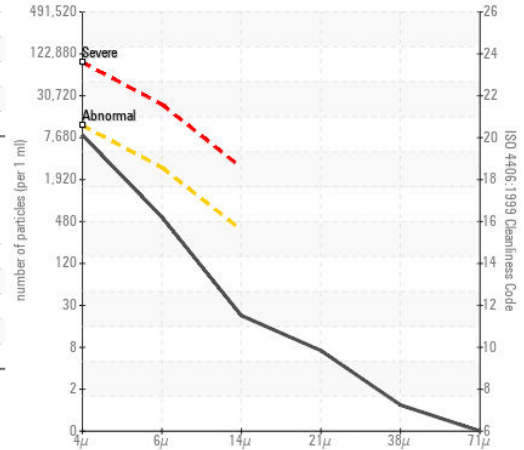

Acid Number

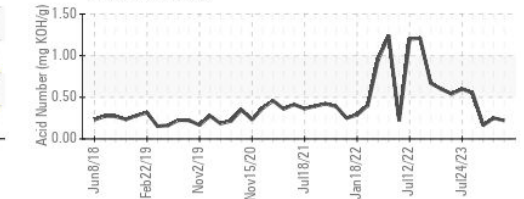

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0708407
Lab Number : 06235912
Unique Number : 11124746
Test Package : PLANT

Received : 15 Jul 2024
Tested : 16 Jul 2024
Diagnosed : 16 Jul 2024 - Don Baldrige

MACLEAN COMPONENT SOLUTIONS
 PO BOX 828
 SAEGERTOWN, PA
 US 16443

Contact: CRAIG WRIGHT
 crwright@macleanfogg.com

T: (814)763-2655
 F: (814)763-2069

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)