




# OIL ANALYSIS REPORT

Sample Rating Trend

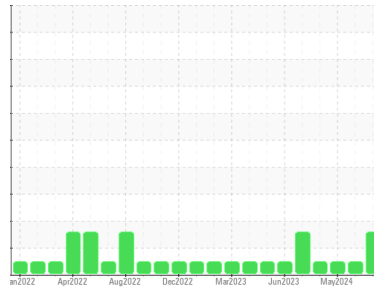

**WATER**



Machine Id  
**C-38**  
 Component  
**Screw Compressor**  
 Fluid  
**INGERSOLL-RAND SSR ULTRA COOLANT (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a trace of moisture present in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0711810</b>	WC0711816	WC0820307
Sample Date	Client Info		<b>09 Jul 2024</b>	04 Jun 2024	01 May 2024
Machine Age	days	Client Info	<b>0</b>	0	0
Oil Age	days	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>MARGINAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >60	<b>2</b>	1	<1
Chromium	ppm	ASTM D5185m >4	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	<b>2</b>	1	2
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >5	<b>2</b>	0	0
Lead	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	<1
Copper	ppm	ASTM D5185m >30	<b>&lt;1</b>	<1	0
Tin	ppm	ASTM D5185m >15	<b>&lt;1</b>	<1	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 500	<b>757</b>	791	776
Molybdenum	ppm	ASTM D5185m 0	<b>&lt;1</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m 0	<b>&lt;1</b>	0	1
Calcium	ppm	ASTM D5185m 0	<b>0</b>	2	6
Phosphorus	ppm	ASTM D5185m 20	<b>39</b>	63	66
Zinc	ppm	ASTM D5185m 0	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m 200	<b>257</b>	384	377

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	<b>3</b>	3	3
Sodium	ppm	ASTM D5185m	<b>1</b>	2	1
Potassium	ppm	ASTM D5185m >20	<b>1</b>	<1	2
Water	%	ASTM D6304 >0.1	<b>▲ 0.101</b>	0.065	0.071
ppm Water	ppm	ASTM D6304 >1000	<b>▲ 1014</b>	653	712

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>275</b>	154	7266
Particles >6µm	ASTM D7647	>2500	<b>60</b>	44	1270
Particles >14µm	ASTM D7647	>320	<b>8</b>	3	16
Particles >21µm	ASTM D7647	>80	<b>3</b>	1	5
Particles >38µm	ASTM D7647	>20	<b>0</b>	0	0
Particles >71µm	ASTM D7647	>4	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	<b>15/13/10</b>	14/13/9	20/17/11

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.057</b>	0.067	0.055




# OIL ANALYSIS REPORT

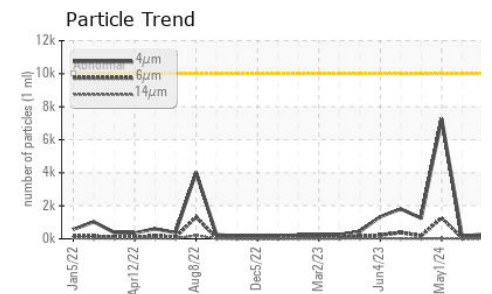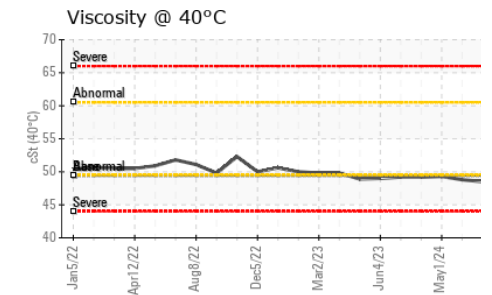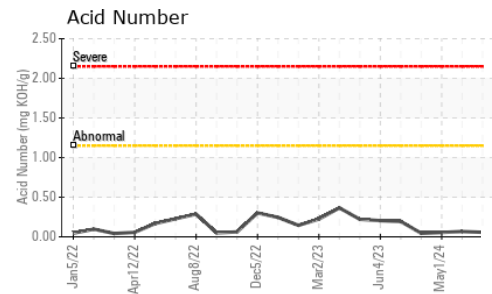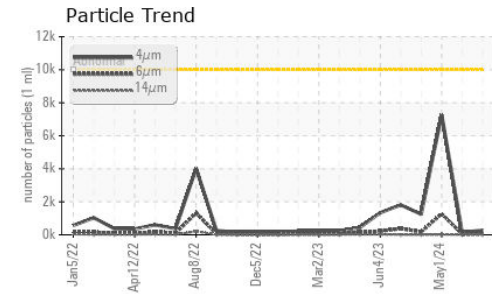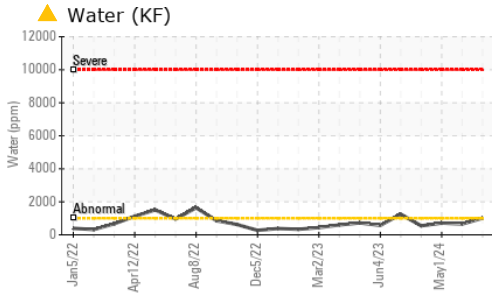






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	49.4	48.5	48.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

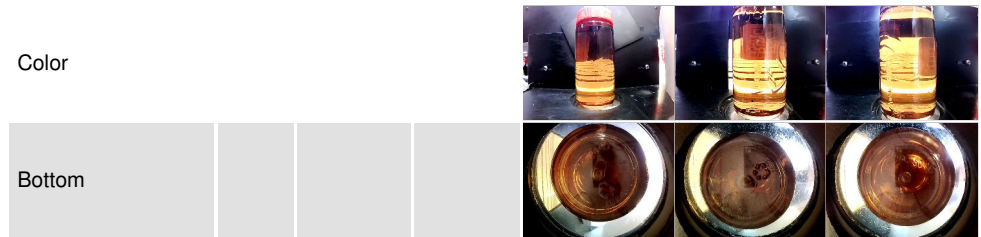

## GRAPHS

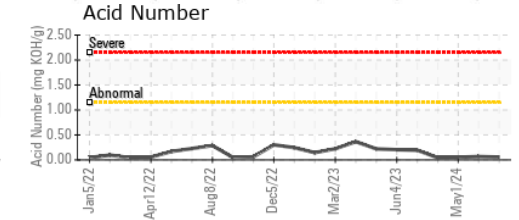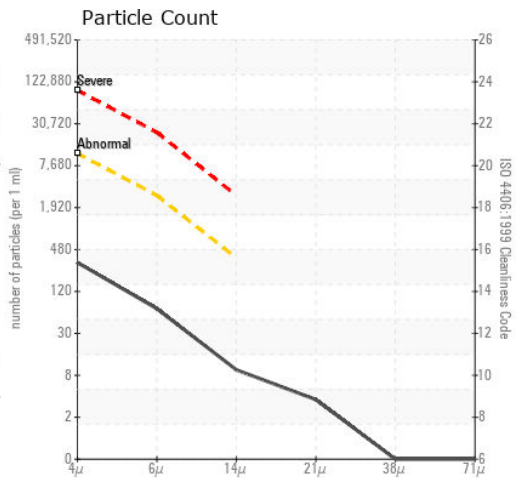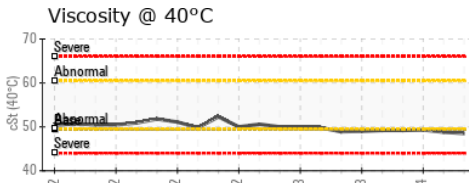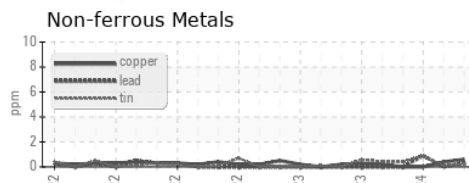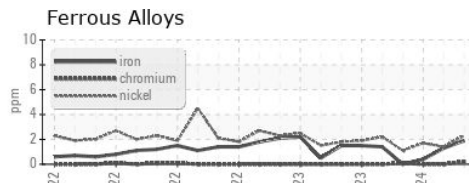

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0711810

Lab Number : 06235941

Unique Number : 11124775

Test Package : IND 2 ( Additional Tests: KF, PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Received : 15 Jul 2024

Tested : 16 Jul 2024

Diagnosed : 16 Jul 2024 - Don Baldrige

UGI ENERGY SERVICES - LNG FACILITY

80 ENERGY LN

MESHOPPEN, PA

US 18630

Contact: JOE BARRETT

jbarrett@ugies.com

T:

F: