




# OIL ANALYSIS REPORT

## Sample Rating Trend

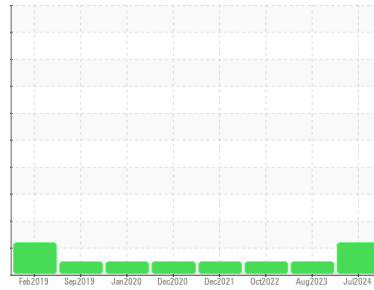

ISO



Machine Id  
**KAESER ASD 60 6235599 (S/N 1394)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

### DIAGNOSIS

#### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is a moderate amount of particulates present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA016003</b>	KCPA003721	KC106636
Sample Date	Client Info			<b>03 Jul 2024</b>	25 Aug 2023	15 Oct 2022
Machine Age	hrs	Client Info		<b>35726</b>	31396	25336
Oil Age	hrs	Client Info		<b>4329</b>	0	4859
Oil Changed	Client Info			<b>Not Chngd</b>	N/A	Changed
Sample Status				<b>ATTENTION</b>	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>11</b>	14	6
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m		<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	90	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m	2	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m		<b>0</b>	<1	2
Zinc	ppm	ASTM D5185m		<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m		<b>17793</b>	17771	15826


CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	0	0
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	0
Water	%	ASTM D6304	>0.05	<b>0.012</b>	0.006	0.010
ppm Water	ppm	ASTM D6304	>500	<b>123</b>	64.9	100.3

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>1627</b>	945	586
Particles >6µm		ASTM D7647	>1300	<b>520</b>	433	197
Particles >14µm		ASTM D7647	>80	<b>84</b>	36	11
Particles >21µm		ASTM D7647	>20	<b>34</b>	10	1
Particles >38µm		ASTM D7647	>4	<b>3</b>	0	0
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>18/16/14</b>	17/16/12	16/15/11


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.46</b>	0.39	0.47

# OIL ANALYSIS REPORT


## Particle Trend

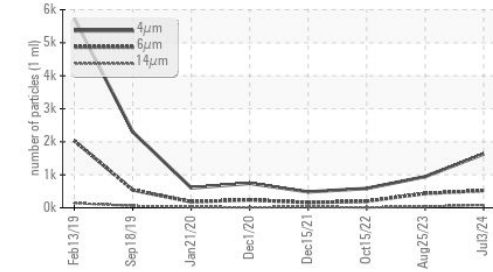


## Water (KF)

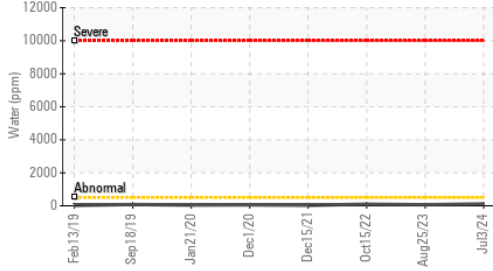


## Acid Number

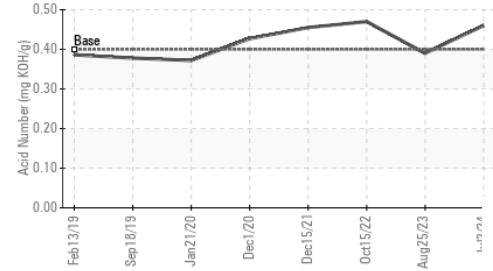

## Water (KF)

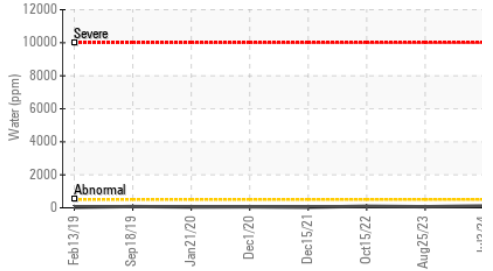


## Viscosity @ 40°C

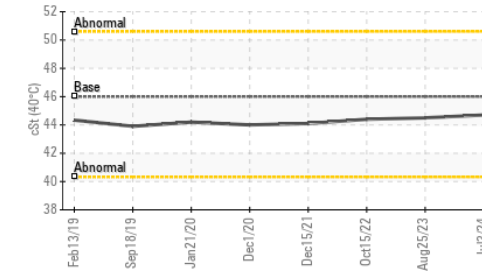

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.5	44.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

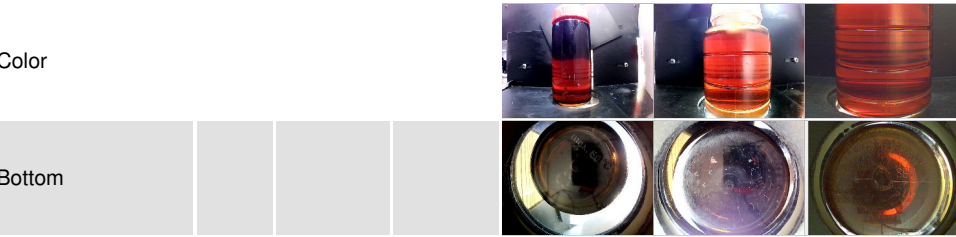


## GRAPHS


### Ferrous Alloys

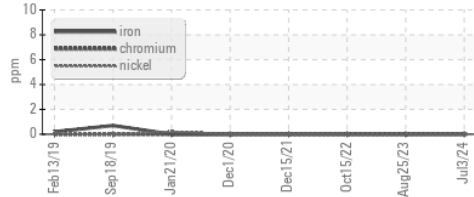


### Non-ferrous Metals

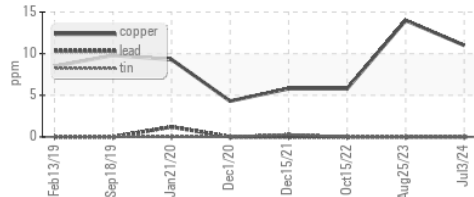


### Viscosity @ 40°C

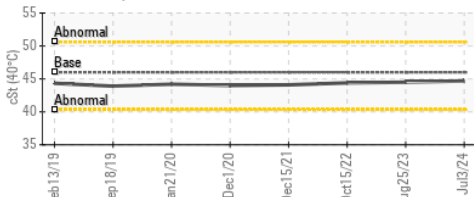

### Particle Count

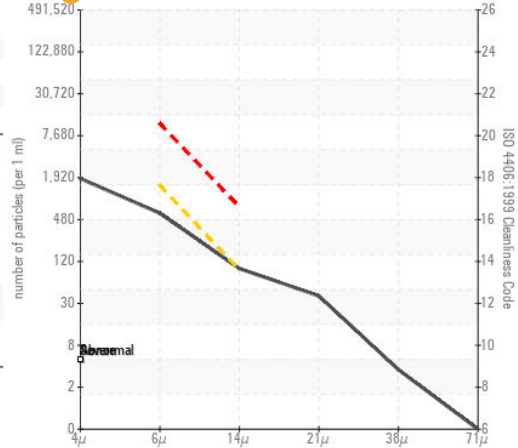

### Acid Number

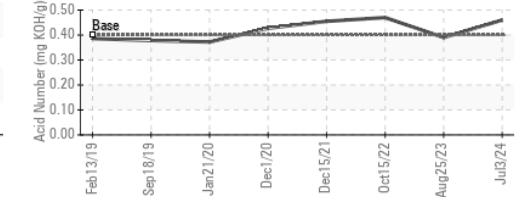

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513

**Sample No.** : KCPA016003

**Lab Number** : 06235951

**Unique Number** : 11124785

**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**Received** : 15 Jul 2024

**Tested** : 16 Jul 2024

**Diagnosed** : 16 Jul 2024 - Don Baldrige

**MONTEBELLO PACKAGING**

650 INDUSTRIAL DR

LEBANON, KY

US 40033

Contact: J. WOLF

jwolf@montebellopkg.com

T:

F: