




OIL ANALYSIS REPORT

Sample Rating Trend

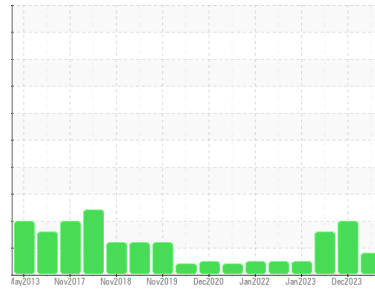

ISO



Machine Id
KAESER ASD 40S 4358820 (S/N 1076)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| SAMPLE INFORMATION | | method | limit/base | current | history1 | history2 |
|--------------------|-------------|-------------|------------|--------------------|-------------|-------------|
| Sample Number | Client Info | | | KCPA014327 | KCPA010955 | KCPA005013 |
| Sample Date | Client Info | | | 20 Jun 2024 | 19 Dec 2023 | 23 Jun 2023 |
| Machine Age | hrs | Client Info | | 60787 | 58346 | 56134 |
| Oil Age | hrs | Client Info | | 0 | 0 | 0 |
| Oil Changed | Client Info | | | Changed | N/A | N/A |
| Sample Status | | | | ATTENTION | ABNORMAL | ABNORMAL |

| WEAR METALS | | method | limit/base | current | history1 | history2 |
|-------------|-----|-------------|------------|--------------|----------|----------|
| Iron | ppm | ASTM D5185m | >50 | 0 | 0 | 0 |
| Chromium | ppm | ASTM D5185m | >10 | 0 | 0 | 0 |
| Nickel | ppm | ASTM D5185m | >3 | 0 | 0 | 0 |
| Titanium | ppm | ASTM D5185m | >3 | 0 | 0 | <1 |
| Silver | ppm | ASTM D5185m | >2 | 0 | 0 | 0 |
| Aluminum | ppm | ASTM D5185m | >10 | <1 | 0 | 1 |
| Lead | ppm | ASTM D5185m | >10 | 0 | 0 | 0 |
| Copper | ppm | ASTM D5185m | >50 | 6 | 9 | 8 |
| Tin | ppm | ASTM D5185m | >10 | 0 | 0 | 0 |
| Vanadium | ppm | ASTM D5185m | | 0 | 0 | <1 |
| Cadmium | ppm | ASTM D5185m | | 0 | 0 | 0 |






| ADDITIVES | | method | limit/base | current | history1 | history2 |
|------------|-----|-------------|------------|--------------|----------|----------|
| Boron | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Barium | ppm | ASTM D5185m | 90 | 0 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Manganese | ppm | ASTM D5185m | | 0 | <1 | 0 |
| Magnesium | ppm | ASTM D5185m | 90 | 0 | 0 | 10 |
| Calcium | ppm | ASTM D5185m | 2 | 0 | 0 | 0 |
| Phosphorus | ppm | ASTM D5185m | | 0 | 57 | 1 |
| Zinc | ppm | ASTM D5185m | | 0 | 0 | 10 |
| Sulfur | ppm | ASTM D5185m | | 16825 | 15310 | 20792 |

| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
|--------------|-----|-------------|------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185m | >25 | 0 | 0 | <1 |
| Sodium | ppm | ASTM D5185m | | 1 | 4 | 3 |
| Potassium | ppm | ASTM D5185m | >20 | <1 | 1 | 4 |
| Water | % | ASTM D6304 | >0.05 | 0.005 | 0.040 | 0.008 |
| ppm Water | ppm | ASTM D6304 | >500 | 58 | 400 | 86.0 |

| FLUID CLEANLINESS | | method | limit/base | current | history1 | history2 |
|-------------------|--|--------------|------------|-----------------|------------|------------|
| Particles >4µm | | ASTM D7647 | | 5586 | 10475 | 9585 |
| Particles >6µm | | ASTM D7647 | >1300 | 1722 | ▲ 4471 | ▲ 4057 |
| Particles >14µm | | ASTM D7647 | >80 | 50 | ▲ 657 | ▲ 325 |
| Particles >21µm | | ASTM D7647 | >20 | 10 | ▲ 184 | ▲ 59 |
| Particles >38µm | | ASTM D7647 | >4 | 1 | ▲ 8 | 2 |
| Particles >71µm | | ASTM D7647 | >3 | 0 | 0 | 0 |
| Oil Cleanliness | | ISO 4406 (c) | >--/17/13 | 20/18/13 | ▲ 21/19/17 | ▲ 20/19/16 |

| FLUID DEGRADATION | | method | limit/base | current | history1 | history2 |
|-------------------|----------|------------|------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 0.4 | 0.38 | 0.33 | 0.34 |


OIL ANALYSIS REPORT

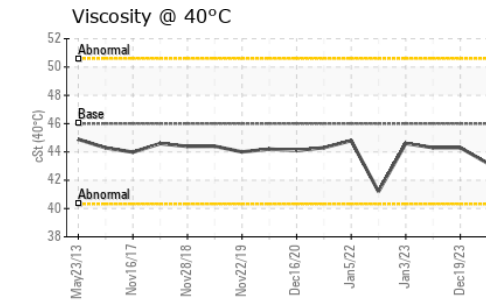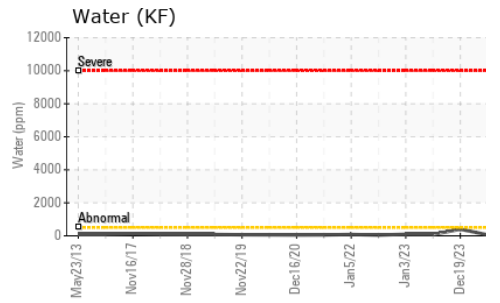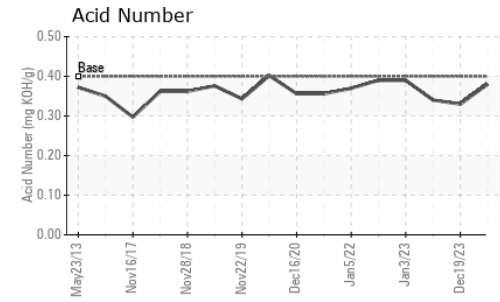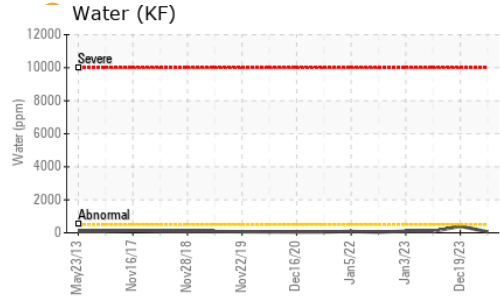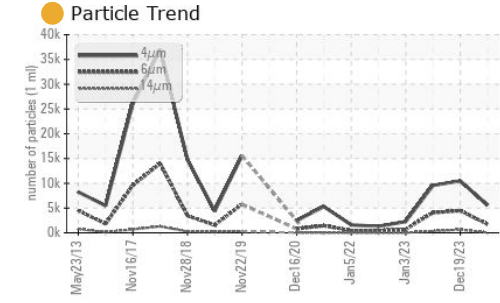





| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >0.05 | NEG | NEG |
| Free Water | scalar | *Visual | | NEG | NEG |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|--------------|---------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 46 | 43.2 | 44.3 | 44.3 |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

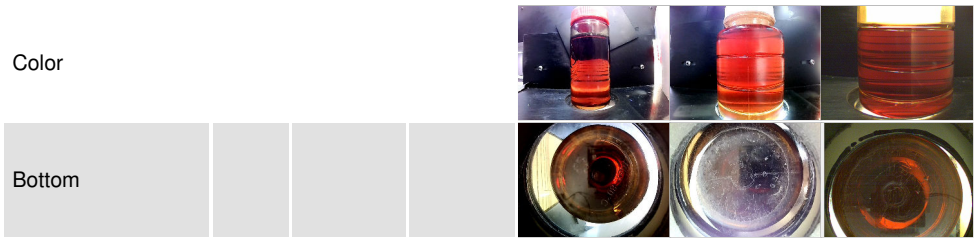

GRAPHS

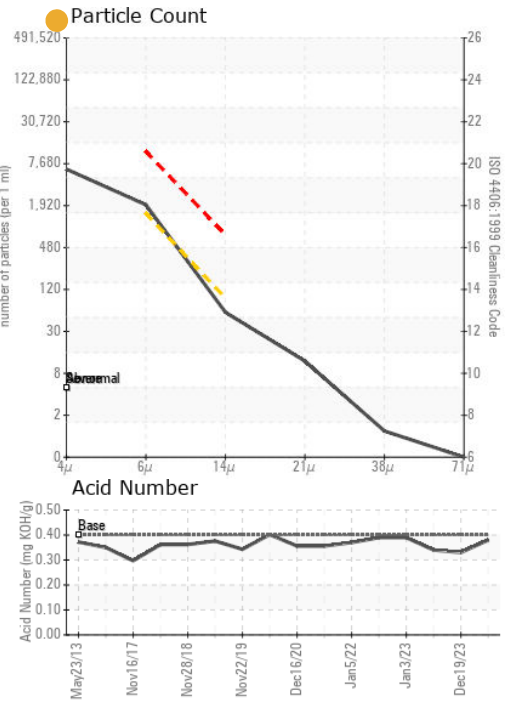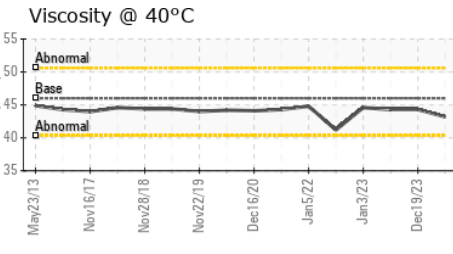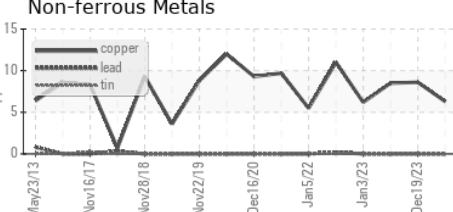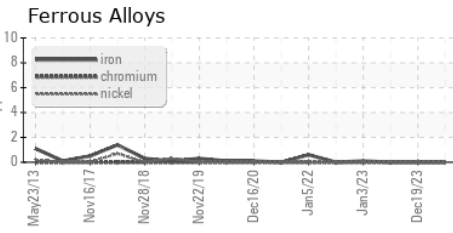

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA014327 **Received** : 15 Jul 2024
Lab Number : 06235972 **Tested** : 16 Jul 2024
Unique Number : 11124806 **Diagnosed** : 17 Jul 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

WL PLASTICS
 2160 S BUSINESS 84
 SNYDER, TX
 US 79549
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: