


OIL ANALYSIS REPORT

Sample Rating Trend

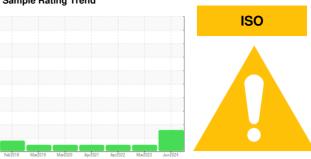

Machine Id

KAESER SM 8 1950946 (S/N 1205)

Compressor

KAESER SIGMA (OEM) M-460 (--- QTS)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Feb 2018	Mar2019 Mar2020	Apr2021 Apr2022 Mar2023	Jun 2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA018852	KCP53281	KCP44474
Sample Date		Client Info		17 Jun 2024	31 Mar 2023	11 Apr 2022
Machine Age	hrs	Client Info		50754	47786	44872
Oil Age	hrs	Client Info		2969	2914	3209
Oil Changed		Client Info		Changed	Changed	Changed
Sample Status				ABNORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	<1
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	<1	<1	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	1	2	1
Tin	ppm	ASTM D5185m	>10	0	0	<1
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	<1
Barium	ppm	ASTM D5185m	90	34	41	39
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m	100	53	80	74
Calcium	ppm	ASTM D5185m	0	0	5	1
Phosphorus	ppm	ASTM D5185m	0	0	6	4
Zinc	ppm	ASTM D5185m	0	0	10	2
Sulfur	ppm	ASTM D5185m	23500	22440	24553	16805
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	2	2
Sodium	ppm	ASTM D5185m		20	23	17
Potassium	ppm	ASTM D5185m	>20	4	2	<1
Water	%	ASTM D6304	>0.05	0.020	0.021	0.023
ppm Water	ppm	ASTM D6304	>500	209	219.7	231.0
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		28911	3165	3904
Particles >6µm		ASTM D7647	>1300	<u> </u>	1129	631
Particles >14μm		ASTM D7647	>80	^ 709	72	42
Particles >21μm		ASTM D7647	>20	<u> 101</u>	10	11
Particles >38μm		ASTM D7647	>4	4	0	0
Particles >71μm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>22/21/17</u>	19/17/13	16/13
FLUID DEGRADA	TION	method	limit/base	current	history1	history2



OIL ANALYSIS REPORT

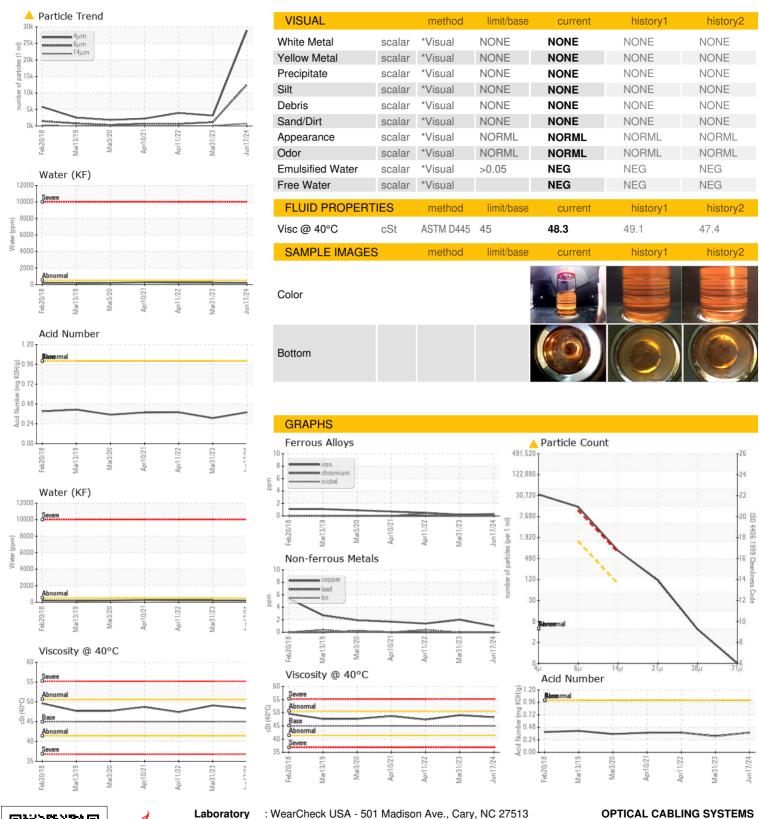





Laboratory Sample No.

: KCPA018852 Lab Number : 06235994 Unique Number: 11124828

Received : 15 Jul 2024 **Tested** Diagnosed

: 16 Jul 2024 : 17 Jul 2024 - Don Baldridge

PLANO, TX US 75074 Contact: Service Manager

2621 SUMMIT AVE, SUITE 100

Test Package : IND 2 (Additional Tests: KF, PrtCount) Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: