




# OIL ANALYSIS REPORT

Sample Rating Trend

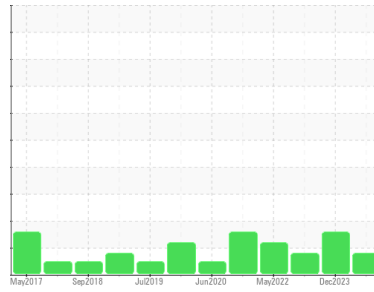

ISO



Machine Id  
**KAESER SM 15 3392670 (S/N 1126)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA019360</b>	KCPA011142	KCPA004115
Sample Date	Client Info			<b>24 Jun 2024</b>	29 Dec 2023	18 Jul 2023
Machine Age	hrs	Client Info		<b>53885</b>	50447	50130
Oil Age	hrs	Client Info		<b>3436</b>	0	0
Oil Changed	Client Info			<b>Changed</b>	N/A	N/A
Sample Status				<b>ATTENTION</b>	ABNORMAL	ATTENTION

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	<1	<1
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	2	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	9	6	24
Tin	ppm	ASTM D5185m	>10	0	<1	0
Vanadium	ppm	ASTM D5185m		0	0	<1
Cadmium	ppm	ASTM D5185m		0	<1	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	2	0
Molybdenum	ppm	ASTM D5185m		0	<1	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m	90	11	61	23
Calcium	ppm	ASTM D5185m	2	0	4	0
Phosphorus	ppm	ASTM D5185m		0	16	2
Zinc	ppm	ASTM D5185m		7	28	41
Sulfur	ppm	ASTM D5185m		<b>20075</b>	20485	19993

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	<1
Sodium	ppm	ASTM D5185m		10	7	8
Potassium	ppm	ASTM D5185m	>20	2	2	2
Water	%	ASTM D6304	>0.05	<b>0.014</b>	▲ 0.717	0.019
ppm Water	ppm	ASTM D6304	>500	<b>144</b>	▲ 7170	191.9

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>5394</b>	---	1719
Particles >6µm		ASTM D7647	>1300	● <b>1583</b>	---	483
Particles >14µm		ASTM D7647	>80	<b>67</b>	---	45
Particles >21µm		ASTM D7647	>20	<b>13</b>	---	17
Particles >38µm		ASTM D7647	>4	<b>0</b>	---	1
Particles >71µm		ASTM D7647	>3	<b>0</b>	---	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	● <b>20/18/13</b>	---	18/16/13

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.33</b>	0.36	0.34

# OIL ANALYSIS REPORT

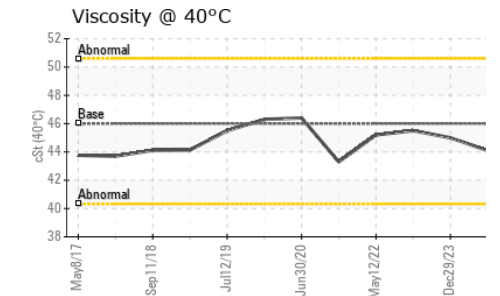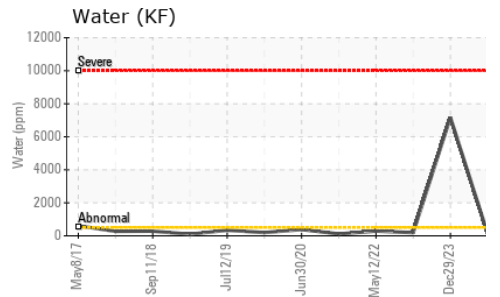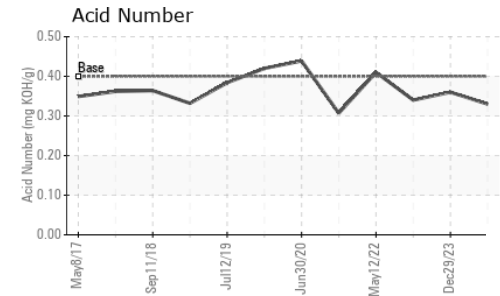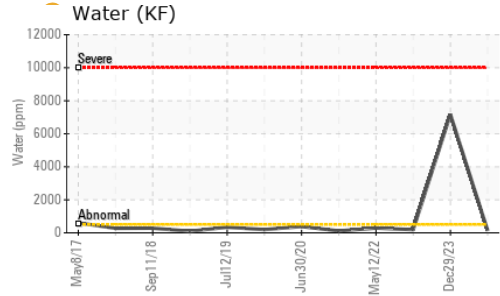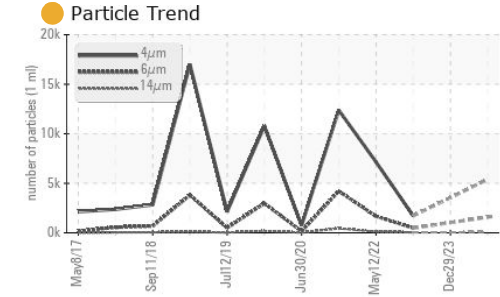






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	HEAVY	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	0.2%
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.1	45.0	45.5

**SAMPLE IMAGES**

method	limit/base	current	history1	history2
Color				
Bottom				

## GRAPHS

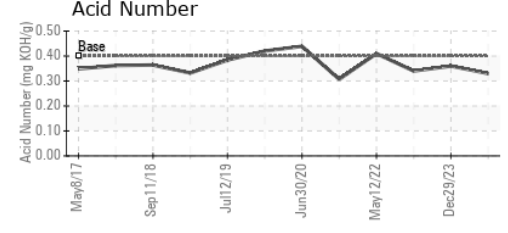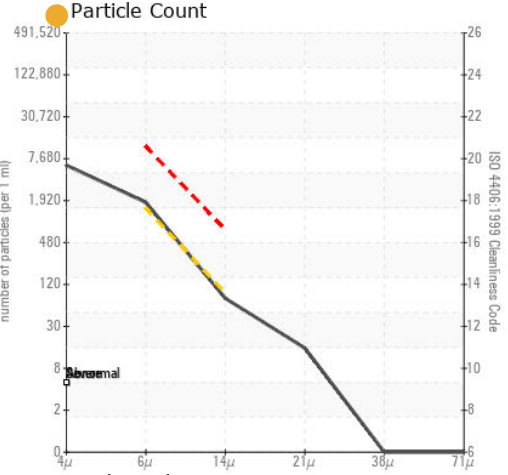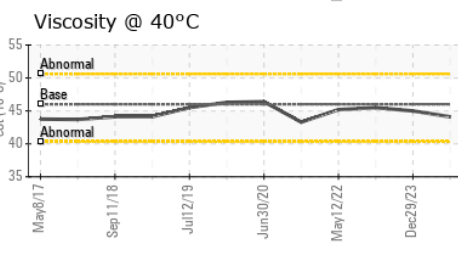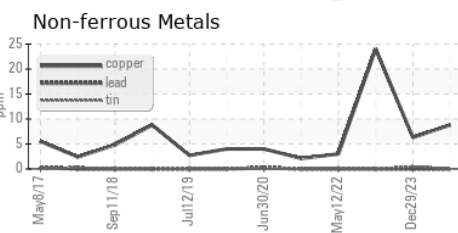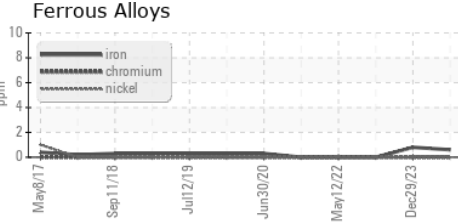

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA019360 **Received** : 15 Jul 2024  
**Lab Number** : 06235998 **Tested** : 16 Jul 2024  
**Unique Number** : 11124832 **Diagnosed** : 17 Jul 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**OXMOOR TOYOTA**  
 8003 SHELBYVILLE RD  
 LOUISVILLE, KY  
 US 40222  
 Contact: J. MIDDLETON  
 jmiddleton@oxmoorautogroup.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)