




# OIL ANALYSIS REPORT

Sample Rating Trend

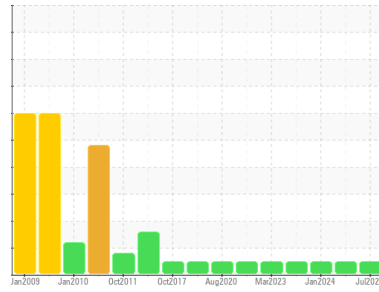

**NORMAL**



Machine Id  
**O2 REACTOR DISCHARGER (S/N 420XX228)**  
 Component  
**Gearbox**  
 Fluid  
**ROYAL PURPLE SYNFILM GT 320 (10 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The water content is negligible. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0892346</b>	WC0432399	WC0432377
Sample Date	Client Info		<b>03 Jul 2024</b>	25 Mar 2024	11 Jan 2024
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >200	<b>40</b>	43	2
Chromium	ppm	ASTM D5185m >15	<b>0</b>	<1	0
Nickel	ppm	ASTM D5185m >15	<b>0</b>	1	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >25	<b>&lt;1</b>	1	0
Lead	ppm	ASTM D5185m >100	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >200	<b>0</b>	<1	0
Tin	ppm	ASTM D5185m >25	<b>0</b>	0	13
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	2	<1
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m 90	<b>51</b>	68	84
Calcium	ppm	ASTM D5185m	<b>0</b>	13	<1
Phosphorus	ppm	ASTM D5185m	<b>114</b>	123	8
Zinc	ppm	ASTM D5185m	<b>0</b>	7	0
Sulfur	ppm	ASTM D5185m	<b>21720</b>	19756	18980

## CONTAMINANTS




	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	<b>8</b>	9	9
Sodium	ppm	ASTM D5185m	<b>2</b>	1	1
Potassium	ppm	ASTM D5185m >20	<b>1</b>	1	0
Water	%	ASTM D6304 >0.2	<b>0.008</b>	0.007	0.030
ppm Water	ppm	ASTM D6304 >2000	<b>80</b>	76	303

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.25	<b>0.44</b>	0.50	0.43




# OIL ANALYSIS REPORT

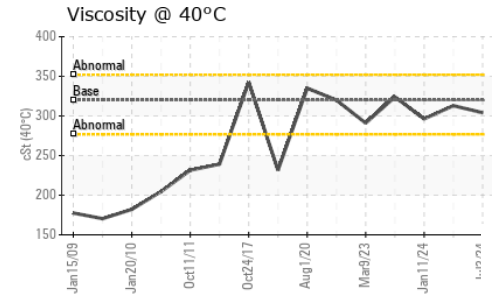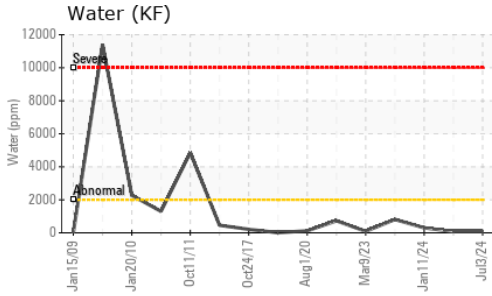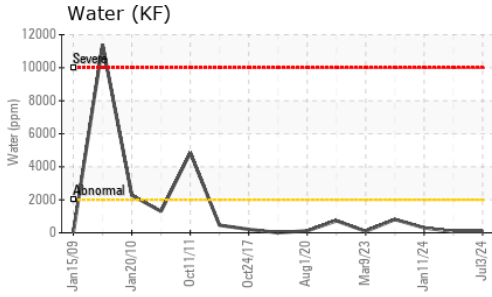





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	320	304	313

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

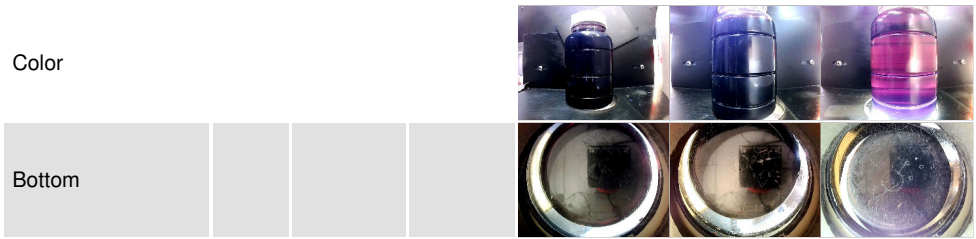

## GRAPHS

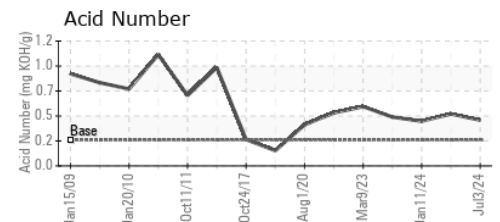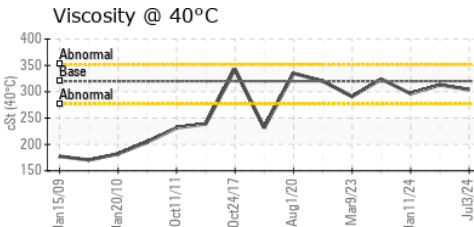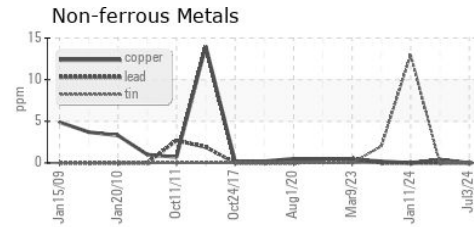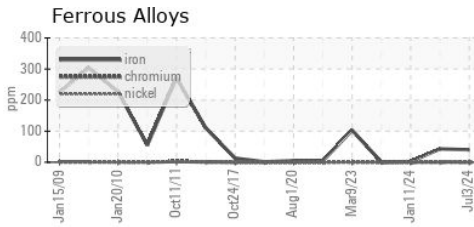

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0892346 **Received** : 15 Jul 2024  
**Lab Number** : 06236100 **Tested** : 16 Jul 2024  
**Unique Number** : 11124934 **Diagnosed** : 16 Jul 2024 - Wes Davis  
**Test Package** : IND 2 ( Additional Tests: KF )

**INTERNATIONAL PAPER**  
 1785 Weyerhaeuser Road  
 VANCEBORO, NC  
 US 28586  
 Contact: DOUG WEIR

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Doug.Weir@ipaper.com;jon.fazenbaker@wearcheck.com

T: (252)633-7350

F: (252)633-7761