

# **OIL ANALYSIS REPORT**

Sample Rating Trend



Machine Id

# P-5220-C (S/N GP37001) Component Pump

**ROYAL PURPLE SYNDRAULIC 68 (1 GAL)** 

## Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

## Contamination

The water content is negligible. There is no indication of any contamination in the oil.


## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		<u>,                                      </u>		Jul2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		RP0045862		
Sample Date		Client Info		10 Jul 2024		
Machine Age	hrs	Client Info		43775		
Oil Age	hrs	Client Info		3645		
Oil Changed	1110	Client Info		N/A		
Sample Status				NORMAL		
·			11 1.0			
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>90	1		
Chromium	ppm	ASTM D5185m	>5	0		
Nickel	ppm	ASTM D5185m	>5	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>3	0		
Aluminum	ppm	ASTM D5185m	>7	0		
Lead	ppm	ASTM D5185m	>12	0		
Copper	ppm	ASTM D5185m	>30	11		
Tin	ppm	ASTM D5185m	>9	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		76		
Phosphorus	ppm	ASTM D5185m		587		
Zinc	ppm	ASTM D5185m		668		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>60	<1		
Sodium	ppm	ASTM D5185m	>00	1		
Potassium	ppm	ASTM D5185m	>20	<1		
Water	%	ASTM D6304		0.003		
ppm Water	ppm	ASTM D6304		38		
FLUID DEGRADA	• •	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	mmbasc	0.73		
VISUAL	mg Korry		limit/base		history1	history2
White Metal	oocler	method *Visual	NONE	current NONE	history1	history2
	scalar					
Yellow Metal	scalar	*Visual	NONE NONE	NONE NONE		
Precipitate Silt	scalar			NONE		
	scalar	*Visual	NONE			
Debris	scalar		NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>.1	NEG	 Submitte	ed B <u>y: T</u> eam Sur
Free Water	scalar	*Visual		NEG	Submitte	Page 1 of 2



## **OIL ANALYSIS REPORT**

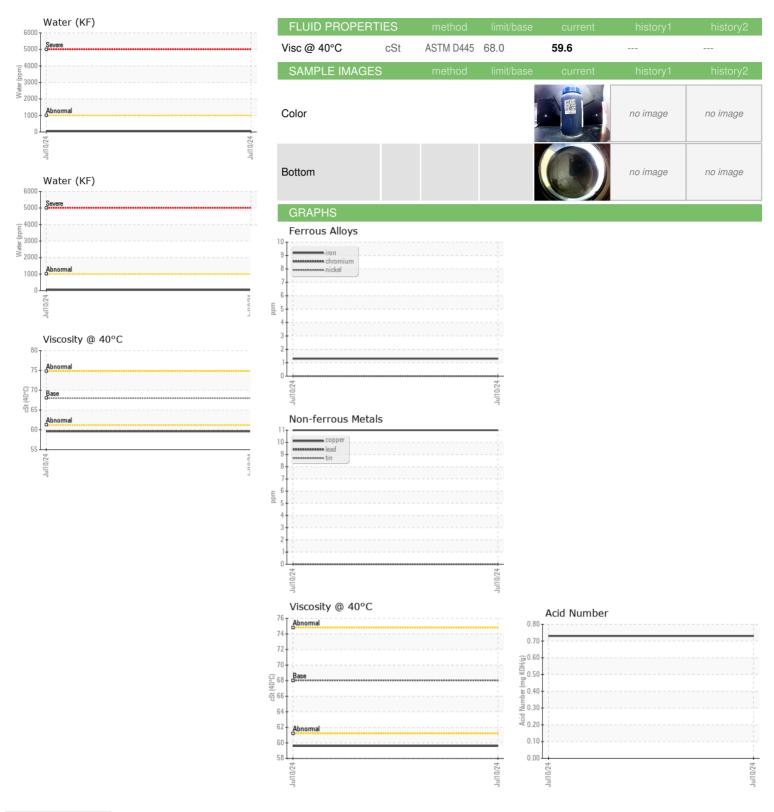



Laboratory Sample No.

: RP0045862

Lab Number : 06236114 Unique Number : 11124948

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 15 Jul 2024 **Tested** : 17 Jul 2024

Diagnosed

: 17 Jul 2024 - Jonathan Hester

Test Package : IND 2 Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) **TEAM SUR S.A.S.** 

BOGOTA, CO Contact: Team Sur

jconde@teamsur.com T: (300)740-0654