




# OIL ANALYSIS REPORT

Sample Rating Trend

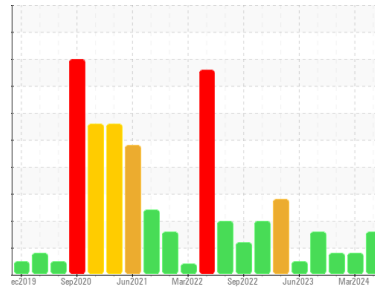

Machine Id  
**CUTI\_U2120 CUTI\_U2120\_P2120**  
 Component  
**Drive End Pump**  
 Fluid  
**ROYAL PURPLE SYNFILM GT 32 (--- GAL)**

## DIAGNOSIS

### Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

### Wear

The tin level is abnormal. All other component wear rates are normal.

### Contamination

There is a moderate amount of visible silt present in the sample.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>RP0043836</b>	RP0029019	RP0025780
Sample Date	Client Info	<b>27 Jun 2024</b>	19 Mar 2024	26 Dec 2023
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>ABNORMAL</b>	MARGINAL	MARGINAL

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >75	<1	2	<1
Chromium	ppm	ASTM D5185m >5	0	<1	0
Nickel	ppm	ASTM D5185m	0	<1	0
Titanium	ppm	ASTM D5185m	0	<1	<1
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >5	<1	1	0
Lead	ppm	ASTM D5185m >10	<1	2	1
Copper	ppm	ASTM D5185m >15	7	8	11
Tin	ppm	ASTM D5185m	▲ 39	▲ 31	▲ 60
Vanadium	ppm	ASTM D5185m	0	<1	<1
Cadmium	ppm	ASTM D5185m	0	<1	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	0	<1	0
Molybdenum	ppm	ASTM D5185m	0	4	0
Manganese	ppm	ASTM D5185m	0	<1	<1
Magnesium	ppm	ASTM D5185m	53	79	78
Calcium	ppm	ASTM D5185m	0	70	4
Phosphorus	ppm	ASTM D5185m	0	51	11
Zinc	ppm	ASTM D5185m	0	26	0

## CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >20	<1	2	0
Sodium	ppm	ASTM D5185m	1	0	2
Potassium	ppm	ASTM D5185m >20	<1	<1	0
Water	%	ASTM D6304 >.1	<b>0.024</b>	0.008	0.016
ppm Water	ppm	ASTM D6304 >1000	<b>250</b>	82	161





## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.35</b>	0.34	0.34

## VISUAL


method	limit/base	current	history1	history2	
White Metal	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual NONE	▲ <b>MODER</b>	NONE	NONE
Debris	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual >.1	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual	<b>NEG</b>	NEG	NEG

# OIL ANALYSIS REPORT

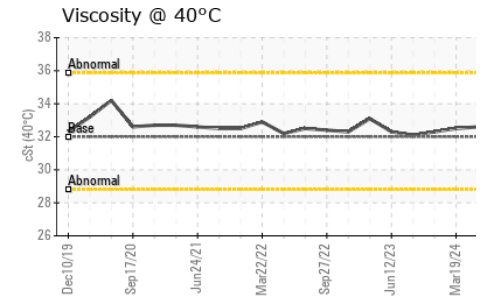
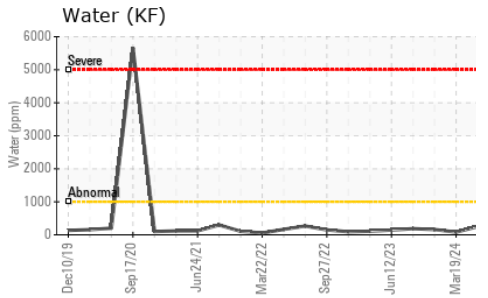
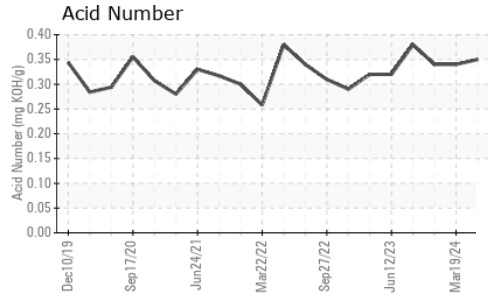
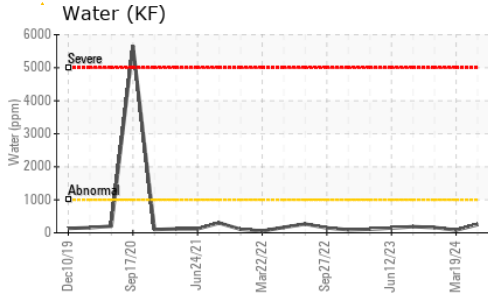


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 32	<b>32.6</b>	32.5	32.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

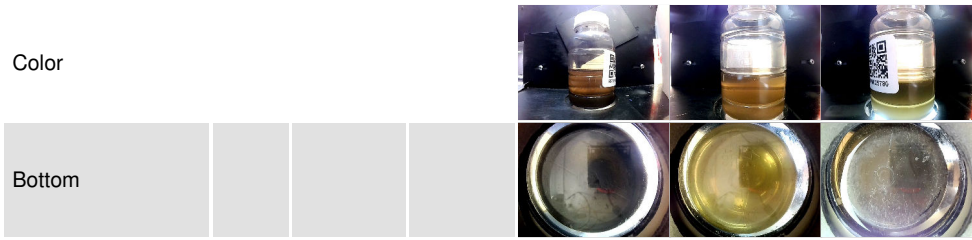

## GRAPHS

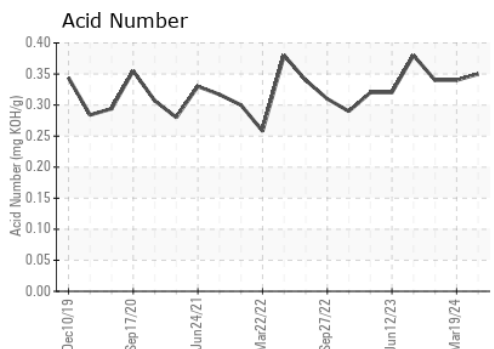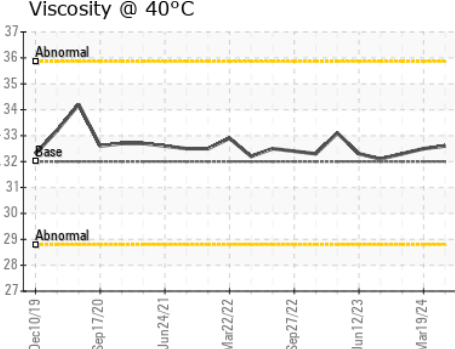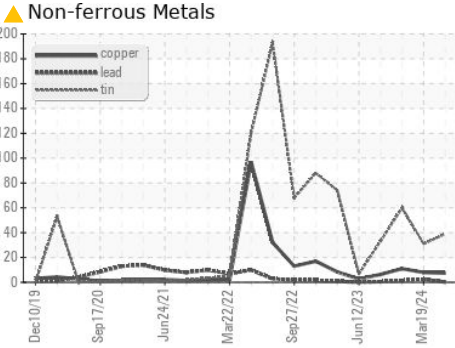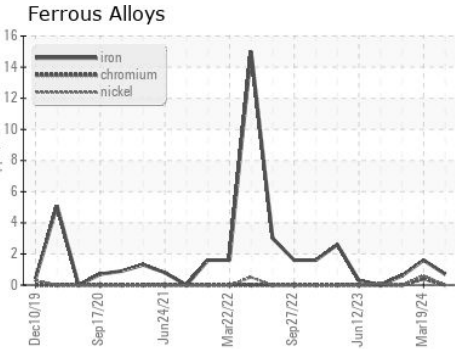

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0043836  
**Lab Number** : 06236123  
**Unique Number** : 11124957  
**Test Package** : IND 2  
**Received** : 15 Jul 2024  
**Tested** : 16 Jul 2024  
**Diagnosed** : 17 Jul 2024 - Don Baldrige

**ENERGY TRANSFER - UTCIA**  
 7077 19 MILE ROAD  
 STERLING HEIGHTS, MI  
 US 48317  
 Contact: SCOTT VERHELLE

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (313)580-0267

F: