




# OIL ANALYSIS REPORT

## Sample Rating Trend

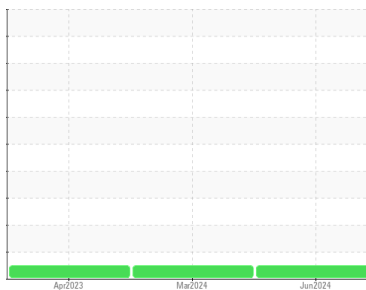

**NORMAL**



Machine Id  
**QUINCY QGV-50 UTY302670 - FOREMOST FARMS**  
 Component  
**Compressor**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>UCZ06236143</b>	UCZ06156139	UCZ05866847
Sample Date	Client Info			<b>26 Jun 2024</b>	27 Mar 2024	21 Apr 2023
Machine Age	hrs	Client Info		<b>16712</b>	0	0
Oil Age	hrs	Client Info		<b>2180</b>	4031	0
Oil Changed	Client Info			<b>Not Changed</b>	Changed	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	<1	<1
Chromium	ppm	ASTM D5185m	>5	<b>0</b>	<1	0
Nickel	ppm	ASTM D5185m		<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m		<b>0</b>	<1	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>15	<b>0</b>	2	0
Lead	ppm	ASTM D5185m	>65	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>65	<b>0</b>	<1	0
Tin	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	<1	0


ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	<1	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	<1	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m		<b>2</b>	<1	<1
Calcium	ppm	ASTM D5185m		<b>1</b>	<1	0
Phosphorus	ppm	ASTM D5185m		<b>&lt;1</b>	4	4
Zinc	ppm	ASTM D5185m		<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m		<b>0</b>	0	3

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	<b>&lt;1</b>	<1	0
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	1	0
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	1	<1

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	.10	<b>0.41</b>	0.49	0.49




# OIL ANALYSIS REPORT

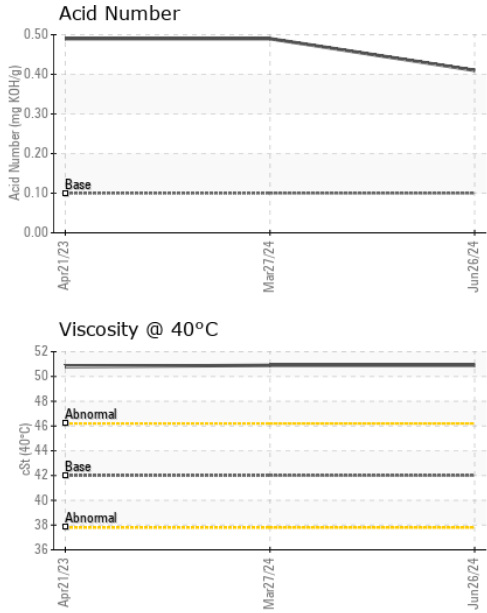



VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	MODER
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	42	<b>50.9</b>	50.9	50.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

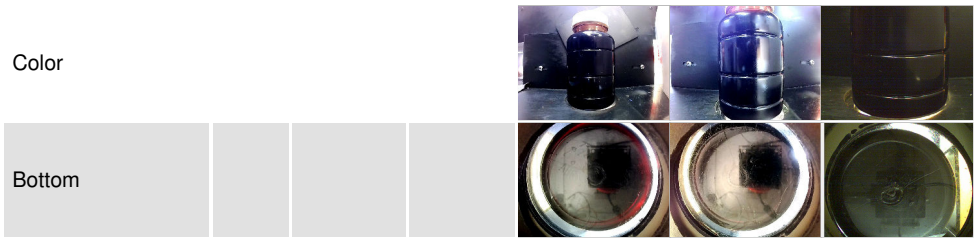

## GRAPHS

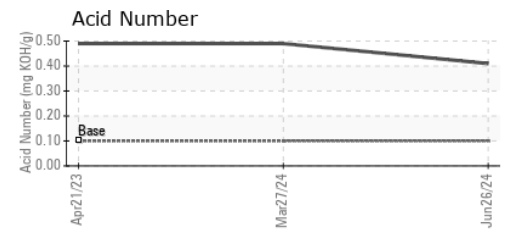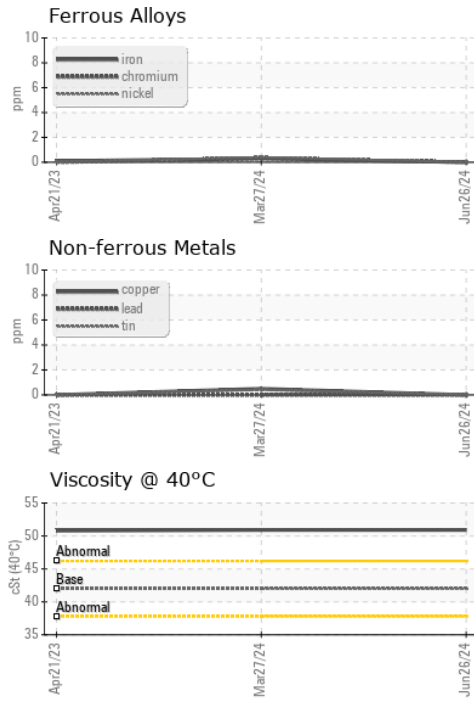

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCZ06236143      **Received** : 15 Jul 2024  
**Lab Number** : **06236143**      **Tested** : 16 Jul 2024  
**Unique Number** : 11124977      **Diagnosed** : 16 Jul 2024 - Wes Davis  
**Test Package** : IND 2

**ZORN COMP & EQUIPMENT CO (GB)**  
 733 POTTS AVE  
 GREEN BAY, WI  
 US 54304  
 Contact: DEAN SCHAD  
 dean.schad@zornair.com  
 T: (920)391-8121  
 F: (920)499-1168

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)