



OIL ANALYSIS REPORT

Sample Rating Trend



DEGRADATION



Area

COOLANT PE

Machine Id

INGERSOLL RAND R575I M0X1002476 - ND PACKAGING

Component

Compressor

DIAGNOSIS

● Recommendation

We advise that you check for a possible overheat condition. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

● Fluid Condition

The oil viscosity is higher than normal. The AN level is at the top-end of the recommended limit.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			UCZ06236146	---	---
Sample Date	Client Info			05 Jul 2024	---	---
Machine Age	hrs	Client Info		23489	---	---
Oil Age	hrs	Client Info		6000	---	---
Oil Changed	Client Info			Changed	---	---
Sample Status				ATTENTION	---	---

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	NEG	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	---	---
Chromium	ppm	ASTM D5185m	>5	0	---	---
Nickel	ppm	ASTM D5185m		0	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m		0	---	---
Aluminum	ppm	ASTM D5185m	>15	0	---	---
Lead	ppm	ASTM D5185m	>65	0	---	---
Copper	ppm	ASTM D5185m	>65	<1	---	---
Tin	ppm	ASTM D5185m	>10	0	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
Cadmium	ppm	ASTM D5185m		0	---	---



ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	---	---
Barium	ppm	ASTM D5185m	700	471	---	---
Molybdenum	ppm	ASTM D5185m	0	0	---	---
Manganese	ppm	ASTM D5185m	0	0	---	---
Magnesium	ppm	ASTM D5185m	0	2	---	---
Calcium	ppm	ASTM D5185m	0	3	---	---
Phosphorus	ppm	ASTM D5185m	0	3	---	---
Zinc	ppm	ASTM D5185m	0	<1	---	---
Sulfur	ppm	ASTM D5185m	630	496	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	<1	---	---
Sodium	ppm	ASTM D5185m		40	---	---
Potassium	ppm	ASTM D5185m	>20	8	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.200	● 1.51	---	---



OIL ANALYSIS REPORT

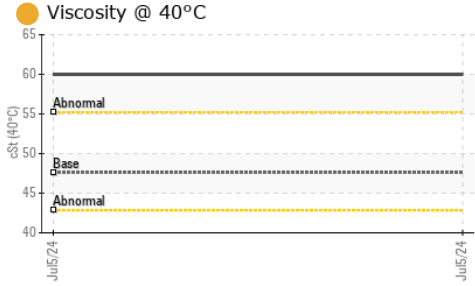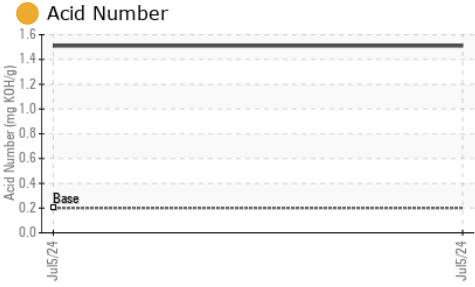





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	47.6	● 60.0	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

GRAPHS

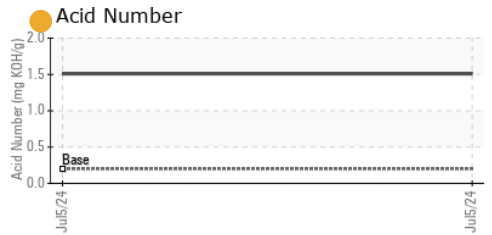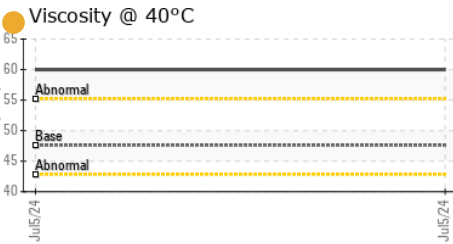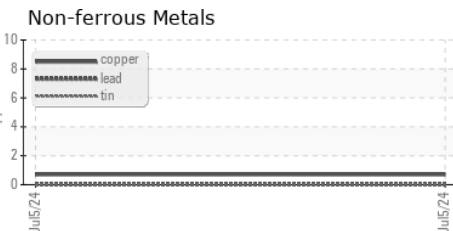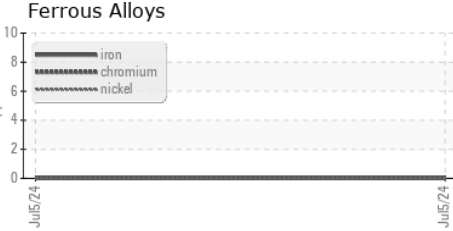

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCZ06236146 **Received** : 15 Jul 2024
Lab Number : 06236146 **Tested** : 16 Jul 2024
Unique Number : 11124980 **Diagnosed** : 17 Jul 2024 - Don Baldrige
Test Package : IND 2

ZORN COMP & EQUIPMENT INC - MAIN
 1335 E WISCONSIN AVE
 PEWAUKEE, WI
 US 53072
 Contact: TONY STELLA
 tony.stella@zornair.com
 T: (800)476-4637
 F: (262)695-7017

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)