





OIL ANALYSIS REPORT

Sample Rating Trend

WEAR



Machine Id
Durham unit 1 (S/N 6181411)
 Component
Biogas Engine
 Fluid
D-A Lubricant Blue Flame HB-8 40W (130 GAL)

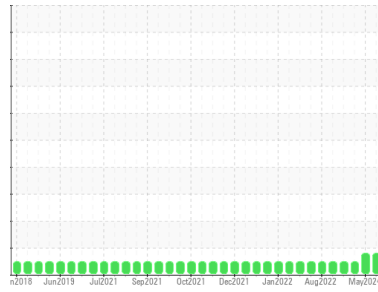

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

▲ Wear

The copper level is abnormal. All other component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WCM2249832	WCM2249834	WCM2249829
Sample Date	Client Info		12 Jul 2024	17 May 2024	02 Apr 2024
Machine Age	hrs	Client Info	2733	1572	506
Oil Age	hrs	Client Info	0	1572	506
Oil Changed	Client Info		N/A	Not Changd	N/A
Sample Status			ABNORMAL	ABNORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Water	WC Method	>.2	NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	8	6	3
Chromium	ppm	ASTM D5185m >5	<1	<1	0
Nickel	ppm	ASTM D5185m >2	0	<1	0
Titanium	ppm	ASTM D5185m	0	<1	0
Silver	ppm	ASTM D5185m >5	0	<1	0
Aluminum	ppm	ASTM D5185m >15	4	4	2
Lead	ppm	ASTM D5185m >20	0	2	0
Copper	ppm	ASTM D5185m >15	▲ 21	▲ 16	5
Tin	ppm	ASTM D5185m >5	<1	2	0
Vanadium	ppm	ASTM D5185m	0	<1	0
Cadmium	ppm	ASTM D5185m	0	<1	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	69	64	55
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	<1	2	<1
Manganese	ppm	ASTM D5185m	<1	<1	0
Magnesium	ppm	ASTM D5185m	11	8	4
Calcium	ppm	ASTM D5185m	1600	1556	1539
Phosphorus	ppm	ASTM D5185m	286	313	284
Zinc	ppm	ASTM D5185m	334	354	323
Sulfur	ppm	ASTM D5185m	1763	1901	2086

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >200	117	79	31
Sodium	ppm	ASTM D5185m >20	3	0	2
Potassium	ppm	ASTM D5185m >20	0	3	0

INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844 >2	0	0	0
Nitration	Abs/cm	*ASTM D7624 >20	9.1	8.2	6.7
Sulfation	Abs/.1mm	*ASTM D7415 >30	19.0	19.7	16.2


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	16.0	15.0	11.4
Acid Number (AN)	mg KOH/g	ASTM D8045	2.13	1.92	1.34
Base Number (BN)	mg KOH/g	ASTM D2896 8	3.44	3.62	4.00




OIL ANALYSIS REPORT


▲ Non-ferrous Metals

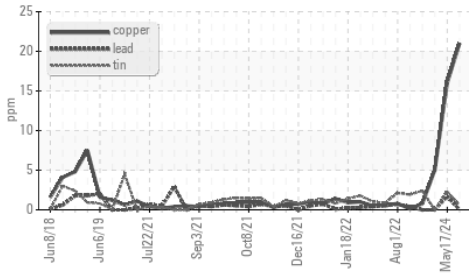


FT-IR (Direct Trend)

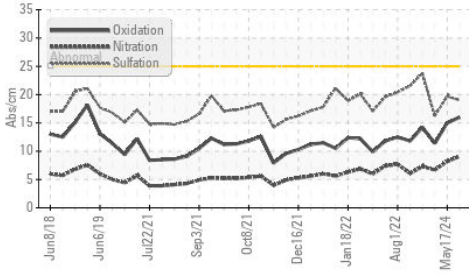


Acid Number

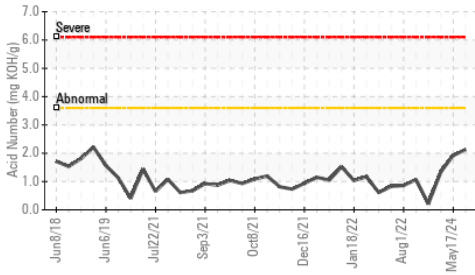

Base Number

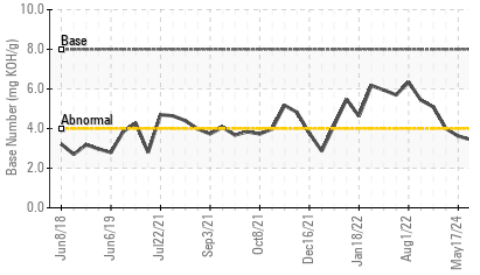









Viscosity @ 100°C

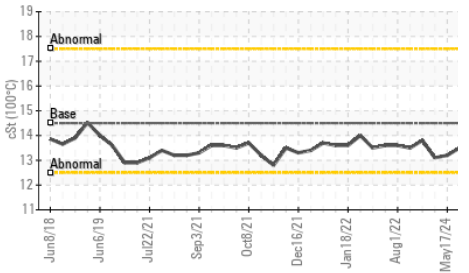

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.5	13.5	13.2

GRAPHS

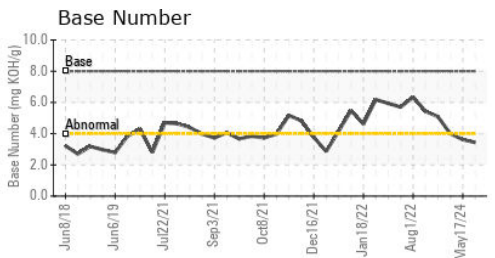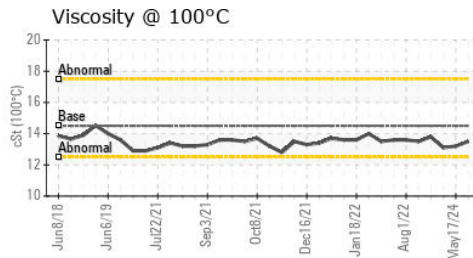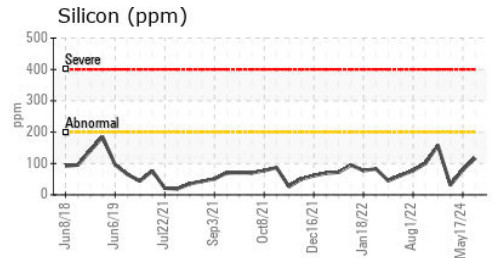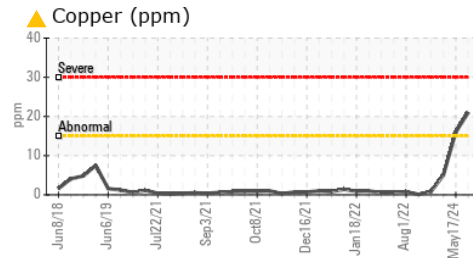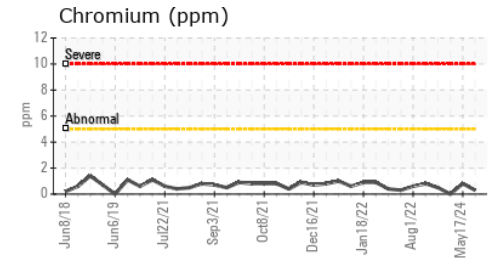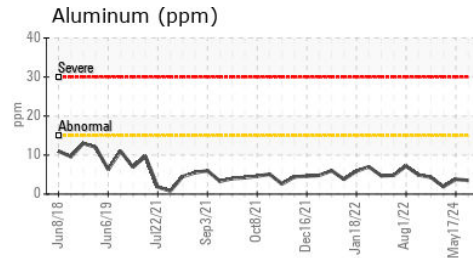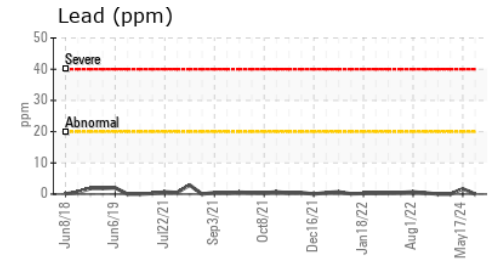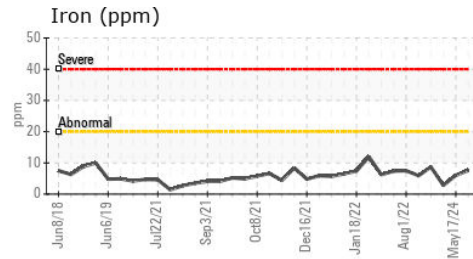

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WCM2249832

Lab Number : 06236247

Unique Number : 11125081

Test Package : MOB 2

Received : 15 Jul 2024

Tested : 16 Jul 2024

Diagnosed : 16 Jul 2024 - Sean Felton

METHANE POWER DURHAM - MAS ENERGY

2115 EAST CLUB BLVD

DURHAM, NC

US 27704

Contact: KAYLA LEHMANN

KLEHMANN@MAS-ENERGY.COM

T: (504)228-6289

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)