




OIL ANALYSIS REPORT

Sample Rating Trend

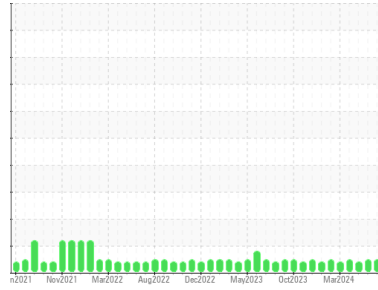

NORMAL



Area
Martinsville
 Machine Id
[Martinsville] Oil - Starboard Genset
 Component
Starboard Genset
 Fluid
DIESEL ENGINE OIL SAE 15W40 (7 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. (Customer Sample Comment: George Willis)

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0898343	WC0845892	WC0845883
Sample Date	Client Info			06 Jul 2024	07 Jun 2024	11 May 2024
Machine Age	hrs	Client Info		3524	3071	2792
Oil Age	hrs	Client Info		481	0	243
Oil Changed	Client Info			Changed	Changed	Not Changd
Sample Status				NORMAL	NORMAL	ATTENTION

CONTAMINATION		method	limit/base	current	history1	history2
Glycol	WC Method			NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	11	3	8
Chromium	ppm	ASTM D5185m	>4	0	<1	<1
Nickel	ppm	ASTM D5185m	>2	0	<1	<1
Titanium	ppm	ASTM D5185m		0	<1	<1
Silver	ppm	ASTM D5185m	>5	0	<1	1
Aluminum	ppm	ASTM D5185m	>12	<1	2	1
Lead	ppm	ASTM D5185m	>17	0	<1	2
Copper	ppm	ASTM D5185m	>70	<1	<1	2
Tin	ppm	ASTM D5185m	>15	0	<1	1
Vanadium	ppm	ASTM D5185m		0	<1	<1
Cadmium	ppm	ASTM D5185m		0	<1	<1

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	250	5	12	10
Barium	ppm	ASTM D5185m	10	0	0	0
Molybdenum	ppm	ASTM D5185m	100	64	59	65
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m	450	1532	1406	1519
Calcium	ppm	ASTM D5185m	3000	1270	1119	1215
Phosphorus	ppm	ASTM D5185m	1150	1098	941	1135
Zinc	ppm	ASTM D5185m	1350	1284	1215	1308
Sulfur	ppm	ASTM D5185m	4250	3804	3160	4020






CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	3	5	5
Sodium	ppm	ASTM D5185m	>158	3	<1	0
Potassium	ppm	ASTM D5185m	>20	0	2	2
Fuel	%	ASTM D3524	>4.0	<1.0	<1.0	<1.0
Water	%	ASTM D6304	>0.1	NEG	NEG	NEG

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		0.3	0.1	0.2
Nitration	Abs/cm	*ASTM D7624	>20	8.0	5.6	6.9
Sulfation	Abs/.1mm	*ASTM D7415	>30	20.0	17.8	18.8

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	15.5	13.6	14.7
Base Number (BN)	mg KOH/g	ASTM D2896	8.5	13.02	12.85	12.49







OIL ANALYSIS REPORT

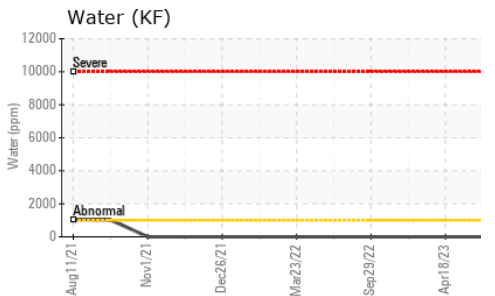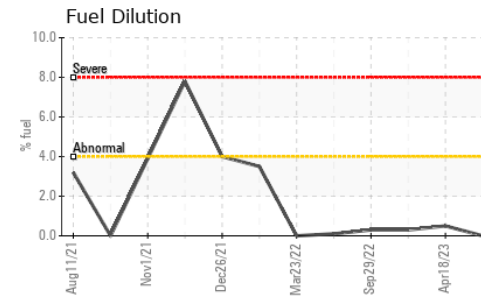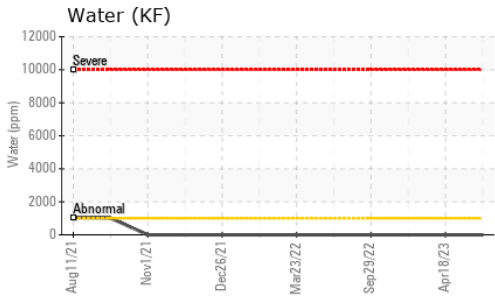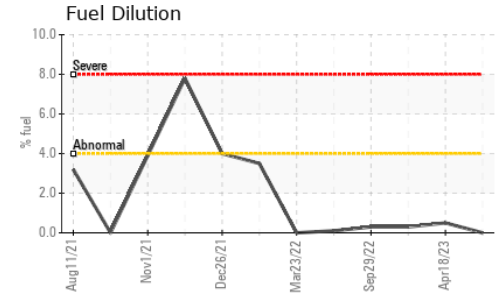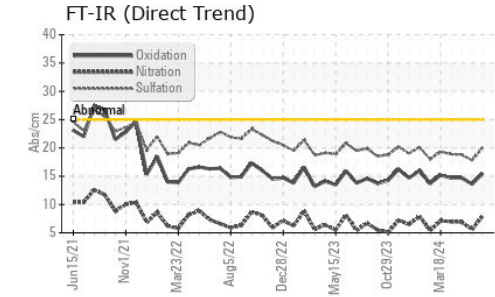

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.4	12.3	14.1

GRAPHS

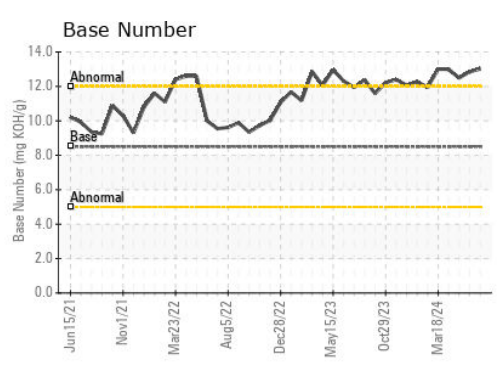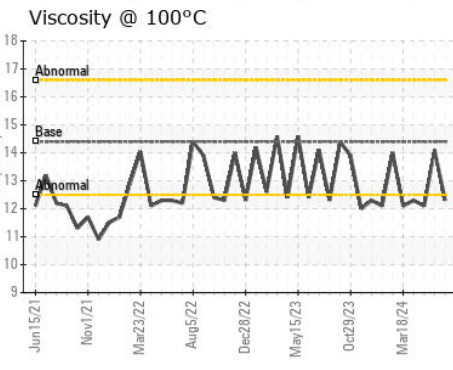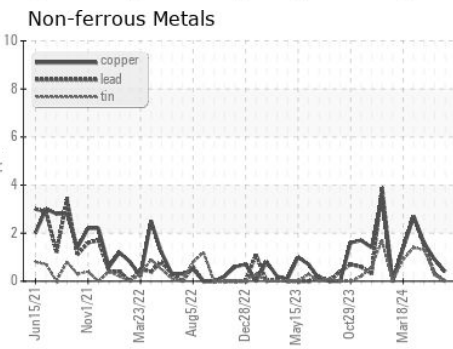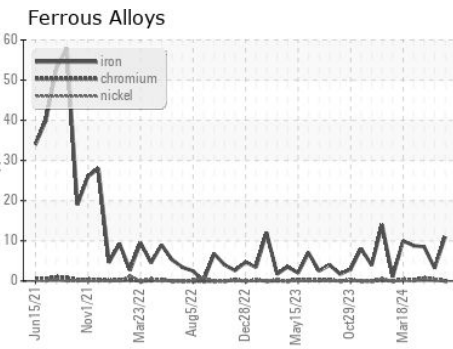

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0898343
Lab Number : 06236276
Unique Number : 11125110
Test Package : IND 2 (Additional Tests: FuelDilution, KF, PercentFuel)

MARATHON PETROLEUM CO.
 101 12TH ST
 CATLETTSBURG, KY
 US 41169
 Contact: CORY GUMBERT
 cagumbert@marathonpetroleum.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (606)585-3950

F: x: