




# OIL ANALYSIS REPORT

Sample Rating Trend

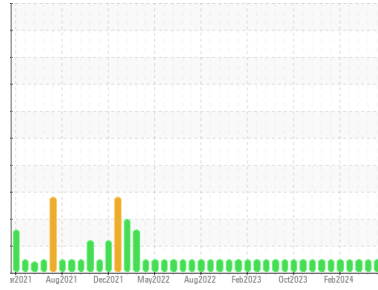

**NORMAL**



Area

**Speedway**

Machine Id

**[Speedway] Oil - Forward Genset**

Component

**Forward Genset**

Fluid

**MOBIL 15W40 (8 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor. ( Customer Sample Comment: Top Up Amount: 3 GAL )

### Wear

All component wear rates are normal for time on oil.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0874684</b>	WC0845798	WC0860108
Sample Date	Client Info			<b>08 Jul 2024</b>	15 May 2024	05 Apr 2024
Machine Age	hrs	Client Info		<b>13111</b>	12606	12095
Oil Age	hrs	Client Info		<b>13035</b>	12529	12018
Oil Changed	Client Info			<b>Oil Added</b>	Oil Added	Oil Added
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>4.0		<b>&lt;1.0</b>	<1.0	<1.0
Glycol	WC Method			<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>38</b>	27	29
Chromium	ppm	ASTM D5185m	>4	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>5	<b>0</b>	<1	0
Aluminum	ppm	ASTM D5185m	>12	<b>&lt;1</b>	1	2
Lead	ppm	ASTM D5185m	>17	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m	>70	<b>&lt;1</b>	0	0
Tin	ppm	ASTM D5185m	>15	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>4</b>	5	8
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>68</b>	67	69
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m		<b>1608</b>	1593	1529
Calcium	ppm	ASTM D5185m		<b>1333</b>	1290	1180
Phosphorus	ppm	ASTM D5185m		<b>1153</b>	1175	1117
Zinc	ppm	ASTM D5185m		<b>1439</b>	1459	1383
Sulfur	ppm	ASTM D5185m		<b>3965</b>	4015	3767

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>5</b>	6	6
Sodium	ppm	ASTM D5185m	>118	<b>14</b>	11	12
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	<1
Water	%	ASTM D6304	>0.1	<b>NEG</b>	NEG	NEG


INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		<b>0.3</b>	0.2	0.2
Nitration	Abs/cm	*ASTM D7624	>20	<b>12.8</b>	12.7	13.5
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>22.8</b>	22.0	23.3

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>23.7</b>	23.9	26.4
Base Number (BN)	mg KOH/g	ASTM D2896		<b>10.04</b>	12.33	11.81




# OIL ANALYSIS REPORT


FT-IR (Direct Trend)

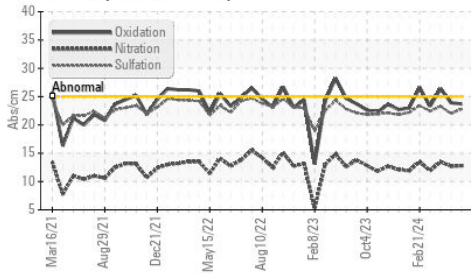


Water (KF)

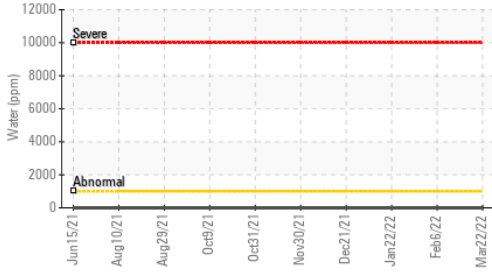

Base Number

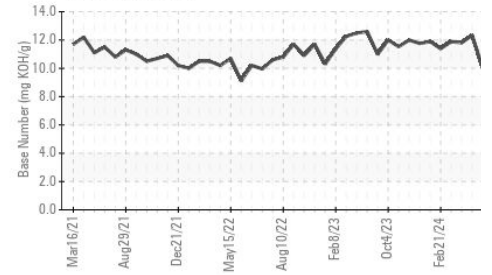

Water (KF)

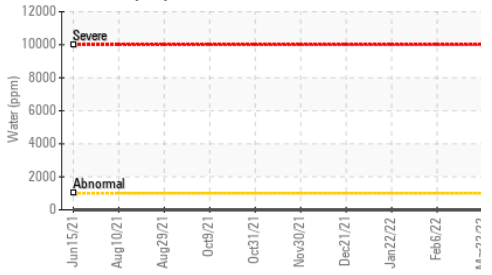


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	12.9	12.7	13.0

## GRAPHS


Ferrous Alloys

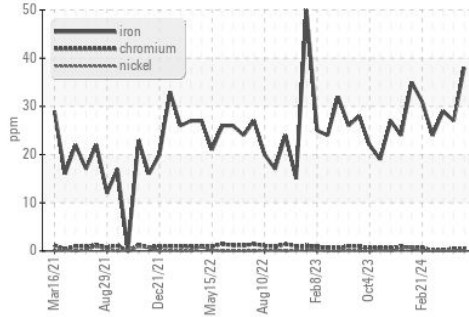


Non-ferrous Metals

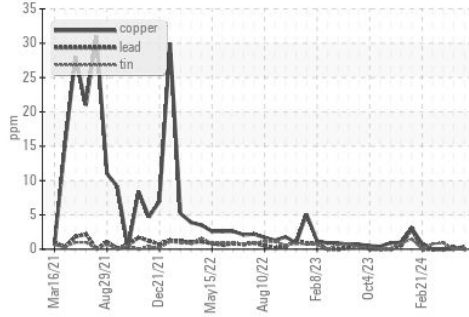

Viscosity @ 100°C

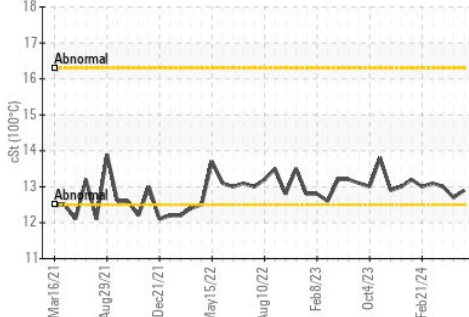

Base Number

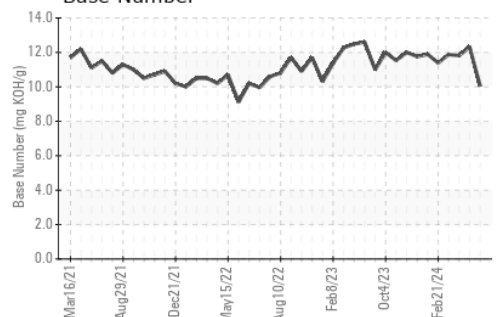

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0874684 **Received** : 15 Jul 2024  
**Lab Number** : 06236289 **Tested** : 16 Jul 2024  
**Unique Number** : 11125123 **Diagnosed** : 16 Jul 2024 - Sean Felton  
**Test Package** : IND 2 ( Additional Tests: KF )

**MARATHON PETROLEUM CO.**  
 101 12TH ST  
 CATLETTSBURG, KY  
 US 41169  
 Contact: CORY GUMBERT  
 cagumbert@marathonpetroleum.com  
 T: (606)585-3950  
 F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)