




FUEL REPORT

Sample Rating Trend

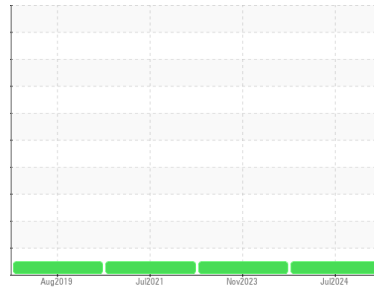

NORMAL



Area
Martinsville
 Machine Id
[Martinsville] Diesel - #1 Port
 Component
Diesel Fuel
 Fluid
No.2 DIESEL FUEL (ULTRALOW SULPHUR) (16500 GAL)

DIAGNOSIS

Recommendation
 No corrective action is recommended at this time. (Customer Sample Comment: George Willis)

Corrosion
 All metal levels are normal indicating no corrosion in the system.

Contaminants
 The water content is negligible. There is no indication of any contamination in the fuel.

Fuel Condition
 The condition of the fuel is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0735545	WC0845976	RP0004207
Sample Date	Client Info			06 Jul 2024	27 Nov 2023	25 Jul 2021
Machine Age	hrs	Client Info		15000	0	0
Sample Status				NORMAL	NORMAL	NORMAL

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	3.0	2.46	2.5	2.25

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	10	0	7	26

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	<1	0	0
Sodium	ppm	ASTM D5185m	<0.1	2	<1	0
Potassium	ppm	ASTM D5185m	<0.1	<1	0	0
Water	%	ASTM D6304	<0.05	0.002	0.003	0.004
ppm Water	ppm	ASTM D6304	<500	23	39	49.2




HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m	<0.1	0	0	<1
Nickel	ppm	ASTM D5185m	<0.1	0	0	0
Lead	ppm	ASTM D5185m	<0.1	0	0	0
Vanadium	ppm	ASTM D5185m	<0.1	0	0	0
Iron	ppm	ASTM D5185m	<0.1	0	0	0
Calcium	ppm	ASTM D5185m	<0.1	0	<1	11
Magnesium	ppm	ASTM D5185m	<0.1	0	<1	8
Phosphorus	ppm	ASTM D5185m	<0.1	0	<1	12
Zinc	ppm	ASTM D5185m	<0.1	0	0	8

SAMPLE IMAGES


		method	limit/base	current	history1	history2
Color						
Bottom						



FUEL REPORT

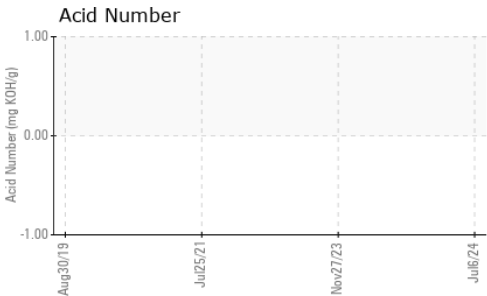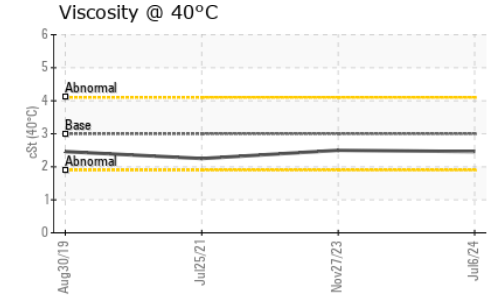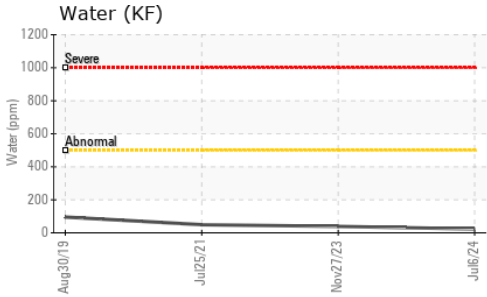

GRAPHS

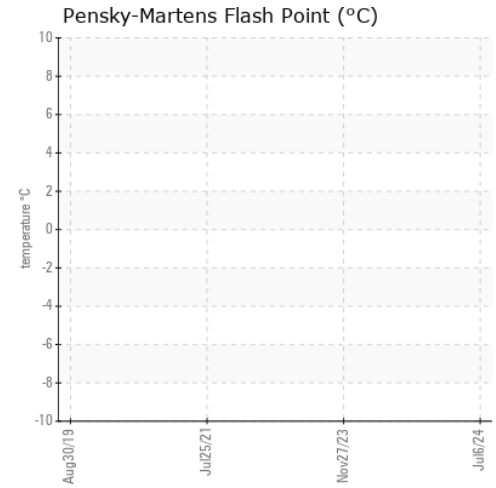

Certificate L2367

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0735545
Lab Number : 06236705
Unique Number : 11125539
Test Package : IND 2 (Additional Tests: KF)

Received : 15 Jul 2024
Tested : 17 Jul 2024
Diagnosed : 17 Jul 2024 - Jonathan Hester

MARATHON PETROLEUM CO.
 101 12TH ST
 CATLETTSBURG, KY
 US 41169

Contact: CORY GUMBERT
 cagumbert@marathonpetroleum.com

T: (606)585-3950

F: x: