




# OIL ANALYSIS REPORT

Sample Rating Trend

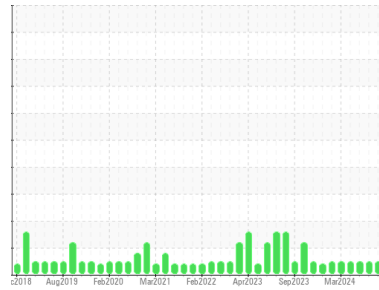

**NORMAL**



Machine Id  
**KAESER B61275 - KAESER 1 (S/N 1223)**  
 Component  
**Compressor**  
 Fluid  
**ULTRACHEM OMNILUBE 32/46 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0953081</b>	WC0921403	WC0921399
Sample Date	Client Info			<b>08 Jul 2024</b>	11 Jun 2024	13 May 2024
Machine Age	hrs	Client Info		<b>64040</b>	63437	62817
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>Not Changed</b>	Not Changed	Not Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.05	<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	<1	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	0	1
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>0</b>	<1	2
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0





ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	1	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	0.3	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	0	<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m	0	<b>2</b>	0	0
Calcium	ppm	ASTM D5185m	0.5	<b>0</b>	0	2
Phosphorus	ppm	ASTM D5185m	536	<b>120</b>	152	199
Zinc	ppm	ASTM D5185m	0.2	<b>4</b>	2	8
Sulfur	ppm	ASTM D5185m	649	<b>1069</b>	1060	1319

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	<1
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	1	1
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	2

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>1137</b>	1464	628
Particles >6µm		ASTM D7647	>1300	<b>427</b>	536	185
Particles >14µm		ASTM D7647	>80	<b>39</b>	52	7
Particles >21µm		ASTM D7647	>20	<b>17</b>	12	2
Particles >38µm		ASTM D7647	>4	<b>1</b>	0	0
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>17/16/12</b>	18/16/13	16/15/10

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.337	<b>0.21</b>	0.21	0.22


# OIL ANALYSIS REPORT

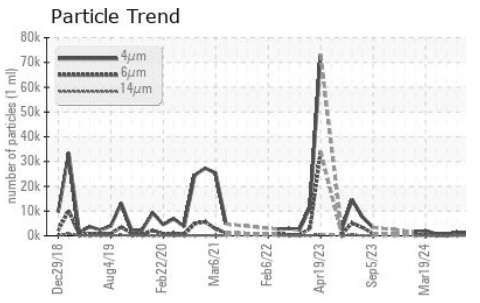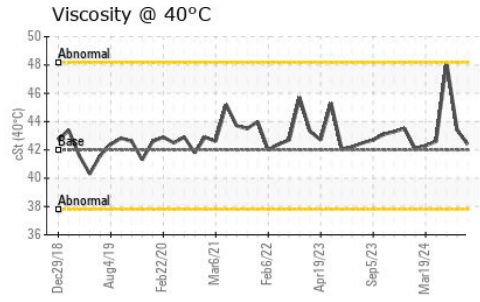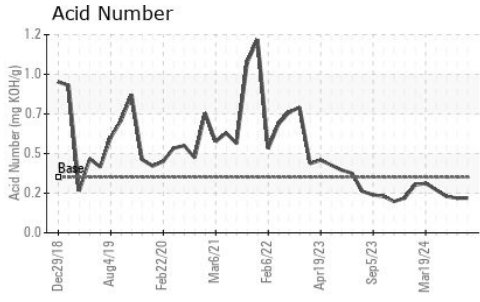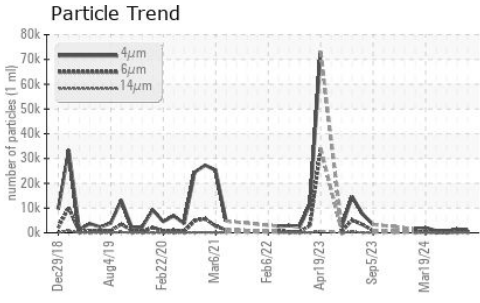






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	42.0	<b>42.4</b>	43.4	48.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

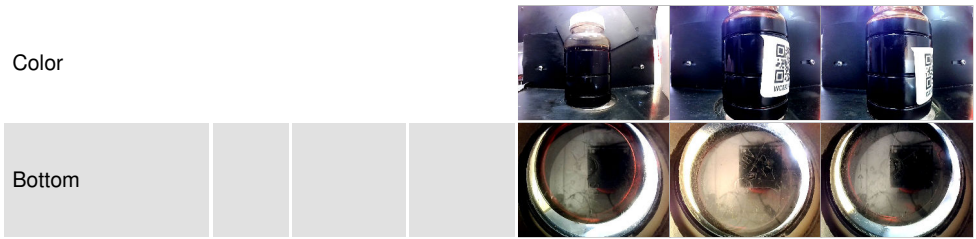

## GRAPHS

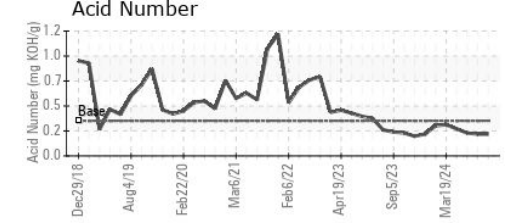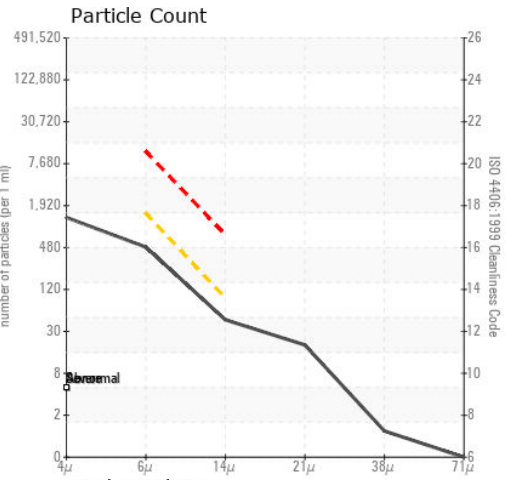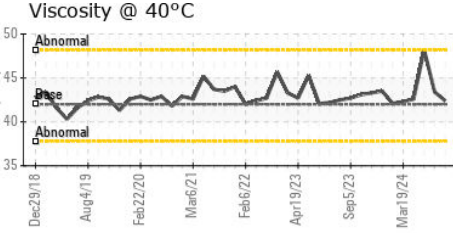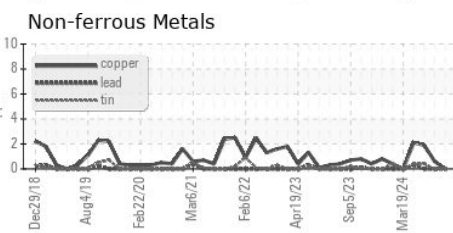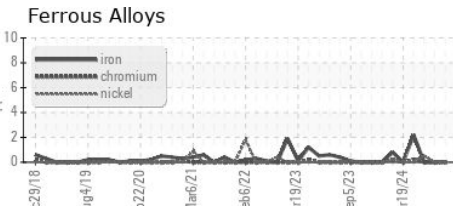

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0953081      **Received** : 15 Jul 2024  
**Lab Number** : **06236799**      **Tested** : 17 Jul 2024  
**Unique Number** : 11125633      **Diagnosed** : 17 Jul 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: PrtCount )

**BURKE CORPORATION.**  
 1516 SOUTH D AVE  
 NEVADA, IA  
 US 50201  
 Contact: EDUARDO COBIO  
 JECOBIO@BURKECORP.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)      F: (515)382-3955