




# OIL ANALYSIS REPORT

## Sample Rating Trend

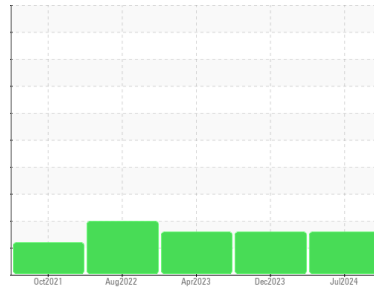

ISO



Machine Id

**KAESER 6498607**

Component

**Compressor**

Fluid

**KAESER SIGMA (OEM) M-460 (--- GAL)**

### DIAGNOSIS

#### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is a high amount of particulates present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA014185</b>	KCPA010075	KCPA000105
Sample Date	Client Info			<b>10 Jul 2024</b>	12 Dec 2023	10 Apr 2023
Machine Age	hrs	Client Info		<b>20914</b>	183843	15362
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>Not Chngd</b>	N/A	N/A
Sample Status				<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	<1
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	0	5
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>1</b>	4	2
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>26</b>	15	21
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	100	<b>74</b>	57	72
Calcium	ppm	ASTM D5185m	0	<b>&lt;1</b>	0	<1
Phosphorus	ppm	ASTM D5185m	0	<b>1</b>	1	2
Zinc	ppm	ASTM D5185m	0	<b>&lt;1</b>	2	5
Sulfur	ppm	ASTM D5185m	23500	<b>21015</b>	18472	19842

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	0	<1
Sodium	ppm	ASTM D5185m		<b>18</b>	8	12
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	0	2
Water	%	ASTM D6304	>0.05	<b>0.020</b>	0.018	0.028
ppm Water	ppm	ASTM D6304	>500	<b>205</b>	186	284.2

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>7763</b>	10825	35557
Particles >6µm		ASTM D7647	>1300	<b>▲ 2781</b>	▲ 3917	▲ 12286
Particles >14µm		ASTM D7647	>80	<b>▲ 206</b>	▲ 348	▲ 451
Particles >21µm		ASTM D7647	>20	<b>▲ 44</b>	▲ 79	▲ 38
Particles >38µm		ASTM D7647	>4	<b>1</b>	3	1
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>▲ 20/19/15</b>	▲ 21/19/16	▲ 22/21/16

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	<b>0.36</b>	0.36	0.39


# OIL ANALYSIS REPORT

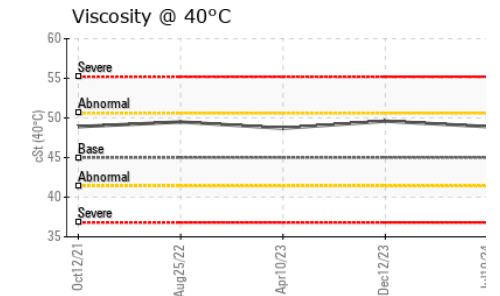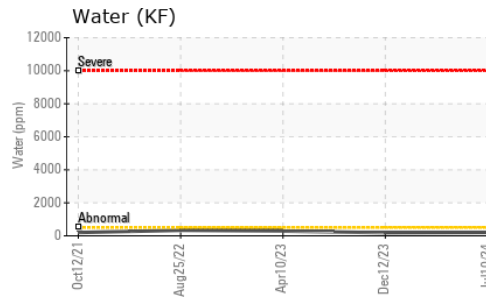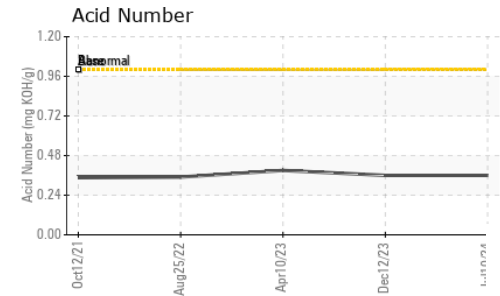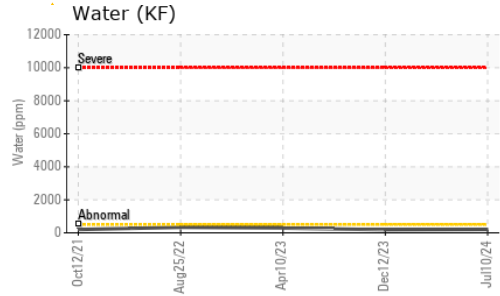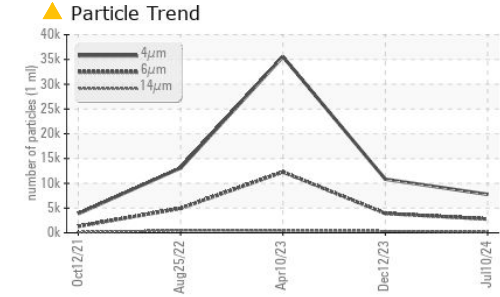





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	48.9	49.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

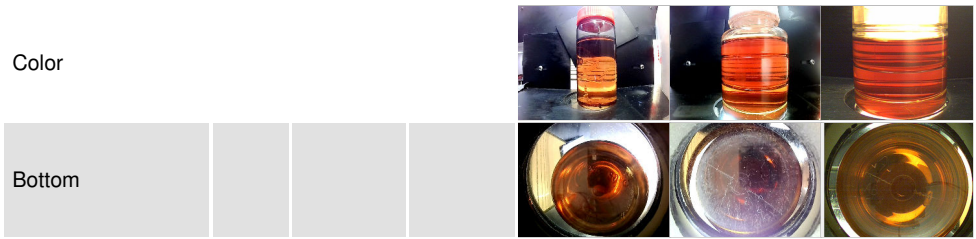

## GRAPHS

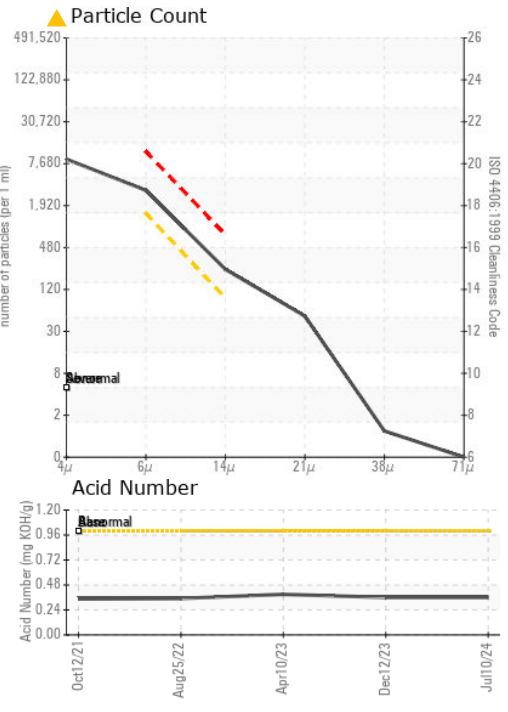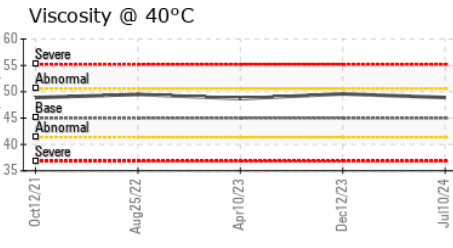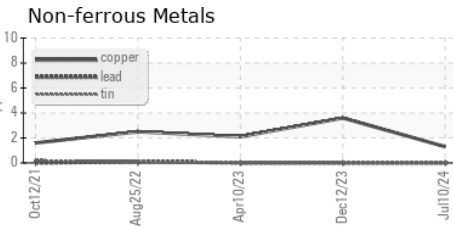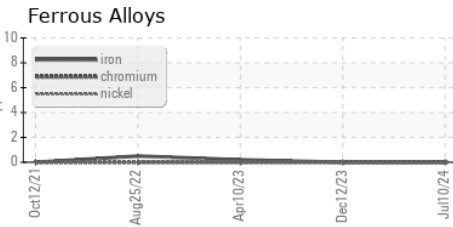

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA014185 **Received** : 15 Jul 2024  
**Lab Number** : 06236801 **Tested** : 17 Jul 2024  
**Unique Number** : 11125635 **Diagnosed** : 17 Jul 2024 - Doug Bogart  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**AMAZON OAK 4**  
 1555 N CHRISMAN RD  
 TRACY, CA  
 US 95304  
 Contact: Service Manager  
 sparcase@amazon.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)