



# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**



Machine Id  
**8394767 (S/N 1192)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## DIAGNOSIS

**Recommendation**  
 Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA016036</b>	---	---
Sample Date	Client Info		<b>10 Jul 2024</b>	---	---
Machine Age	hrs Client Info		<b>6999</b>	---	---
Oil Age	hrs Client Info		<b>4000</b>	---	---
Oil Changed	Client Info		<b>Changed</b>	---	---
Sample Status			<b>NORMAL</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m	>50	<b>0</b>	---	---
Chromium	ppm ASTM D5185m	>10	<b>0</b>	---	---
Nickel	ppm ASTM D5185m	>3	<b>0</b>	---	---
Titanium	ppm ASTM D5185m	>3	<b>0</b>	---	---
Silver	ppm ASTM D5185m	>2	<b>0</b>	---	---
Aluminum	ppm ASTM D5185m	>10	<b>0</b>	---	---
Lead	ppm ASTM D5185m	>10	<b>0</b>	---	---
Copper	ppm ASTM D5185m	>50	<b>9</b>	---	---
Tin	ppm ASTM D5185m	>10	<b>0</b>	---	---
Vanadium	ppm ASTM D5185m		<b>0</b>	---	---
Cadmium	ppm ASTM D5185m		<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	0	<b>0</b>	---	---
Barium	ppm ASTM D5185m	90	<b>0</b>	---	---
Molybdenum	ppm ASTM D5185m	0	<b>0</b>	---	---
Manganese	ppm ASTM D5185m		<b>0</b>	---	---
Magnesium	ppm ASTM D5185m	100	<b>4</b>	---	---
Calcium	ppm ASTM D5185m	0	<b>0</b>	---	---
Phosphorus	ppm ASTM D5185m	0	<b>&lt;1</b>	---	---
Zinc	ppm ASTM D5185m	0	<b>31</b>	---	---
Sulfur	ppm ASTM D5185m	23500	<b>20081</b>	---	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m	>25	<b>&lt;1</b>	---	---
Sodium	ppm ASTM D5185m		<b>1</b>	---	---
Potassium	ppm ASTM D5185m	>20	<b>0</b>	---	---
Water	% ASTM D6304	>0.05	<b>0.008</b>	---	---
ppm Water	ppm ASTM D6304	>500	<b>81</b>	---	---






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>1455</b>	---	---
Particles >6µm	ASTM D7647	>1300	<b>416</b>	---	---
Particles >14µm	ASTM D7647	>80	<b>43</b>	---	---
Particles >21µm	ASTM D7647	>20	<b>9</b>	---	---
Particles >38µm	ASTM D7647	>4	<b>0</b>	---	---
Particles >71µm	ASTM D7647	>3	<b>0</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	<b>18/16/13</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045	1.0	<b>0.36</b>	---	---


# OIL ANALYSIS REPORT

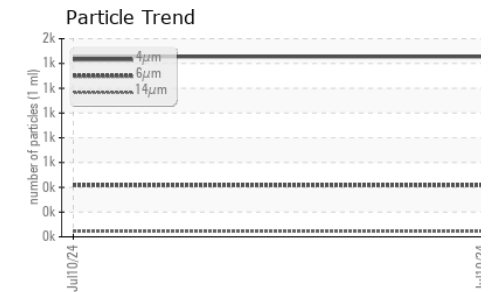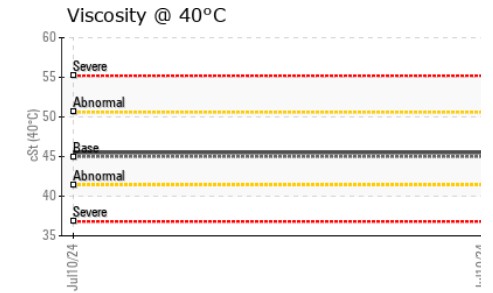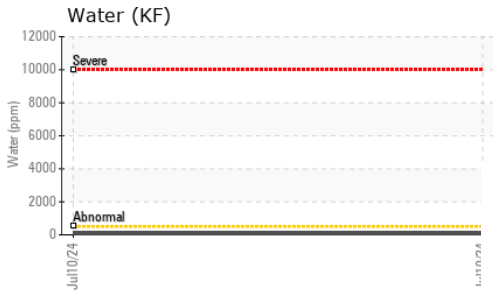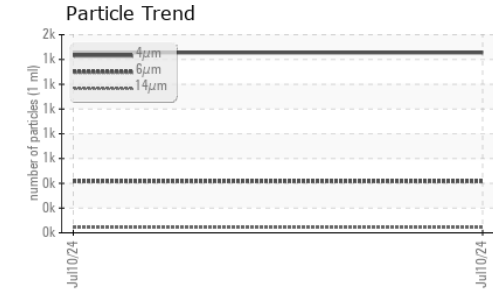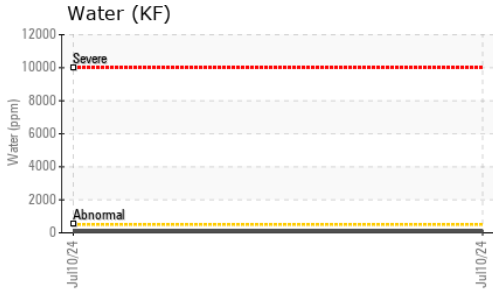






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	45.5	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

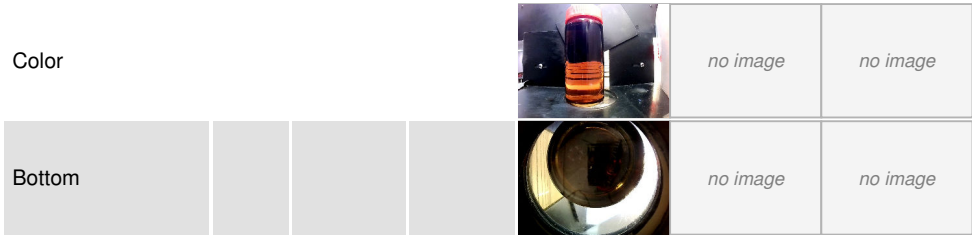

## GRAPHS

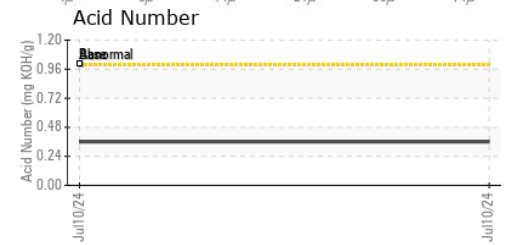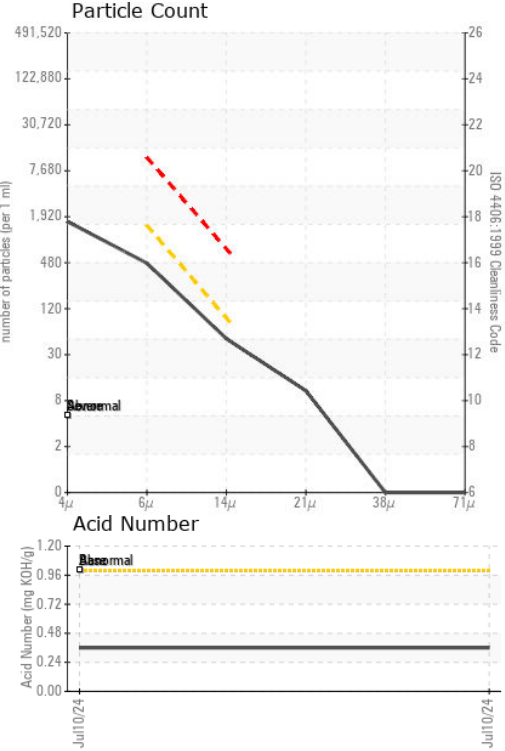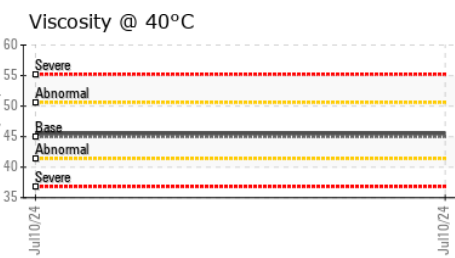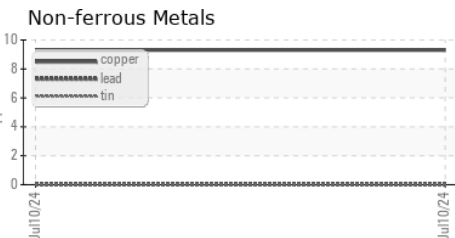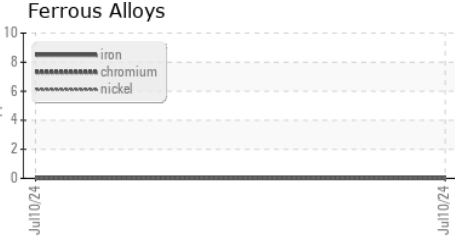

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA016036 **Received** : 15 Jul 2024  
**Lab Number** : 06236805 **Tested** : 17 Jul 2024  
**Unique Number** : 11125639 **Diagnosed** : 17 Jul 2024 - Doug Bogart  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**R & B WAGNER**  
 10600 W BROWN DEER RD  
 MILWAUKEE, WI  
 US 53224  
 Contact: J. WISSBROECKER  
 jwissbroecker@mailwagner.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)