

OIL ANALYSIS REPORT



Machine Id

9119485 (S/N 1566) Compressor

Fluid KAESER SIGMA (OEM) FG-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| SAMPLE INFORM | IATION | method | limit/base | current | history1 | history2 |
|------------------|---------------|--------------|------------|-------------------|----------|----------|
| Sample Number | | Client Info | | KCPA020569 | | |
| Sample Date | | Client Info | | 09 Jul 2024 | | |
| Machine Age | hrs | Client Info | | 2314 | | |
| Oil Age | hrs | Client Info | | 2314 | | |
| Oil Changed | | Client Info | | Changed | | |
| Sample Status | | | | ABNORMAL | | |
| WEAR METALS | | method | limit/base | current | history1 | history2 |
| Iron | ppm | ASTM D5185m | >50 | 16 | | |
| Chromium | ppm | ASTM D5185m | >10 | 0 | | |
| Nickel | ppm | ASTM D5185m | >3 | 0 | | |
| Titanium | ppm | ASTM D5185m | >3 | 0 | | |
| Silver | ppm | ASTM D5185m | >2 | 0 | | |
| Aluminum | ppm | ASTM D5185m | >10 | 3 | | |
| Lead | ppm | ASTM D5185m | >10 | 0 | | |
| Copper | ppm | ASTM D5185m | >50 | 6 | | |
| Tin | ppm | ASTM D5185m | >10 | 0 | | |
| Vanadium | ppm | ASTM D5185m | | 0 | | |
| Cadmium | ppm | ASTM D5185m | | 0 | | |
| ADDITIVES | | method | limit/base | current | history1 | history2 |
| Boron | ppm | ASTM D5185m | | 0 | | |
| Barium | ppm | ASTM D5185m | | <1 | | |
| Molybdenum | ppm | ASTM D5185m | | 0 | | |
| Manganese | ppm | ASTM D5185m | | 0 | | |
| Magnesium | ppm | ASTM D5185m | | 3 | | |
| Calcium | ppm | ASTM D5185m | | 0 | | |
| Phosphorus | ppm | ASTM D5185m | 500 | 147 | | |
| Zinc | ppm | ASTM D5185m | | 78 | | |
| Sulfur | ppm | ASTM D5185m | | 7368 | | |
| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
| Silicon | ppm | ASTM D5185m | >25 | <1 | | |
| Sodium | ppm | ASTM D5185m | | 4 | | |
| Potassium | ppm | ASTM D5185m | >20 | <1 | | |
| Water | % | ASTM D6304 | >0.05 | 0.006 | | |
| ppm Water | ppm | ASTM D6304 | >500 | 60 | | |
| FLUID CLEANLIN | IESS | method | limit/base | current | history1 | history2 |
| Particles >4µm | | ASTM D7647 | | 22320 | | |
| Particles >6µm | | ASTM D7647 | >1300 | <u> </u> | | |
| Particles >14µm | | ASTM D7647 | >80 | <u> </u> | | |
| Particles >21µm | | ASTM D7647 | >20 | <u> </u> | | |
| Particles >38µm | | ASTM D7647 | >4 | <u> </u> | | |
| Particles >71µm | | ASTM D7647 | >3 | 1 | | |
| Oil Cleanliness | | ISO 4406 (c) | >/17/13 | A 22/20/15 | | |
| FLUID DEGRADA | TION | method | limit/base | current | history1 | history2 |
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 1.5 | 0.65 | | |
| · · · · | U - U | | | | | |





Built for a lifetime







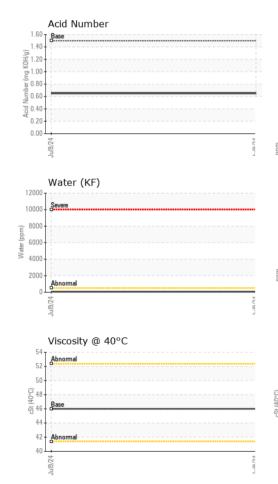

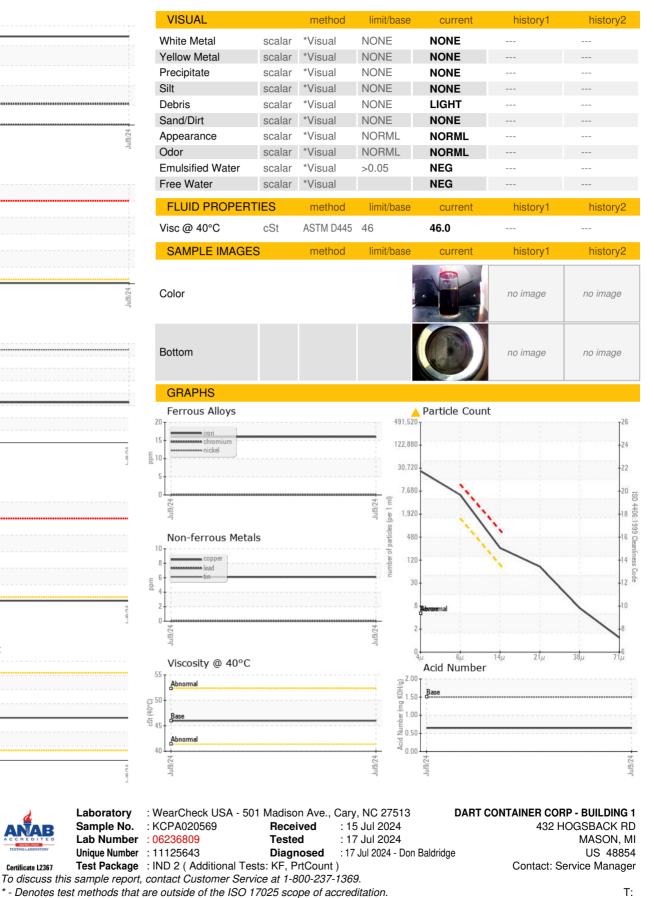

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate 12367

Laboratory

Sample No.

Lab Number

Contact/Location: Service Manager - DARMASMI

F: