




# OIL ANALYSIS REPORT

## Sample Rating Trend

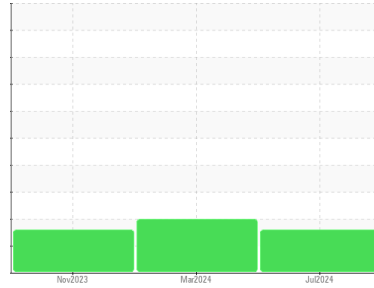

Machine Id  
**KAESER BSD 50T 7378257 (S/N 1033)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

### DIAGNOSIS

#### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is a high amount of particulates present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>KC125150</b>	KC126785	KC06019989
Sample Date	Client Info	<b>09 Jul 2024</b>	07 Mar 2024	02 Nov 2023
Machine Age	hrs	<b>35521</b>	32551	29526
Oil Age	hrs	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

### WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	<1
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	<1
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	2
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m >50	<b>10</b>	7	7
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	<1

### ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 90	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	<1
Manganese	ppm	ASTM D5185m	<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m 90	<b>6</b>	0	13
Calcium	ppm	ASTM D5185m 2	<b>0</b>	0	<1
Phosphorus	ppm	ASTM D5185m	<b>1</b>	0	0
Zinc	ppm	ASTM D5185m	<b>3</b>	0	0

### CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<b>3</b>	<1	1
Sodium	ppm	ASTM D5185m	<b>4</b>	2	0
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	4
Water	%	ASTM D6304 >0.05	<b>0.015</b>	0.008	0.004
ppm Water	ppm	ASTM D6304 >500	<b>151</b>	90	48






### FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	<b>8219</b>	18435	10638
Particles >6µm	ASTM D7647 >1300	<b>▲ 2602</b>	▲ 6041	▲ 4039
Particles >14µm	ASTM D7647 >80	<b>▲ 224</b>	▲ 747	▲ 314
Particles >21µm	ASTM D7647 >20	<b>▲ 72</b>	▲ 237	▲ 68
Particles >38µm	ASTM D7647 >4	<b>4</b>	▲ 5	0
Particles >71µm	ASTM D7647 >3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	<b>▲ 20/19/15</b>	▲ 21/20/17	▲ 21/19/15

### FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.38</b>	0.45	0.40


# OIL ANALYSIS REPORT

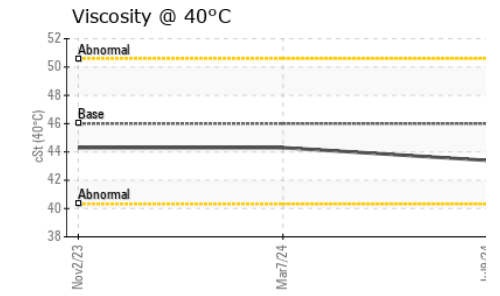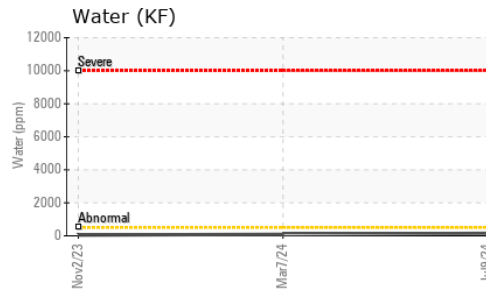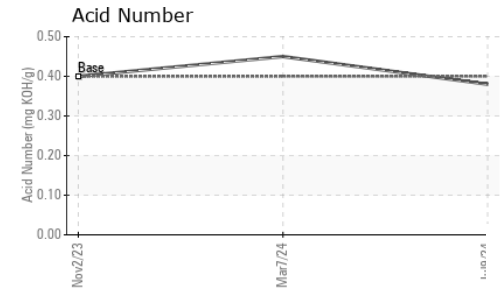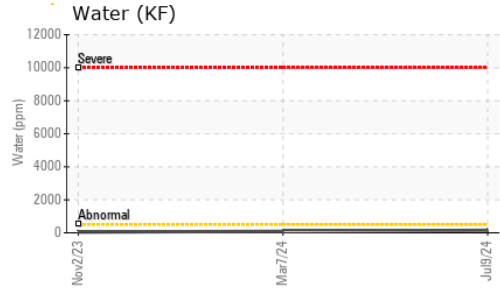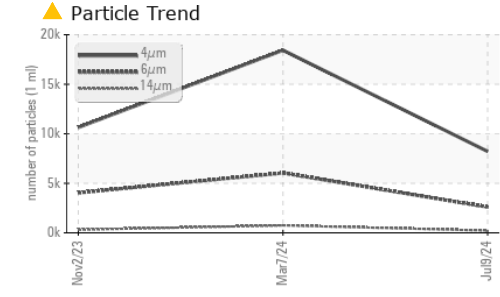





PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	43.4	44.3	44.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

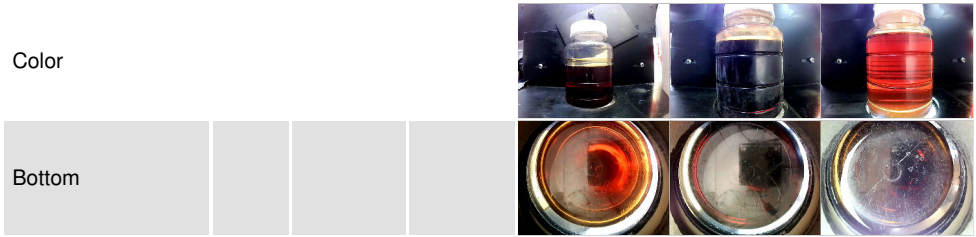

## GRAPHS

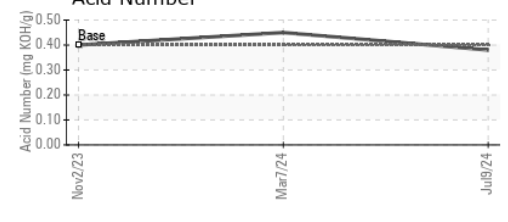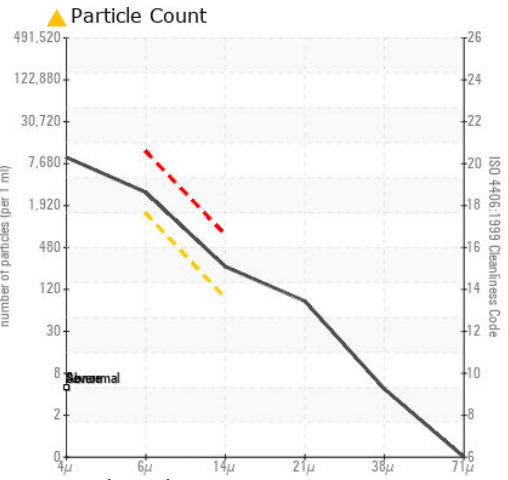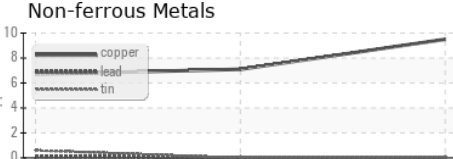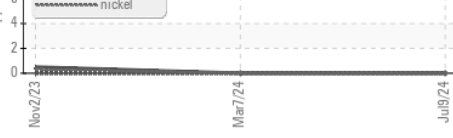

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC125150  
**Lab Number** : 06236818  
**Unique Number** : 11125652  
**Test Package** : IND 2  
**Received** : 15 Jul 2024  
**Tested** : 17 Jul 2024  
**Diagnosed** : 17 Jul 2024 - Don Baldrige

**QUANTUM METALS**  
 3675 TAFT DRIVE  
 LEBANON, OH  
 US 45036  
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)