


# **OIL ANALYSIS REPORT**

Sample Rating Trend

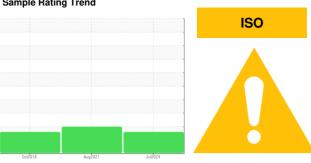

Machine Id

# KAESER SK 15 6073537 (S/N 1015)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

### **DIAGNOSIS**

#### Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

## Contamination

There is a high amount of particulates present in the oil.


#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Oct2016 Aug2021 Jul2024						
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA016026	KC98921	KC76137
Sample Date		Client Info		08 Jul 2024	27 Aug 2021	25 Oct 2018
Machine Age	hrs	Client Info		19321	15303	5958
Oil Age	hrs	Client Info		0	3000	4061
Oil Changed		Client Info		Changed	Changed	Changed
Sample Status				ABNORMAL	ABNORMAL	ATTENTION
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	0	<1
Lead	ppm	ASTM D5185m	>10	0	0	<1
Copper	ppm	ASTM D5185m	>50	18	10	6
Tin	ppm	ASTM D5185m	>10	0	0	<1
Antimony	ppm	ASTM D5185m			0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	586	0
Barium	ppm	ASTM D5185m	90	<1	0	4
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m	90	4	<u>^</u> 20	46
Calcium	ppm	ASTM D5185m	2	0	0	<1
Phosphorus	ppm	ASTM D5185m		0	0	5
Zinc	ppm	ASTM D5185m		4	2	14
Sulfur	ppm	ASTM D5185m		19091	15713	20334
CONTAMINANTS	1	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	<1
Sodium	ppm	ASTM D5185m		2	9	11
Potassium	ppm	ASTM D5185m	>20	0	0	<1
Water	%	ASTM D6304	>0.05	0.007	<u>^</u> 0.352	0.015
ppm Water	ppm	ASTM D6304	>500	74	▲ 3520	150
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		15107	4583	5730
Particles >6µm		ASTM D7647	>1300	<u>^</u> 5618	863	<b>1717</b>
Particles >14μm		ASTM D7647	>80	<b>471</b>	76	138
Particles >21µm		ASTM D7647	>20	<u> </u>	24	45
Particles >38μm		ASTM D7647	>4	4	3	<b>5</b>
Particles >71μm		ASTM D7647	>3	0	0	1
Oil Cleanliness		ISO 4406 (c)	>/17/13	<b>21/20/16</b>	17/13	<b>18/14</b>
		.0000 (0)	> /11/10	21/20/10	17/10	10/14



## **OIL ANALYSIS REPORT**

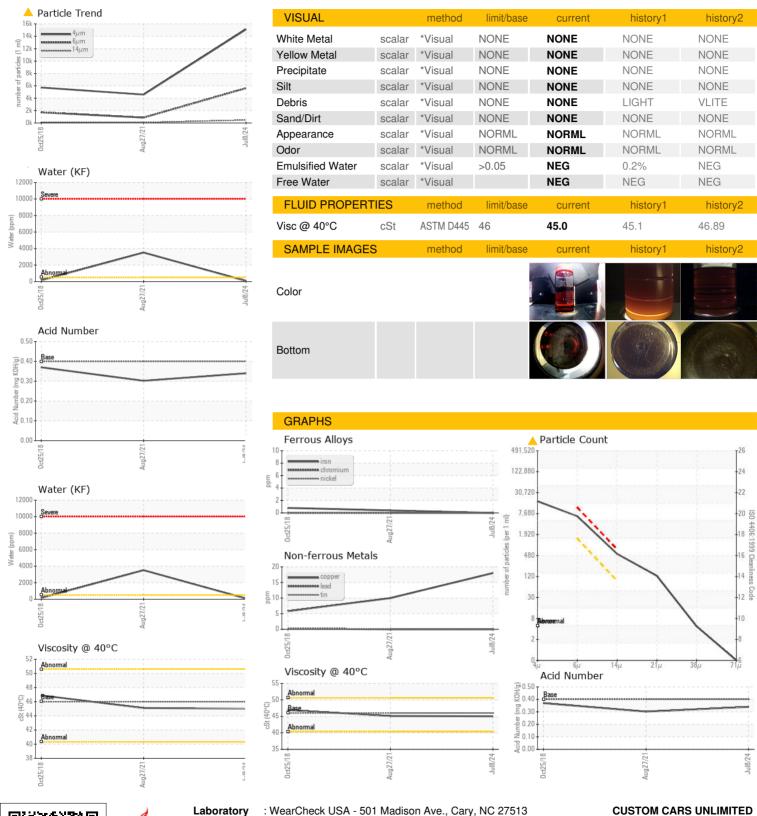





Laboratory Sample No.

Lab Number Unique Number: 11125659

: KCPA016026 : 06236825

Received : 15 Jul 2024 **Tested** Diagnosed

: 17 Jul 2024 : 17 Jul 2024 - Don Baldridge

US 60525 Contact: Service Manager

340 E BURLINGTON AVE

LA GRANGE, IL

Test Package : IND 2 ( Additional Tests: KF, PrtCount ) Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: Service Manager - CUSLAG

T:

F: