


OIL ANALYSIS REPORT

Machine Id

KAESER BSD 60T 6343691 (S/N 1221)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

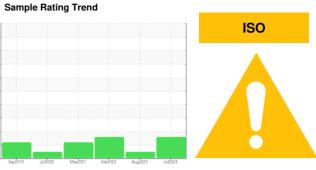

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA020675	KCPA006071	KCP55911
Sample Date		Client Info		08 Jul 2024	09 Aug 2023	15 Feb 2023
Machine Age	hrs	Client Info		37716	30457	26746
Oil Age	hrs	Client Info		2615	0	3700
Oil Changed		Client Info		Not Changd	N/A	Changed
Sample Status				ABNORMAL	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	<1	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	4	6	7
Tin	ppm	ASTM D5185m	>10	0	<1	0
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	90	93	70	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	100	88	79	<u> </u>
Calcium	ppm	ASTM D5185m	0	3	3	0
Phosphorus	ppm	ASTM D5185m	0	1	4	47
Zinc	ppm	ASTM D5185m	0	2	7	3
Sulfur	ppm	ASTM D5185m	23500	21583	22895	7031
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	<1
Sodium	ppm	ASTM D5185m		41	42	6
Potassium	ppm	ASTM D5185m	>20	9	14	<1
Water	%	ASTM D6304	>0.05	0.026	0.024	0.005
ppm Water	ppm	ASTM D6304	>500	262	247.5	57.8
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		15071	1893	
Particles >6µm		ASTM D7647	>1300	<u>▲</u> 5462	482	
Particles >14μm		ASTM D7647	>80	402	23	
Particles >21µm		ASTM D7647	>20	<u>^</u> 75	5	
Particles >38µm		ASTM D7647	>4	1	0	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 21/20/16	18/16/12	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2



OIL ANALYSIS REPORT

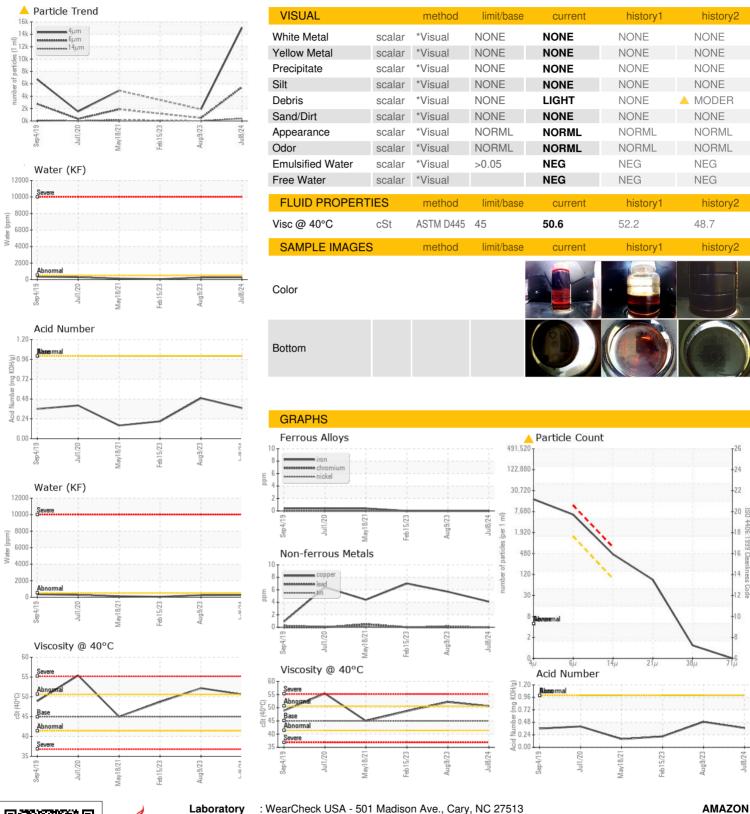





Certificate 12367

Laboratory Sample No.

Lab Number : 06236827

: KCPA020675 Unique Number: 11125661

Received **Tested**

: 17 Jul 2024 Diagnosed

: 17 Jul 2024 - Don Baldridge

: 15 Jul 2024

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F:

1700 SPARROWS POINT BLVD

SPARROWS POINT, MD

ECESAR@AMAZON.COM

Contact: E CESAR

US 21219