




OIL ANALYSIS REPORT

Sample Rating Trend

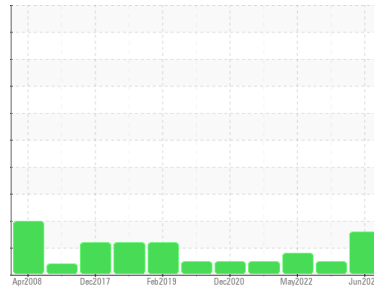

ISO



Machine Id
KAESER SK-19 2168804 (S/N 1681)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA011853	KCPA002184	KC104272
Sample Date	Client Info		28 Jun 2024	16 Jun 2023	23 May 2022
Machine Age	hrs	Client Info	77857	75508	72943
Oil Age	hrs	Client Info	0	0	1677
Oil Changed	Client Info		N/A	N/A	Not Changd
Sample Status			ATTENTION	NORMAL	ATTENTION

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	<1	<1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	0	0	<1
Lead	ppm	ASTM D5185m >10	0	0	<1
Copper	ppm	ASTM D5185m >50	9	8	6
Tin	ppm	ASTM D5185m >10	0	<1	0
Antimony	ppm	ASTM D5185m	---	---	---
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 90	0	<1	13
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	<1	<1
Magnesium	ppm	ASTM D5185m 90	18	24	50
Calcium	ppm	ASTM D5185m 2	0	0	2
Phosphorus	ppm	ASTM D5185m	3	2	2
Zinc	ppm	ASTM D5185m	65	55	35
Sulfur	ppm	ASTM D5185m	18393	18361	19156

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	2	3	2
Sodium	ppm	ASTM D5185m	14	11	22
Potassium	ppm	ASTM D5185m >20	1	2	4
Water	%	ASTM D6304 >0.05	0.015	0.014	0.034
ppm Water	ppm	ASTM D6304 >500	156	146.1	343.8






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		4856	2071	22550
Particles >6µm	ASTM D7647 >1300		1380	357	1428
Particles >14µm	ASTM D7647 >80		113	13	64
Particles >21µm	ASTM D7647 >20		27	3	16
Particles >38µm	ASTM D7647 >4		1	0	1
Particles >71µm	ASTM D7647 >3		0	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	19/18/14	18/16/11	22/18/13

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.32	0.328	0.35

OIL ANALYSIS REPORT

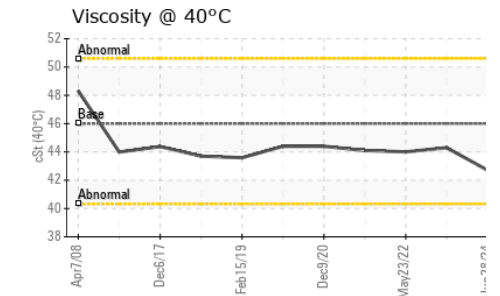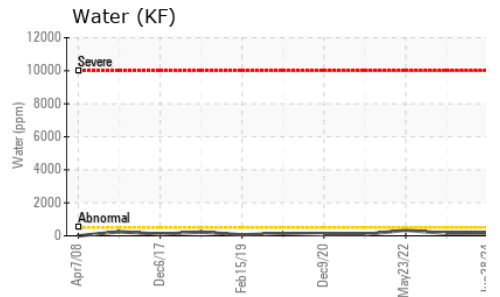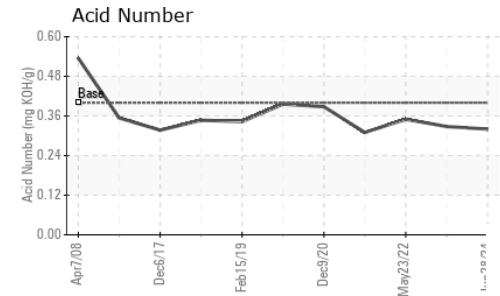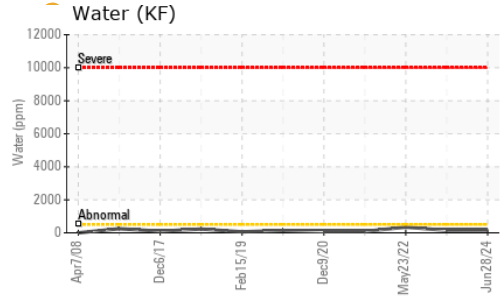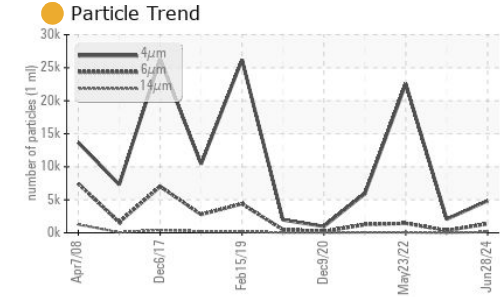

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	42.7	44.3	44.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

Ferrous Alloys

Date	Iron (ppm)	Chromium (ppm)	Nickel (ppm)
Apr7/08	0.5	0.5	0.5
Dec6/17	0.5	0.5	0.5
Feb15/19	0.5	0.5	0.5
Dec9/20	0.5	0.5	0.5
May23/22	0.5	0.5	0.5
Jun28/24	0.5	0.5	0.5

Particle Count

Date	Number of particles (per 1 ml)	ISO 4406:1999 Cleanliness Code
Apr7/08	7680	18
Dec6/17	1920	14
Feb15/19	1200	12
Dec9/20	300	10
May23/22	100	8
Jun28/24	50	6

Non-ferrous Metals

Date	Copper (ppm)	Lead (ppm)	Tin (ppm)
Apr7/08	5	5	5
Dec6/17	10	10	10
Feb15/19	15	15	15
Dec9/20	18	18	18
May23/22	10	10	10
Jun28/24	10	10	10

Viscosity @ 40°C

Date	cSt (40°C)
Apr7/08	48
Dec6/17	44
Feb15/19	44
Dec9/20	45
May23/22	44
Jun28/24	43



Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA011853
Lab Number : 06236829
Unique Number : 11125663
Test Package : IND 2 (Additional Tests: KF, PrtCount)
Received : 15 Jul 2024
Tested : 17 Jul 2024
Diagnosed : 17 Jul 2024 - Don Baldrige

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

CABLE TECHNOLOGIES INC
 73 RIVER RD
 WILLINGTON, CT
 US 06279
 Contact: BRIAN
 BRIAN@CABLETECHNOLOGYINC.COM
 T:
 F: