


# **OIL ANALYSIS REPORT**

Sample Rating Trend



**NORMAL** 



Machine Id

# KAESER HOUSE COMPRESSOR (S/N 1197)

Compressor

KAESER SIGMA (OEM) FG-460 (--- GAL)

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Nov202	3 Jan 2024	Apr2024 Ju	12024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA010741	KCPA008967	KCPA010743
Sample Date		Client Info		05 Jul 2024	11 Apr 2024	03 Jan 2024
Machine Age	hrs	Client Info		8585	7493	6181
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	Changed
Sample Status				NORMAL	ABNORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	2	7	6
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	9	<b>▲</b> 42	8
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	<1	2	<1
Tin	ppm	ASTM D5185m	>10	0	<1	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m		2	1	0
Calcium	ppm	ASTM D5185m		0	4	0
Phosphorus	ppm	ASTM D5185m	500	93	417	98
Zinc	ppm	ASTM D5185m		21	128	58
Sulfur	ppm	ASTM D5185m		2012	2496	2280
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	0
Sodium	ppm	ASTM D5185m		2	4	<1
Potassium	ppm	ASTM D5185m	>20	0	4	0
Water	%	ASTM D6304	>0.05	0.002	0.007	0.007
ppm Water	ppm	ASTM D6304	>500	18	77	80
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1405	1191	223
Particles >6µm		ASTM D7647	>1300	437	475	58
Particles >14µm		ASTM D7647	>80	29	62	8
Particles >21µm		ASTM D7647	>20	7	16	1
Particles >38µm		ASTM D7647	>4	1	0	0
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/12	17/16/13	15/13/10
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.5	0.49	1.49	0.52



## OIL ANALYSIS REPORT

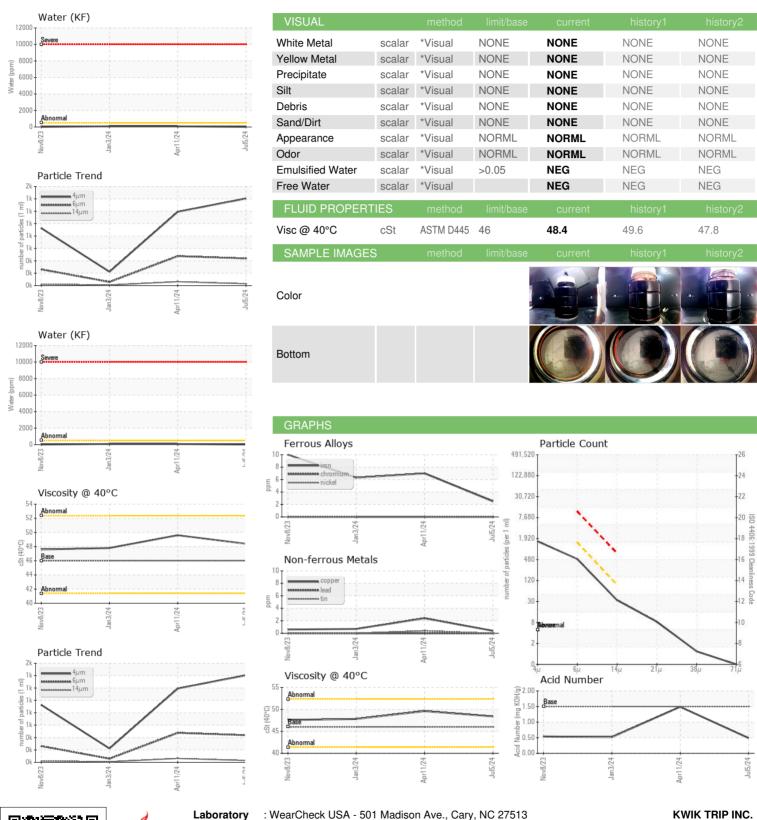





Certificate 12367

Sample No. Lab Number

: KCPA010741 : 06236830 Unique Number : 11125664

Received **Tested** Diagnosed

: 15 Jul 2024 : 17 Jul 2024 Test Package : IND 2 ( Additional Tests: KF, PrtCount )

: 17 Jul 2024 - Jonathan Hester

US 54601 Contact: D PROBUS DPROBUS@KWIKTRIP.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: KWILACKC [WUSCAR] 06236830 (Generated: 07/17/2024 14:42:48) Rev: 1

Contact/Location: D PROBUS - KWILACKC

T:

F:

1626 OAK ST.

LA CROSSE, WI