


# **OIL ANALYSIS REPORT**

Sample Rating Trend



Machine Id

# 4878998 (S/N 1125)

Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

### Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

## Contamination

There is a moderate amount of particulates present in the oil.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Jun2024	JunŽ024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA020566	KCPA020632	
Sample Date		Client Info		24 Jun 2024	24 Jun 2024	
Machine Age	hrs	Client Info		18487	18487	
Oil Age	hrs	Client Info		0	0	
Oil Changed		Client Info		Changed	Changed	
Sample Status				ATTENTION	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm		>10	0	<1	
Nickel	ppm	ASTM D5185m	>3	0	<1	
Titanium	ppm	ASTM D5185m	>3	0	<1	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	2	
Lead	ppm	ASTM D5185m	>10	0	<1	
Copper	ppm	ASTM D5185m		27	32	
Tin	ppm	ASTM D5185m	>10	0	<1	
Vanadium	ppm	ASTM D5185m		0	<1	
Cadmium	ppm	ASTM D5185m		0	<1	
ADDITIVES	ρρ	method	limit/base	current	history1	history2
Boron		ASTM D5185m	0		0	
	ppm			0		
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m	0	0	<1	
Manganese	ppm	ASTM D5185m	100	0	<1	
Magnesium	ppm	ASTM D5185m	100	2	9	
Calcium	ppm	ASTM D5185m	0	0	0	
Phosphorus	ppm	ASTM D5185m	0	35	0	
Zinc	ppm	ASTM D5185m	0	5	20	
Sulfur	ppm	ASTM D5185m	23500	17716	17822	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	1	
Sodium	ppm	ASTM D5185m		1	5	
Potassium	ppm	ASTM D5185m	>20	0	<1	
Water	%	ASTM D6304	>0.05	0.003	0.010	
ppm Water	ppm	ASTM D6304	>500	32	109	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		5321	62496	
Particles >6μm		ASTM D7647	>1300	<u> </u>	<u>^</u> 22076	
Particles >14μm		ASTM D7647	>80	<u>120</u>	<u></u> 856	
Particles >21μm		ASTM D7647	>20	<u>22</u>	<u>130</u>	
Particles >38μm		ASTM D7647	>4	1	4	
Particles >71μm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>17/13	<b>18/14</b>	<u>22/17</u>	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.29	0.24	



# **OIL ANALYSIS REPORT**

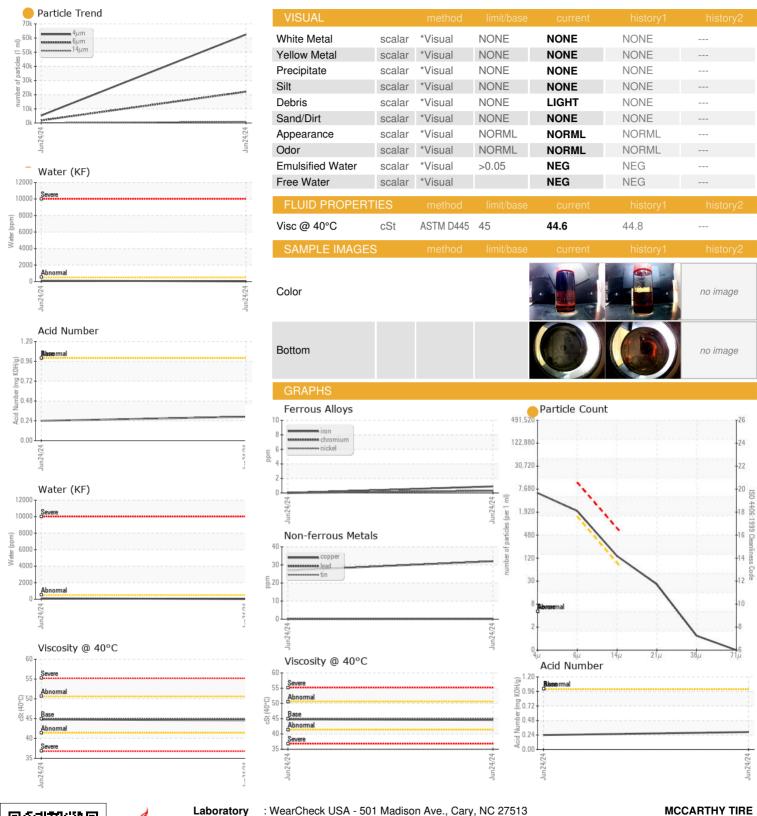





Laboratory Sample No.

: KCPA020566 Lab Number : 06236836 Unique Number : 11125670

Received **Tested** Diagnosed

: 17 Jul 2024 : 17 Jul 2024 - Jonathan Hester

: 15 Jul 2024 1901 HARTEL AVE LEVITTOWN, PA US 19057 Contact: Service Manager

Test Package : IND 2 ( Additional Tests: KF, PrtCount ) Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: