




OIL ANALYSIS REPORT

Sample Rating Trend

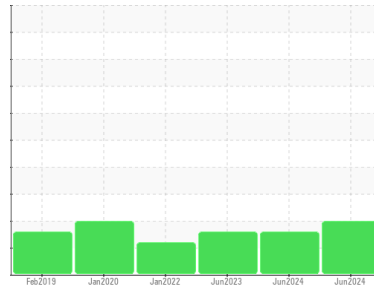

ISO



Machine Id
KAESER SK 15 6032074 (S/N 2220)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCPA020572	KCPA014375	KCPA001924
Sample Date	Client Info	26 Jun 2024	26 Jun 2024	05 Jun 2023
Machine Age	hrs	18103	18103	15367
Oil Age	hrs	0	0	0
Oil Changed	Client Info	Not Chngd	Not Chngd	Changed
Sample Status		ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	0	<1	0
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	0	0	2
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	16	6	3
Tin	ppm	ASTM D5185m >10	0	0	0
Antimony	ppm	ASTM D5185m	---	---	---
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 0	0	0	0
Barium	ppm	ASTM D5185m 90	0	0	5
Molybdenum	ppm	ASTM D5185m 0	0	0	0
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m 100	2	30	32
Calcium	ppm	ASTM D5185m 0	0	0	0
Phosphorus	ppm	ASTM D5185m 0	26	<1	0
Zinc	ppm	ASTM D5185m 0	0	2	11
Sulfur	ppm	ASTM D5185m 23500	16151	20693	18768

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<1	0	0
Sodium	ppm	ASTM D5185m	2	7	8
Potassium	ppm	ASTM D5185m >20	0	<1	<1
Water	%	ASTM D6304 >0.05	0.004	0.030	0.017
ppm Water	ppm	ASTM D6304 >500	46	307	175.8






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	24235	58261	7077
Particles >6µm	ASTM D7647 >1300	▲ 9166	▲ 23537	● 2200
Particles >14µm	ASTM D7647 >80	▲ 746	▲ 1056	▲ 165
Particles >21µm	ASTM D7647 >20	▲ 172	▲ 122	▲ 43
Particles >38µm	ASTM D7647 >4	▲ 5	4	1
Particles >71µm	ASTM D7647 >3	0	0	1
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 22/20/17	▲ 23/22/17	▲ 20/18/15

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.30	0.398	0.36


OIL ANALYSIS REPORT

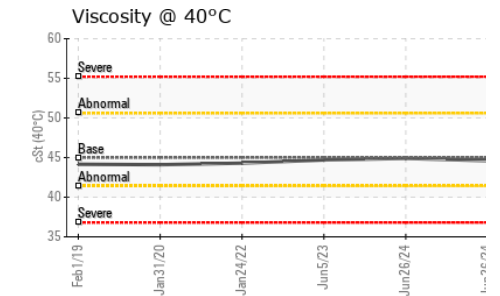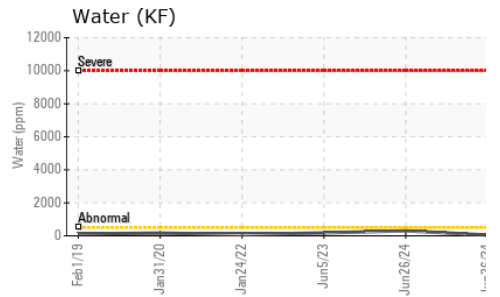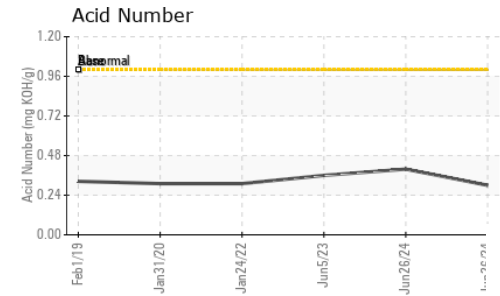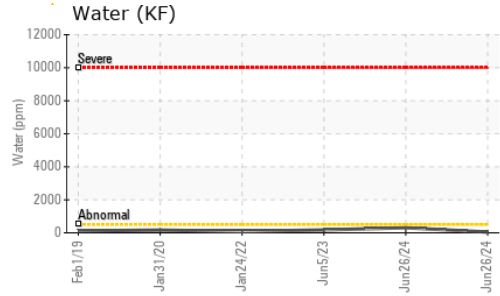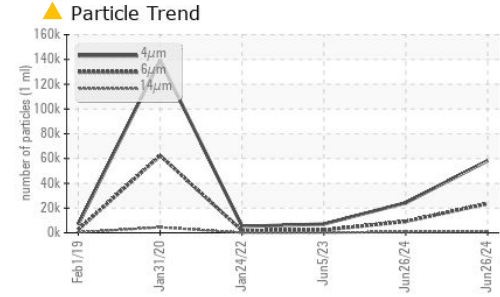






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	44.6	44.9	44.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

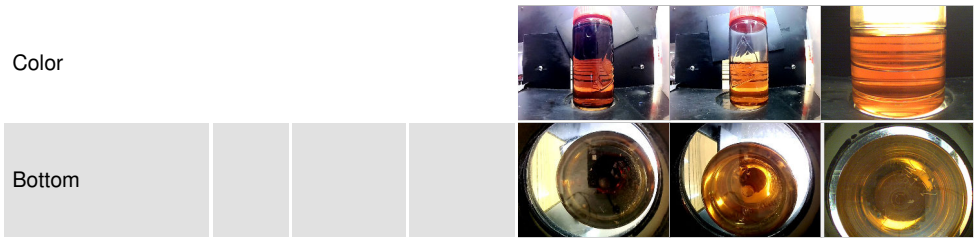

GRAPHS

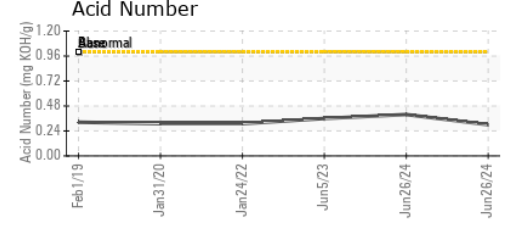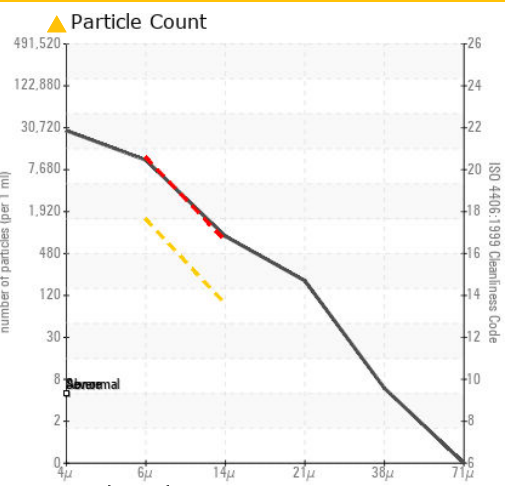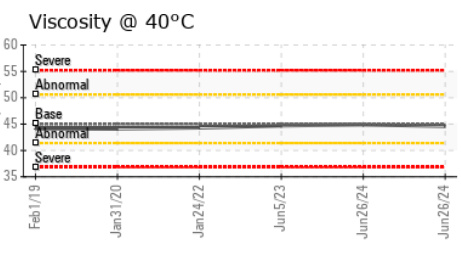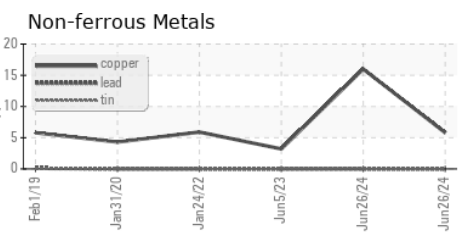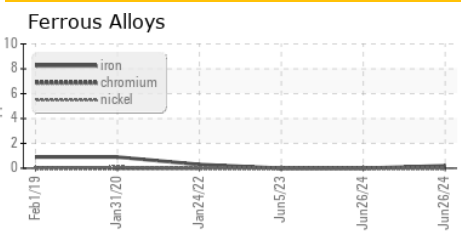

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA020572 **Received** : 15 Jul 2024
Lab Number : 06236844 **Tested** : 17 Jul 2024
Unique Number : 11125678 **Diagnosed** : 17 Jul 2024 - Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PrtCount)

BILL MCELROY AUTO BODY
 419 STATION AVE
 BENSLEM, PA
 US 19020
 Contact: BILL
 BILL@MCELROYAUTOBODY.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)