

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

KAESER 9429165

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jun 2024		
SAMPLE INFORM	ΛΔΤΙΩΝ	method	limit/base	current	history1	history2
	ATION		IIIIIII Dase			
Sample Number		Client Info		KCPA018748		
Sample Date		Client Info		24 Jun 2024		
Machine Age	hrs	Client Info		4105		
Oil Age	hrs	Client Info		4105		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	9		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	90	0		
Calcium	ppm	ASTM D5185m	2	0		
Phosphorus	ppm	ASTM D5185m		7		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m		16846		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		<1		
Potassium	ppm	ASTM D5185m	>20	<1		
Water	%	ASTM D6304	>0.05	0.004		
ppm Water	ppm	ASTM D6304	>500	44		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		3159		
Particles >6µm		ASTM D7647	>1300	1133		
Particles >14µm		ASTM D7647	>80	68		
Particles >21µm		ASTM D7647	>20	17		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/13		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Asid Number (AN)	1/011/-	ACTM DODAE	0.4	0.00		


Acid Number (AN)

mg KOH/g ASTM D8045 0.4

0.29



OIL ANALYSIS REPORT

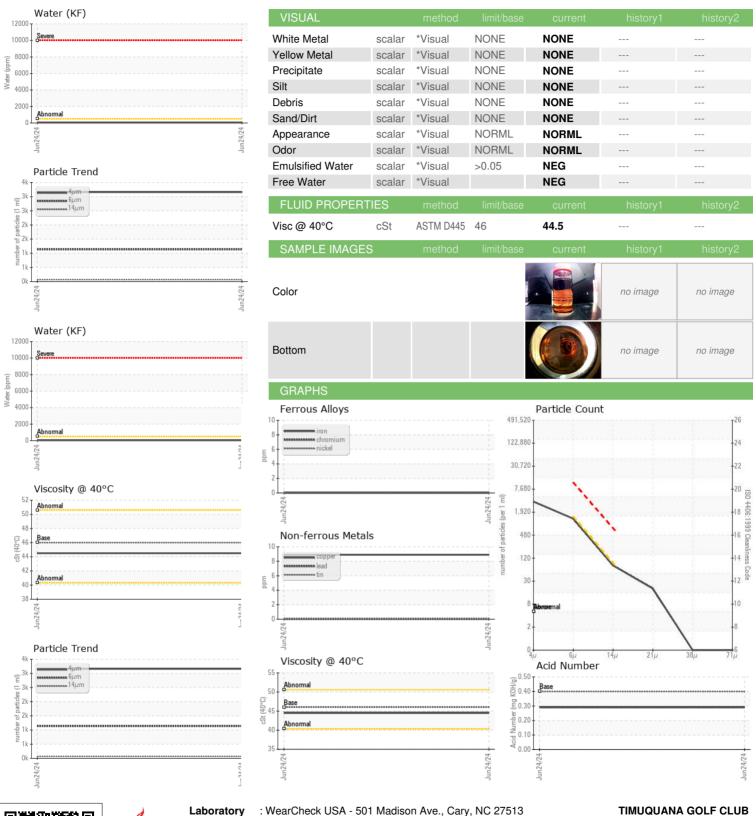



Certificate 12367

Laboratory Sample No.

Lab Number : 06236847 Unique Number : 11125681

: KCPA018748

Received **Tested** Diagnosed Test Package : IND 2 (Additional Tests: KF, PrtCount)

: 17 Jul 2024

: 17 Jul 2024 - Jonathan Hester

: 15 Jul 2024

US 32210 Contact: RON ron@nanooxygensystems.com

4028 TIMUQUANA RD

JACKSONVILLE, FL

To discuss this sample report, contact Customer Service at 1-800-237-1369. st - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: