


OIL ANALYSIS REPORT

Sample Rating Trend

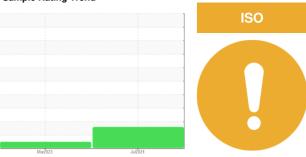

Machine Id

KAESER 8241068

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Mar2023	Jul2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA020667	KCPA000454	
Sample Date		Client Info		08 Jul 2024	07 Mar 2023	
Machine Age	hrs	Client Info		10445	4434	
Oil Age	hrs	Client Info		6011	0	
Oil Changed	1110	Client Info		Not Changd	N/A	
Sample Status		Oliotic IIIIo		ATTENTION	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
	n.n.m	ASTM D5185m	>50		0	
Iron Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
	ppm				0	
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	0	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	28	18	
Tin	ppm	ASTM D5185m	>10	0	<1	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m	90	0	20	
Calcium	ppm	ASTM D5185m	2	0	0	
Phosphorus	ppm	ASTM D5185m		6	3	
Zinc	ppm	ASTM D5185m		47	72	
Sulfur	ppm	ASTM D5185m		17328	21614	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	
Sodium	ppm	ASTM D5185m		1	6	
Potassium	ppm	ASTM D5185m	>20	<1	4	
Water	%	ASTM D6304	>0.05	0.005	0.009	
ppm Water	ppm	ASTM D6304	>500	59	94.5	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2991	1804	
Particles >6µm		ASTM D7647	>1300	<u> </u>	720	
Particles >14µm		ASTM D7647	>80	<u> </u>	80	
Particles >21µm		ASTM D7647	>20	22	23	
Particles >38µm		ASTM D7647	>4	0	2	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/18/14	18/17/13	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.36	0.31	



OIL ANALYSIS REPORT





Certificate 12367

Laboratory Sample No.

Lab Number

: KCPA020667 : 06236849 Unique Number : 11125683

To discuss this sample report, contact Customer Service at 1-800-237-1369.

Received : 15 Jul 2024 **Tested** Diagnosed Test Package : IND 2 (Additional Tests: KF, PrtCount)

: 17 Jul 2024

: 17 Jul 2024 - Jonathan Hester

QUITMAN, GA US 31643 Contact: MICAH BEODDY MICAH.BEODDY@GMAIL.COM

3600 THOMPSON RD

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: SOUQUI [WUSCAR] 06236849 (Generated: 07/17/2024 14:55:57) Rev: 1

Contact/Location: MICAH BEODDY - SOUQUI

T:

F: