



OIL ANALYSIS REPORT

Sample Rating Trend



DEGRADATION



Machine Id
AIR 7
 Component
Air Compressor
 Fluid
 {not provided} (--- GAL)

DIAGNOSIS

▲ Recommendation

The oil is near the end of its useful service life and we recommend schedule an oil change. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

▲ Fluid Condition

The AN level is at the top-end of the recommended limit.

| SAMPLE INFORMATION | | method | limit/base | current | history1 | history2 |
|--------------------|-------------|-------------|------------|--------------------|----------|----------|
| Sample Number | Client Info | | | USP0012342 | --- | --- |
| Sample Date | Client Info | | | 09 Jul 2024 | --- | --- |
| Machine Age | hrs | Client Info | | 0 | --- | --- |
| Oil Age | hrs | Client Info | | 0 | --- | --- |
| Oil Changed | Client Info | | | N/A | --- | --- |
| Sample Status | | | | ABNORMAL | --- | --- |

| WEAR METALS | | method | limit/base | current | history1 | history2 |
|-------------|-----|-------------|------------|--------------|----------|----------|
| Iron | ppm | ASTM D5185m | >50 | <1 | --- | --- |
| Chromium | ppm | ASTM D5185m | >4 | 0 | --- | --- |
| Nickel | ppm | ASTM D5185m | >4 | 0 | --- | --- |
| Titanium | ppm | ASTM D5185m | | 0 | --- | --- |
| Silver | ppm | ASTM D5185m | | 0 | --- | --- |
| Aluminum | ppm | ASTM D5185m | >10 | 0 | --- | --- |
| Lead | ppm | ASTM D5185m | >20 | 0 | --- | --- |
| Copper | ppm | ASTM D5185m | >40 | 6 | --- | --- |
| Tin | ppm | ASTM D5185m | >5 | 0 | --- | --- |
| Vanadium | ppm | ASTM D5185m | | 0 | --- | --- |
| Cadmium | ppm | ASTM D5185m | | 0 | --- | --- |

| ADDITIVES | | method | limit/base | current | history1 | history2 |
|------------|-----|-------------|------------|--------------|----------|----------|
| Boron | ppm | ASTM D5185m | | 0 | --- | --- |
| Barium | ppm | ASTM D5185m | | 0 | --- | --- |
| Molybdenum | ppm | ASTM D5185m | | 0 | --- | --- |
| Manganese | ppm | ASTM D5185m | | <1 | --- | --- |
| Magnesium | ppm | ASTM D5185m | | 0 | --- | --- |
| Calcium | ppm | ASTM D5185m | | 1 | --- | --- |
| Phosphorus | ppm | ASTM D5185m | | <1 | --- | --- |
| Zinc | ppm | ASTM D5185m | | 6 | --- | --- |
| Sulfur | ppm | ASTM D5185m | | 0 | --- | --- |






| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
|--------------|-----|-------------|------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185m | >25 | <1 | --- | --- |
| Sodium | ppm | ASTM D5185m | | <1 | --- | --- |
| Potassium | ppm | ASTM D5185m | >20 | <1 | --- | --- |
| Water | % | ASTM D6304 | >0.6 | 0.058 | --- | --- |
| ppm Water | ppm | ASTM D6304 | >6000 | 588 | --- | --- |

| FLUID CLEANLINESS | | method | limit/base | current | history1 | history2 |
|-------------------|--|--------------|------------|-----------------|----------|----------|
| Particles >4µm | | ASTM D7647 | >10000 | 217 | --- | --- |
| Particles >6µm | | ASTM D7647 | >2500 | 65 | --- | --- |
| Particles >14µm | | ASTM D7647 | >320 | 7 | --- | --- |
| Particles >21µm | | ASTM D7647 | >80 | 2 | --- | --- |
| Particles >38µm | | ASTM D7647 | >20 | 0 | --- | --- |
| Particles >71µm | | ASTM D7647 | >4 | 0 | --- | --- |
| Oil Cleanliness | | ISO 4406 (c) | >20/18/15 | 15/13/10 | --- | --- |

| FLUID DEGRADATION | | method | limit/base | current | history1 | history2 |
|-------------------|----------|------------|------------|---------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 | | ▲ 1.69 | --- | --- |



OIL ANALYSIS REPORT

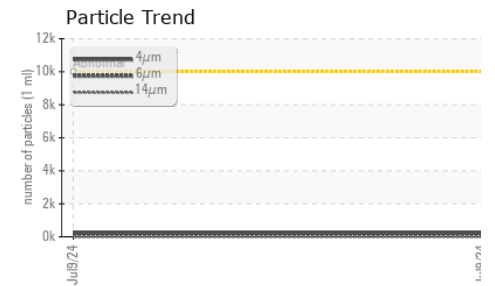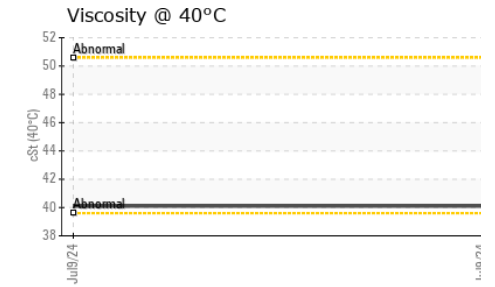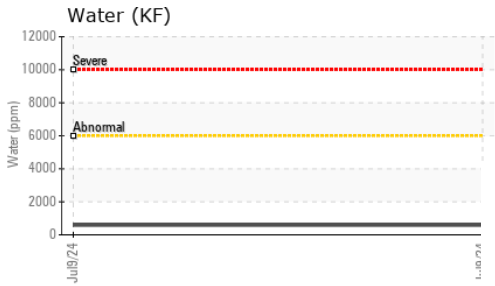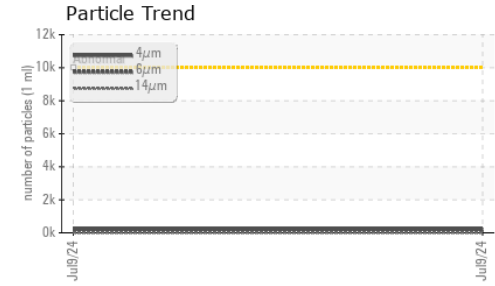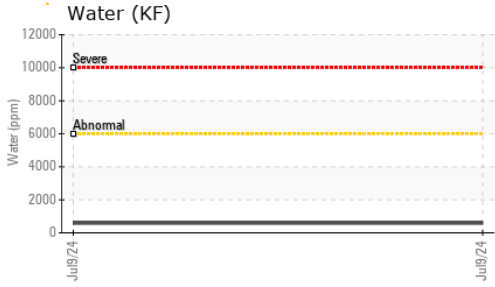





| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | --- |
| Yellow Metal | scalar | *Visual | NONE | NONE | --- |
| Precipitate | scalar | *Visual | NONE | NONE | --- |
| Silt | scalar | *Visual | NONE | NONE | --- |
| Debris | scalar | *Visual | NONE | NONE | --- |
| Sand/Dirt | scalar | *Visual | NONE | NONE | --- |
| Appearance | scalar | *Visual | NORML | NORML | --- |
| Odor | scalar | *Visual | NORML | NORML | --- |
| Emulsified Water | scalar | *Visual | >0.6 | NEG | --- |
| Free Water | scalar | *Visual | | NEG | --- |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 | 40.1 | --- | --- |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

| | | | |
|--------|--|----------|----------|
| Color | | no image | no image |
| Bottom | | no image | no image |

GRAPHS

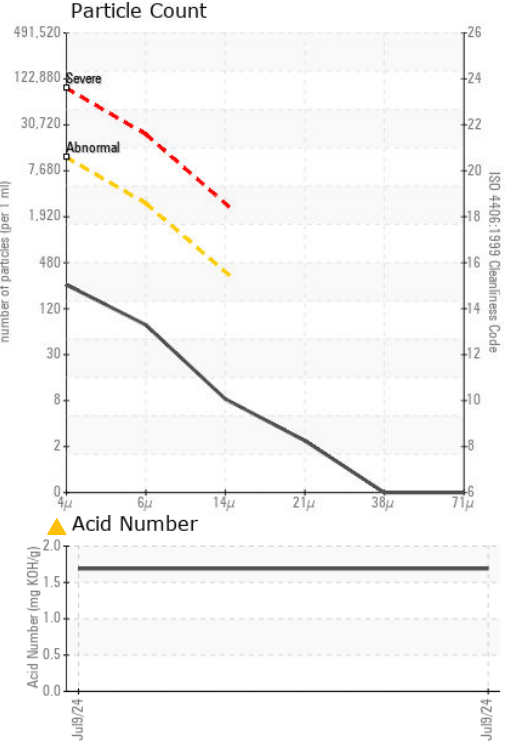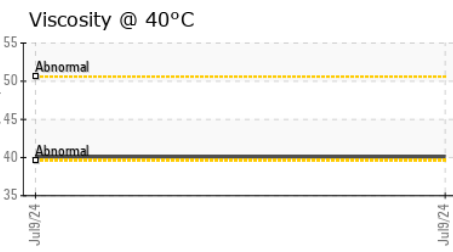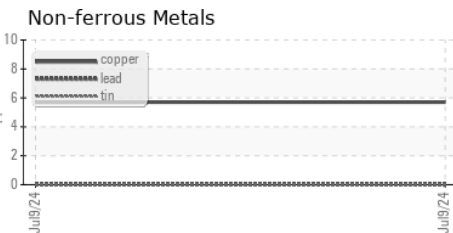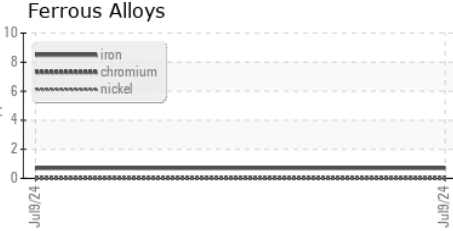

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : USP0012342 **Received** : 15 Jul 2024
Lab Number : 06236873 **Tested** : 17 Jul 2024
Unique Number : 11125707 **Diagnosed** : 17 Jul 2024 - Doug Bogart
Test Package : IND 2

CARGILL
 FORT MORGAN, CO
 US
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)