




OIL ANALYSIS REPORT

Sample Rating Trend

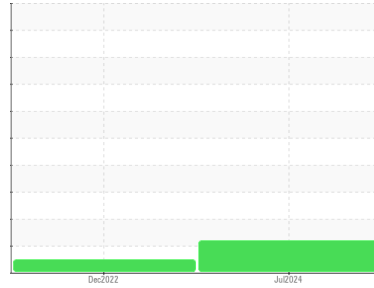

DEGRADATION



Machine Id
AIR 5
 Component
Air Compressor
 Fluid
 {not provided} (--- GAL)

DIAGNOSIS

▲ Recommendation

We recommend that you drain the oil from the component if this has not already been done. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

▲ Fluid Condition

The AN level is above the recommended limit. Confirmed.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			USP0012343	USPR000105	---
Sample Date	Client Info			09 Jul 2024	19 Dec 2022	---
Machine Age	hrs	Client Info		0	0	---
Oil Age	hrs	Client Info		0	0	---
Oil Changed	Client Info			N/A	N/A	---
Sample Status				ABNORMAL	NORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	---
Chromium	ppm	ASTM D5185m	>4	0	0	---
Nickel	ppm	ASTM D5185m	>4	0	0	---
Titanium	ppm	ASTM D5185m		0	0	---
Silver	ppm	ASTM D5185m		0	0	---
Aluminum	ppm	ASTM D5185m	>10	1	0	---
Lead	ppm	ASTM D5185m	>20	0	0	---
Copper	ppm	ASTM D5185m	>40	6	<1	---
Tin	ppm	ASTM D5185m	>5	0	0	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	---
Barium	ppm	ASTM D5185m		5	0	---
Molybdenum	ppm	ASTM D5185m		0	0	---
Manganese	ppm	ASTM D5185m		0	0	---
Magnesium	ppm	ASTM D5185m		0	0	---
Calcium	ppm	ASTM D5185m		2	2	---
Phosphorus	ppm	ASTM D5185m		39	0	---
Zinc	ppm	ASTM D5185m		0	0	---
Sulfur	ppm	ASTM D5185m		77	0	---






CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	3	---
Sodium	ppm	ASTM D5185m		2	0	---
Potassium	ppm	ASTM D5185m	>20	1	<1	---
Water	%	ASTM D6304	>0.6	0.043	0.014	---
ppm Water	ppm	ASTM D6304	>6000	430	141.6	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	233	235	---
Particles >6µm		ASTM D7647	>2500	82	68	---
Particles >14µm		ASTM D7647	>320	12	6	---
Particles >21µm		ASTM D7647	>80	3	3	---
Particles >38µm		ASTM D7647	>20	0	0	---
Particles >71µm		ASTM D7647	>4	0	0	---
Oil Cleanliness		ISO 4406 (c)	>20/18/15	15/14/11	15/13/10	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		▲ 2.85	0.44	---




OIL ANALYSIS REPORT

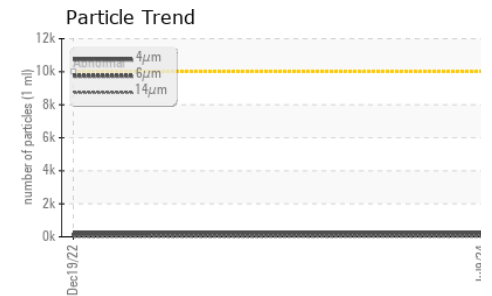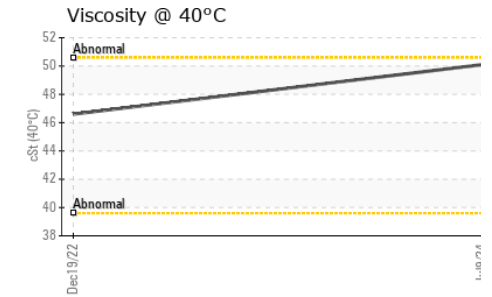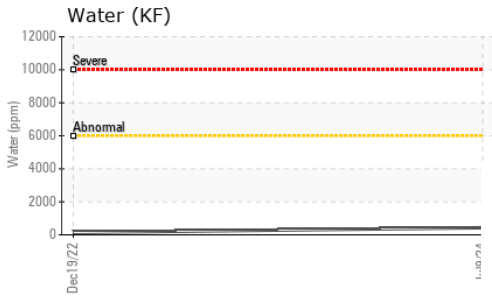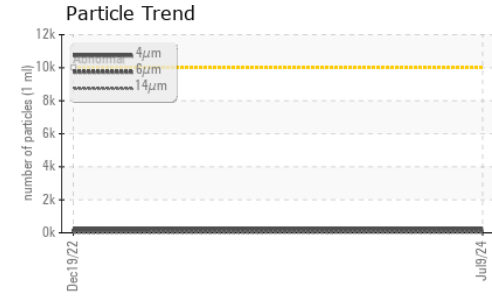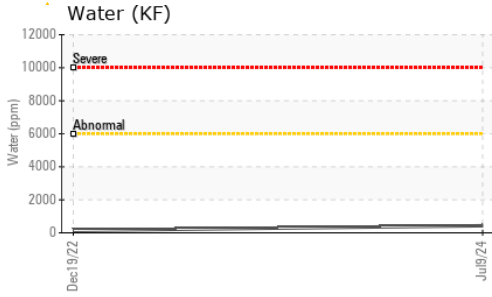






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.6	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	50.1	46.6	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

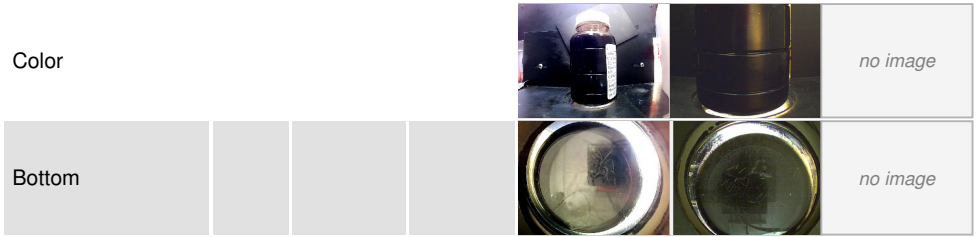

GRAPHS

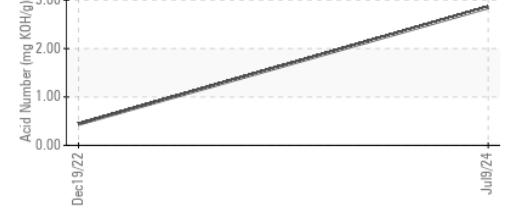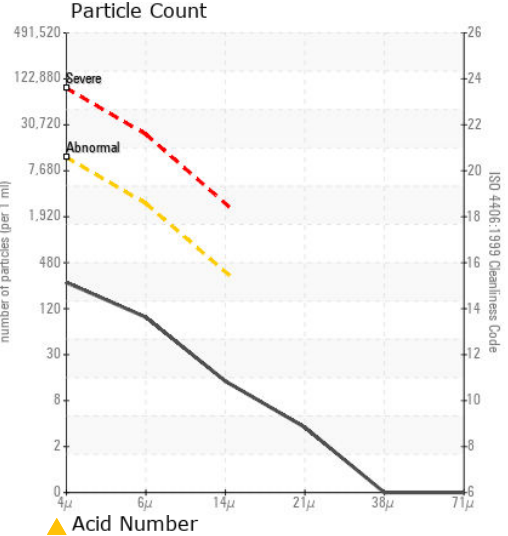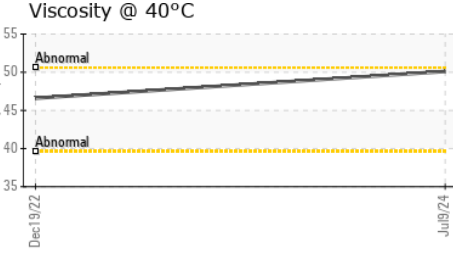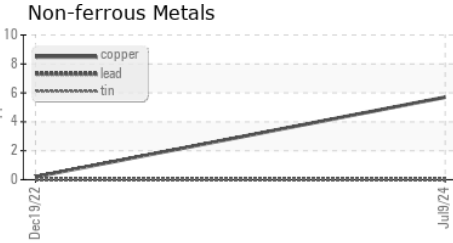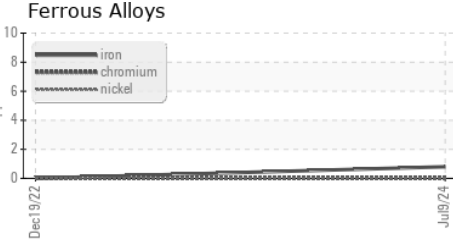

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : USP0012343
Lab Number : 06236874
Unique Number : 11125708
Test Package : IND 2

Received : 15 Jul 2024
Tested : 17 Jul 2024
Diagnosed : 17 Jul 2024 - Doug Bogart

CARGILL

FORT MORGAN, CO
 US
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
 F: