


OIL ANALYSIS REPORT

Sample Rating Trend







Machine Id

MYCOM TYSWAT 14 MY (S/N 3251589)

Refrigeration Compressor

USPI 1009-68 SC (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| n2011 Jan2013 Jun2014 Jan2016 Oct2017 Aug2019 Mar2021 Mar2023 | | | | | | | | | |
|---|---------|--------------|------------|-------------|-------------|-------------|--|--|--|
| SAMPLE INFORM | MATION | method | limit/base | current | history1 | history2 | | | |
| Sample Number | | Client Info | | USP0012336 | USP0007603 | USP0001252 | | | |
| Sample Date | | Client Info | | 14 Jul 2024 | 26 Feb 2024 | 12 Oct 2023 | | | |
| Machine Age | hrs | Client Info | | 0 | 0 | 0 | | | |
| Oil Age | hrs | Client Info | | 0 | 0 | 0 | | | |
| Oil Changed | | Client Info | | N/A | N/A | N/A | | | |
| Sample Status | | | | NORMAL | NORMAL | NORMAL | | | |
| WEAR METALS | | method | limit/base | current | history1 | history2 | | | |
| Iron | ppm | ASTM D5185m | >8 | 0 | 0 | 0 | | | |
| Chromium | ppm | ASTM D5185m | >2 | 0 | <1 | 0 | | | |
| Nickel | ppm | ASTM D5185m | | 0 | 0 | 0 | | | |
| Titanium | ppm | ASTM D5185m | | 0 | 0 | 0 | | | |
| Silver | ppm | ASTM D5185m | >2 | 0 | 0 | 0 | | | |
| Aluminum | ppm | ASTM D5185m | >3 | 0 | 0 | 0 | | | |
| Lead | ppm | ASTM D5185m | >2 | 0 | 0 | 0 | | | |
| Copper | ppm | ASTM D5185m | >8 | 0 | 0 | 0 | | | |
| Tin | ppm | ASTM D5185m | >4 | 0 | 0 | 0 | | | |
| Vanadium | ppm | ASTM D5185m | | 0 | 0 | 0 | | | |
| Cadmium | ppm | ASTM D5185m | | 0 | 0 | 0 | | | |
| ADDITIVES | | method | limit/base | current | history1 | history2 | | | |
| Boron | ppm | ASTM D5185m | | 0 | 0 | 0 | | | |
| Barium | ppm | ASTM D5185m | | 0 | 0 | 0 | | | |
| Molybdenum | ppm | ASTM D5185m | | 0 | 0 | 0 | | | |
| Manganese | ppm | ASTM D5185m | | 0 | 0 | <1 | | | |
| Magnesium | ppm | ASTM D5185m | | 0 | <1 | 0 | | | |
| Calcium | ppm | ASTM D5185m | | 0 | 0 | 1 | | | |
| Phosphorus | ppm | ASTM D5185m | | 1 | 0 | <1 | | | |
| Zinc | ppm | ASTM D5185m | | 0 | 0 | 0 | | | |
| Sulfur | ppm | ASTM D5185m | 50 | 0 | 0 | 6 | | | |
| CONTAMINANTS | ; | method | limit/base | current | history1 | history2 | | | |
| Silicon | ppm | ASTM D5185m | >15 | <1 | 0 | <1 | | | |
| Sodium | ppm | ASTM D5185m | | 1 | 0 | <1 | | | |
| Potassium | ppm | ASTM D5185m | >20 | <1 | <1 | 0 | | | |
| Water | % | ASTM D6304 | >0.01 | 0.001 | 0.002 | 0.002 | | | |
| ppm Water | ppm | ASTM D6304 | >100 | 11 | 17 | 18.1 | | | |
| FLUID CLEANLIN | IESS | method | limit/base | current | history1 | history2 | | | |
| Particles >4µm | | ASTM D7647 | >10000 | 4609 | 3455 | 693 | | | |
| Particles >6µm | | ASTM D7647 | >2500 | 1238 | 659 | 206 | | | |
| Particles >14µm | | ASTM D7647 | >320 | 14 | 16 | 18 | | | |
| Particles >21µm | | ASTM D7647 | >80 | 1 | 1 | 5 | | | |
| Particles >38µm | | ASTM D7647 | >20 | 0 | 0 | 0 | | | |
| Particles >71µm | | ASTM D7647 | >4 | 0 | 0 | 0 | | | |
| Oil Cleanliness | | ISO 4406 (c) | >20/18/15 | 19/17/11 | 19/17/11 | 17/15/11 | | | |
| FLUID DEGRADA | TION | method | limit/base | current | history1 | history2 | | | |
| A aid Number (ANI) | I/OII/- | ACTM DOZA | 0.005 | 0.014 | 0.014 | 0.010 | | | |

Acid Number (AN)

0.014


0.014


mg KOH/g ASTM D974 0.005


0.013





OIL ANALYSIS REPORT













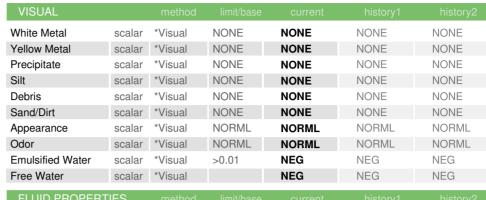

| I LOID I NOI LITTILO | | method | | | Thistory i | HISTOLYZ |
|----------------------|-----|-----------|----|------|------------|----------|
| Visc @ 40°C | cSt | ASTM D445 | 67 | 68.7 | 68.5 | 67.9 |

SAMPLE IMAGES Color



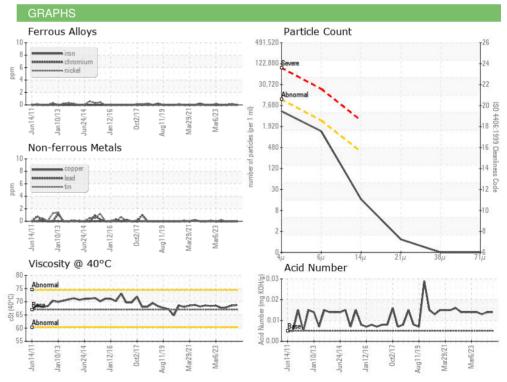





Laboratory Sample No. Lab Number

: USP0012336 : 06236879 Unique Number : 11125713

Bottom

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 15 Jul 2024

Tested : 17 Jul 2024 Diagnosed : 17 Jul 2024 - Jonathan Hester

TYSON - WATERLOO - USP CODE TYSWATPRO 501 N Elk Run Road

Waterloo, IA US 50703

Contact: ED ALBERT

Test Package : IND 2 Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (319)236-9328 F: (319)236-9393