




# OIL ANALYSIS REPORT

Sample Rating Trend

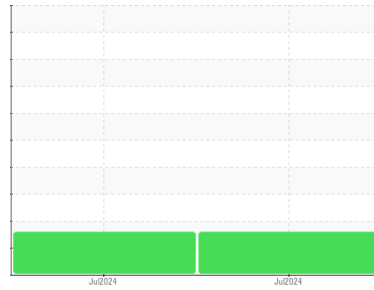

**WATER**



Machine Id

## AVIENT BUILDING 47 CH 7 CIRC A

Component

### Refrigeration Compressor

Fluid

### GEAR OIL LS 80W90 (--- GAL)

#### DIAGNOSIS

##### ▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

##### Wear

All component wear rates are normal.

##### ▲ Contamination

There is a trace of moisture present in the oil. Elemental level of silicon (Si) above normal.

##### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

#### SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>WC0899758</b>	WC0899754	---
Sample Date	Client Info	<b>12 Jul 2024</b>	11 Jul 2024	---
Machine Age	hrs	Client Info	<b>0</b>	0
Oil Age	hrs	Client Info	<b>0</b>	0
Oil Changed	Client Info	<b>N/A</b>	N/A	---
Sample Status		<b>MARGINAL</b>	MARGINAL	---

#### WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	<b>0</b>	0
Chromium	ppm	ASTM D5185m >2	<b>0</b>	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0
Aluminum	ppm	ASTM D5185m >3	<b>0</b>	0
Lead	ppm	ASTM D5185m >2	<b>0</b>	0
Copper	ppm	ASTM D5185m >8	<b>0</b>	0
Tin	ppm	ASTM D5185m >4	<b>0</b>	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0

#### ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 150	<b>0</b>	0
Barium	ppm	ASTM D5185m	<b>0</b>	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0
Magnesium	ppm	ASTM D5185m 10	<b>0</b>	0
Calcium	ppm	ASTM D5185m 70	<b>0</b>	0
Phosphorus	ppm	ASTM D5185m 2000	<b>930</b>	63
Zinc	ppm	ASTM D5185m 50	<b>0</b>	0
Sulfur	ppm	ASTM D5185m 20000	<b>0</b>	0

#### CONTAMINANTS




method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>5</b>	10
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	1
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	<1
Water	%	ASTM D6304 >0.01	<b>▲ 0.031</b>	▲ 0.023
ppm Water	ppm	ASTM D6304 >100	<b>▲ 312</b>	▲ 236

#### FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	<b>0.014</b>	0.014



# OIL ANALYSIS REPORT

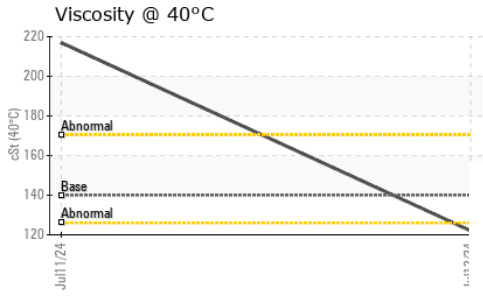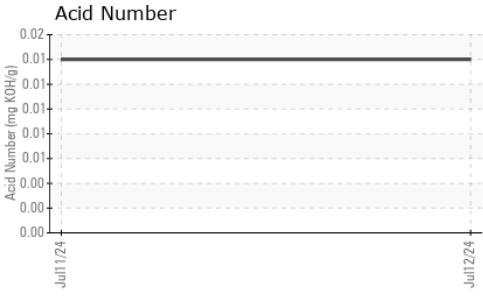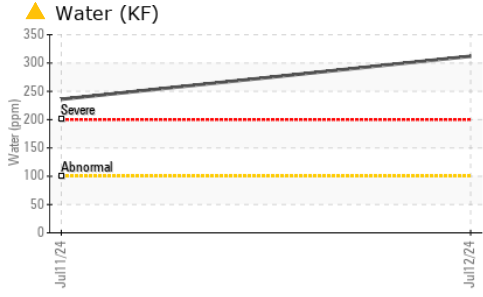

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.01	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 140	122	217	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------





**Color**

no image

**Bottom**

no image

## GRAPHS

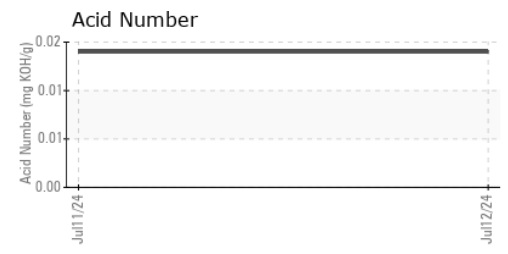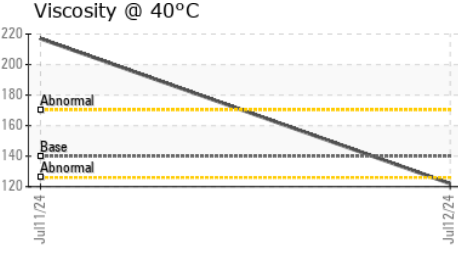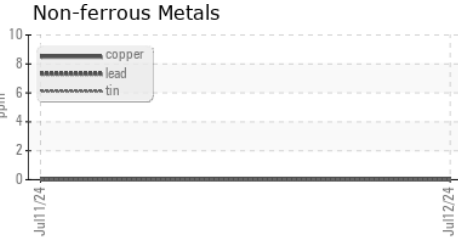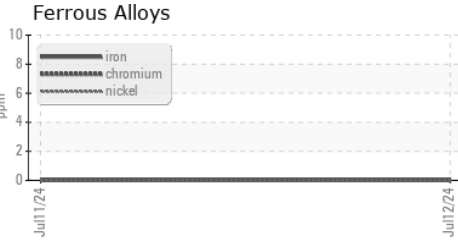

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0899758      **Received** : 15 Jul 2024  
**Lab Number** : 06236907      **Tested** : 16 Jul 2024  
**Unique Number** : 11125741      **Diagnosed** : 17 Jul 2024 - Jonathan Hester  
**Test Package** : IND 2

**SCHNEIDER ELECTRIC**  
 PO DRAWER 185  
 MORRISVILLE, NC  
 US 27560  
 Contact: ERICH WEBBER  
 erich.webber@se.com  
 T: (919)274-4145  
 F: (919)467-7466

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)