




# OIL ANALYSIS REPORT

Sample Rating Trend

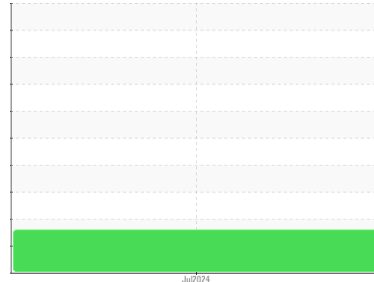

WATER



Area

**NOT GIVEN**

Machine Id

**INGERSOLL RAND MOX1000071U1943 - CASCADES**

Component

**Compressor**

## DIAGNOSIS

### ● Recommendation

We advise that you follow the water drain-off procedure for this component. We recommend an early resample to monitor this condition.

### Wear

All component wear rates are normal.

### ● Contamination

There is a moderate concentration of water present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UCH06236927</b>	---	---
Sample Date	Client Info		<b>09 Jul 2024</b>	---	---
Machine Age	hrs	Client Info	<b>13941</b>	---	---
Oil Age	hrs	Client Info	<b>6000</b>	---	---
Oil Changed	Client Info		<b>Not Changed</b>	---	---
Sample Status			<b>ATTENTION</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	---	---
Chromium	ppm	ASTM D5185m >10	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m	<b>0</b>	---	---
Silver	ppm	ASTM D5185m	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >25	<b>0</b>	---	---
Lead	ppm	ASTM D5185m >25	<b>0</b>	---	---
Copper	ppm	ASTM D5185m >50	<b>0</b>	---	---
Tin	ppm	ASTM D5185m >15	<b>&lt;1</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	---	---
Barium	ppm	ASTM D5185m	<b>75</b>	---	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Magnesium	ppm	ASTM D5185m	<b>0</b>	---	---
Calcium	ppm	ASTM D5185m	<b>2</b>	---	---
Phosphorus	ppm	ASTM D5185m	<b>4</b>	---	---
Zinc	ppm	ASTM D5185m	<b>0</b>	---	---
Sulfur	ppm	ASTM D5185m	<b>393</b>	---	---

## CONTAMINANTS




	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>1</b>	---	---
Sodium	ppm	ASTM D5185m	<b>33</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>5</b>	---	---
Water	%	ASTM D6304 >0.1	● <b>0.548</b>	---	---
ppm Water	ppm	ASTM D6304 >1000	● <b>5480</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.29</b>	---	---



# OIL ANALYSIS REPORT

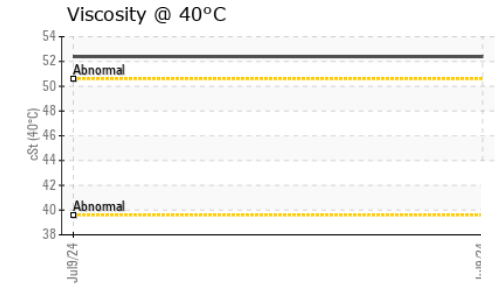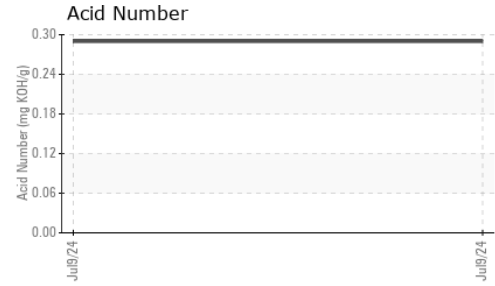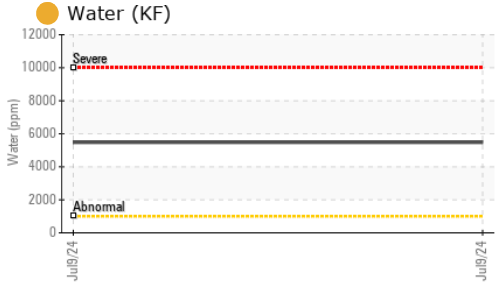





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	0.2%	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	52.4	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

## GRAPHS

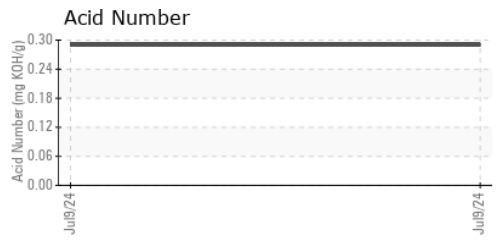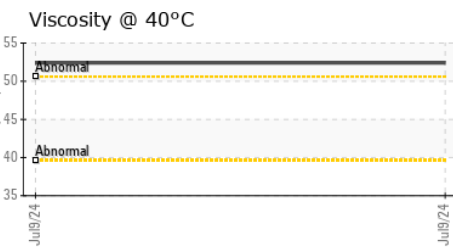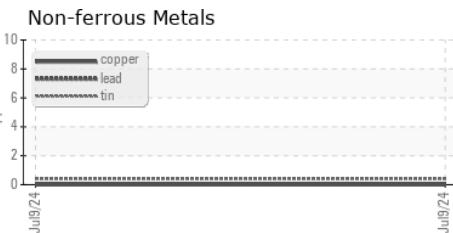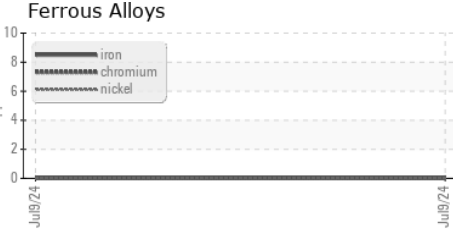

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH06236927      **Received** : 15 Jul 2024  
**Lab Number** : 06236927      **Tested** : 17 Jul 2024  
**Unique Number** : 11125761      **Diagnosed** : 17 Jul 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF )

**GREEN COUNTY COMPRESSOR SERVICE**  
 11974 E 530 RD  
 CLAREMORE, OK  
 US 74019  
 Contact: ASHLEY PIGUET  
 ashley@gccs.us.com  
 T: (918)906-6343  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)