


# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**

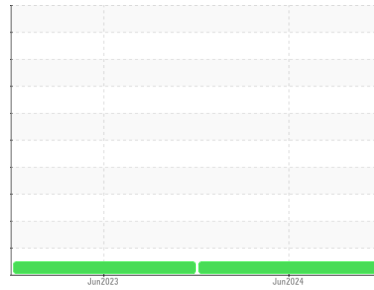

Area

**IR ULTRA SSR**

Machine Id

**INGERSOLL RAND KE1604U95180 - OMAHA TRACK**

Component

**Compressor**

**DIAGNOSIS**

**Recommendation**

Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**Contamination**

There is no indication of any contamination in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

**SAMPLE INFORMATION** method limit/base current history1 history2

Sample Number	Client Info	<b>JHF0000251</b>	UCH05889205	---
Sample Date	Client Info	<b>27 Jun 2024</b>	20 Jun 2023	---
Machine Age	hrs	Client Info	<b>18152</b>	18151
Oil Age	hrs	Client Info	<b>60</b>	239
Oil Changed	Client Info	<b>Not Chngd</b>	Not Chngd	---
Sample Status		<b>NORMAL</b>	NORMAL	---

**CONTAMINATION** method limit/base current history1 history2

Water	WC Method	>0.1	<b>NEG</b>	NEG	---
-------	-----------	------	------------	-----	-----

**WEAR METALS** method limit/base current history1 history2

Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	---
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m		<b>0</b>	0	---
Titanium	ppm	ASTM D5185m		<b>0</b>	0	---
Silver	ppm	ASTM D5185m		<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>25	<b>0</b>	0	---
Lead	ppm	ASTM D5185m	>25	<b>0</b>	<1	---
Copper	ppm	ASTM D5185m	>50	<b>0</b>	<1	---
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	---

**ADDITIVES** method limit/base current history1 history2

Boron	ppm	ASTM D5185m	0	<b>0</b>	0	---
Barium	ppm	ASTM D5185m	500	<b>537</b>	540	---
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m		<b>0</b>	0	---
Magnesium	ppm	ASTM D5185m	0	<b>0</b>	<1	---
Calcium	ppm	ASTM D5185m	0	<b>3</b>	3	---
Phosphorus	ppm	ASTM D5185m	20	<b>3</b>	2	---
Zinc	ppm	ASTM D5185m	0	<b>0</b>	6	---
Sulfur	ppm	ASTM D5185m	200	<b>320</b>	277	---



**CONTAMINANTS** method limit/base current history1 history2

Silicon	ppm	ASTM D5185m	>25	<b>2</b>	2	---
Sodium	ppm	ASTM D5185m		<b>19</b>	13	---
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	1	---

**FLUID DEGRADATION** method limit/base current history1 history2

Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.17</b>	0.321	---
------------------	----------	------------	--	-------------	-------	-----


# OIL ANALYSIS REPORT

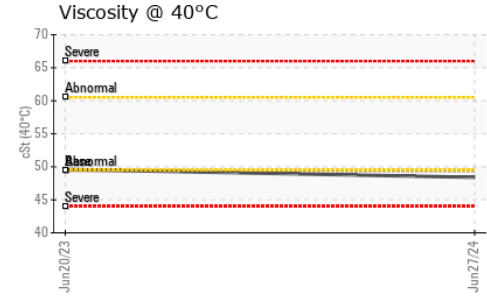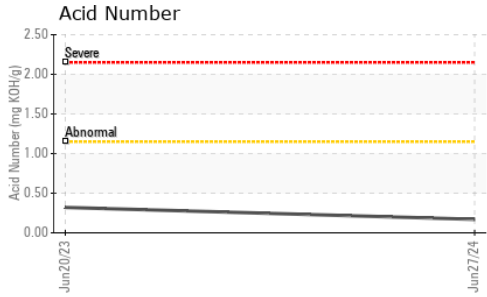





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	49.4	<b>48.4</b>	49.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

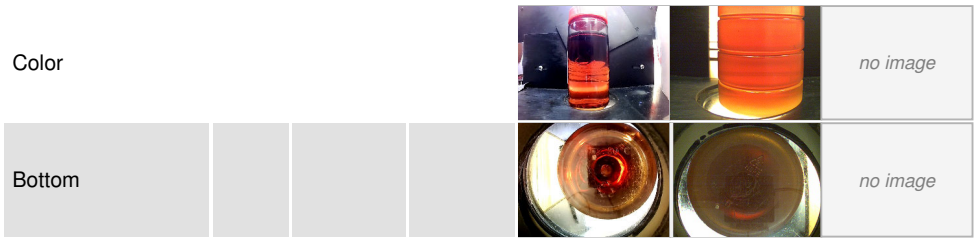

### GRAPHS

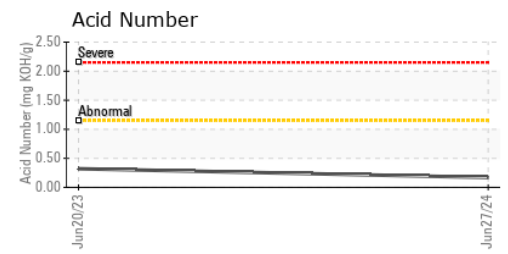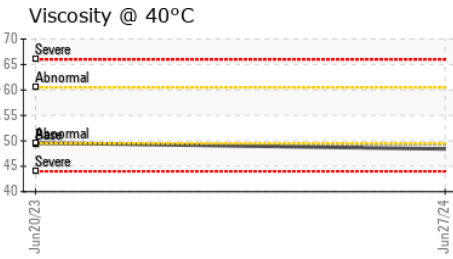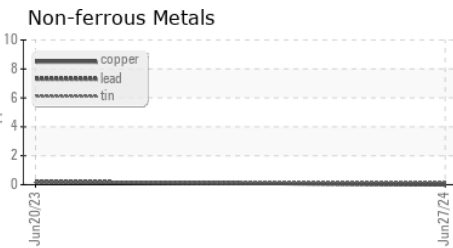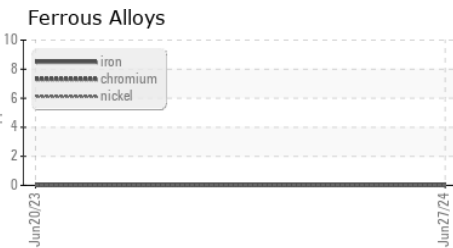

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : JHF0000251      **Received** : 15 Jul 2024  
**Lab Number** : **06236940**      **Tested** : 17 Jul 2024  
**Unique Number** : 11125774      **Diagnosed** : 17 Jul 2024 - Don Baldrige  
**Test Package** : IND 2

**JOHN HENRY FOSTER COMPANY**  
 4700 LEBOURGET STREET  
 SAINT LOUIS, MO  
 US 63134  
 Contact: RACHEL VON HATTEN  
 rvonhatten@jhf.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)