




# OIL ANALYSIS REPORT

Sample Rating Trend

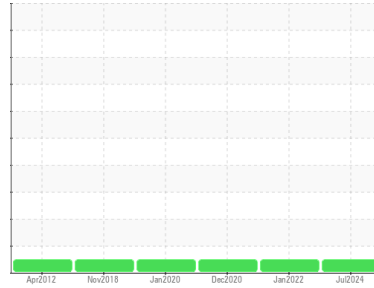

**NORMAL**



Area  
**ACS-46-5 [421892]**  
 Machine Id  
**ATLAS COPCO API293381 - ROCKAWAY MARBLE**  
 Component  
**Compressor**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UCH06236971</b>	UCH05457258	UCH05146250
Sample Date	Client Info		<b>09 Jul 2024</b>	06 Jan 2022	03 Dec 2020
Machine Age	hrs	Client Info	<b>46010</b>	41957	0
Oil Age	hrs	Client Info	<b>2768</b>	2024	0
Oil Changed	Client Info		<b>Changed</b>	Changed	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>50	<b>&lt;1</b>	<1	<1
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
Aluminum	ppm	ASTM D5185m	>25	<b>2</b>	0	0
Lead	ppm	ASTM D5185m	>25	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	0
Antimony	ppm	ASTM D5185m		<b>---</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0.0	<b>0</b>	3	0
Barium	ppm	ASTM D5185m	0.0	<b>3</b>	0	0
Molybdenum	ppm	ASTM D5185m	0	<b>&lt;1</b>	0	0
Manganese	ppm	ASTM D5185m	0	<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m	0.0	<b>&lt;1</b>	0	0
Calcium	ppm	ASTM D5185m	0.0	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	966	<b>677</b>	199	200
Zinc	ppm	ASTM D5185m	0	<b>5</b>	24	22
Sulfur	ppm	ASTM D5185m	1309	<b>130</b>	1915	1304

## CONTAMINANTS


	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>25	<b>1</b>	<1	0
Sodium	ppm	ASTM D5185m		<b>0</b>	<1	0
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	0	0

## FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	0.172	<b>0.26</b>	0.059	0.085




# OIL ANALYSIS REPORT

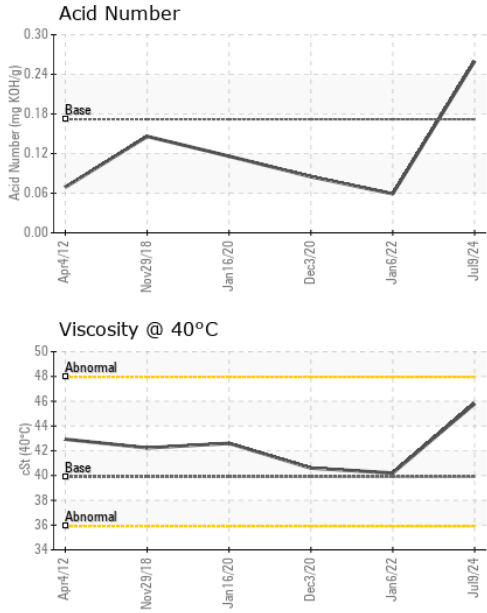





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	39.9	<b>45.8</b>	40.2	40.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

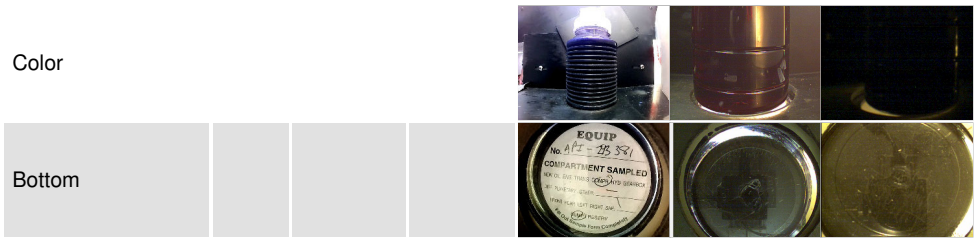

## GRAPHS

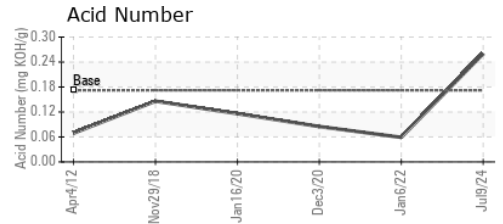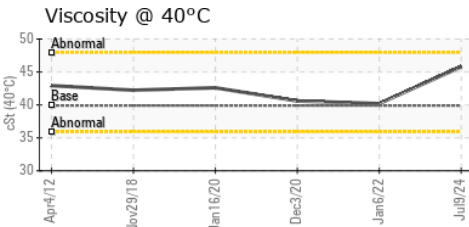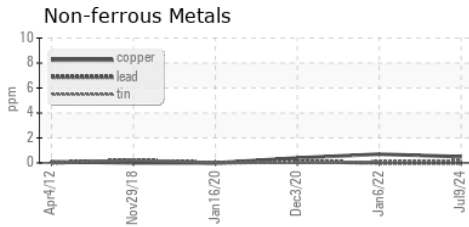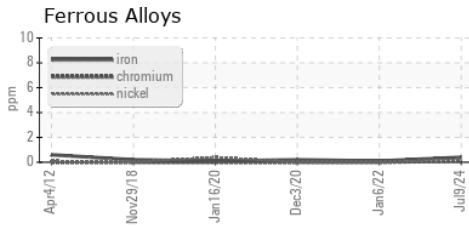

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH06236971      **Received** : 15 Jul 2024  
**Lab Number** : **06236971**      **Tested** : 17 Jul 2024  
**Unique Number** : 11125805      **Diagnosed** : 17 Jul 2024 - Wes Davis  
**Test Package** : IND 2

**AIRMATIC COMPRESSOR SYSTEMS**  
 700 WASHINGTON AVE  
 CARLSTADT, NJ  
 US 07072  
 Contact: ELVIN DIAZ  
 ediaz@airmaticcompressor.com; canastasio@wearcheckusa.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (800)864-7621  
F: (201)342-6241