

Area


**NOT GIVEN**

Machine Id

**SULLIVAN PALATEK VD018976 - BRIESE IRON WORKS**

Component

**Compressor**

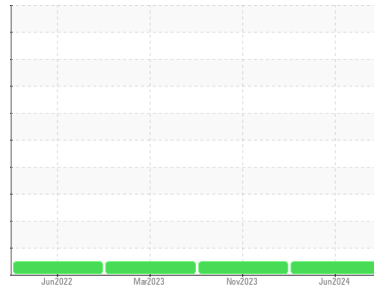

**DIAGNOSIS**

**Recommendation**

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

**Wear**

All component wear rates are normal.

**Contamination**

There is no indication of any contamination in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>UHK06236993</b>	UHK06019696	UHK05841541
Sample Date	Client Info			<b>22 Jun 2024</b>	14 Nov 2023	31 Mar 2023
Machine Age	hrs	Client Info		<b>11029</b>	7850	4681
Oil Age	hrs	Client Info		<b>4279</b>	7850	4114
Oil Changed	Client Info			<b>Changed</b>	Changed	Not Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	<b>NEG</b>	NEG	NEG


WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>1</b>	<1	0
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
Silver	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Aluminum	ppm	ASTM D5185m	>25	<b>2</b>	2	6
Lead	ppm	ASTM D5185m	>25	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m	>50	<b>2</b>	<1	0
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
Magnesium	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Calcium	ppm	ASTM D5185m		<b>0</b>	4	0
Phosphorus	ppm	ASTM D5185m		<b>562</b>	174	218
Zinc	ppm	ASTM D5185m		<b>1</b>	0	0
Sulfur	ppm	ASTM D5185m		<b>748</b>	294	104

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>1</b>	4	3
Sodium	ppm	ASTM D5185m		<b>0</b>	0	0
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	<1	0

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.21</b>	0.13	0.339


# OIL ANALYSIS REPORT

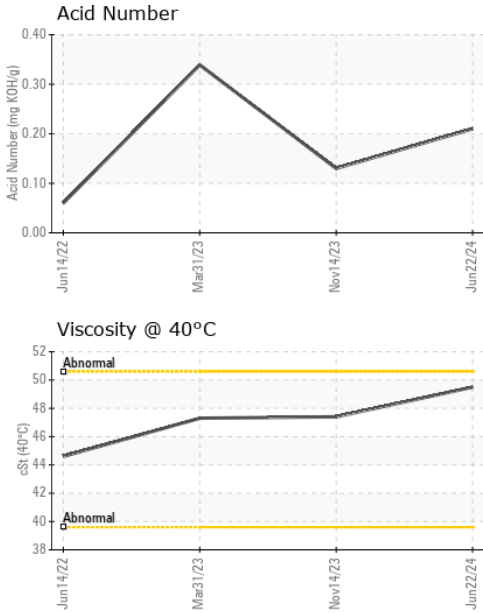



VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	LIGHT
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	<b>49.5</b>	47.4	47.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

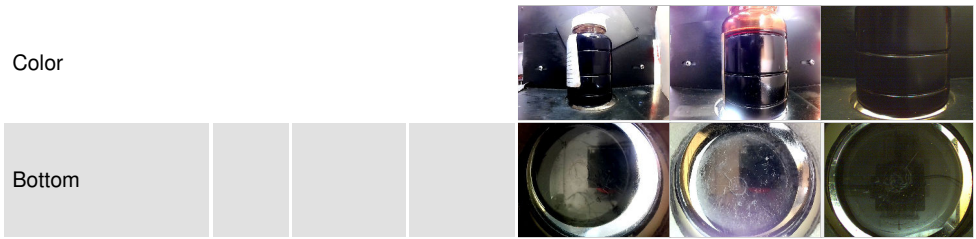

## GRAPHS

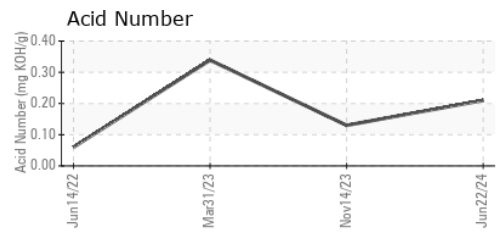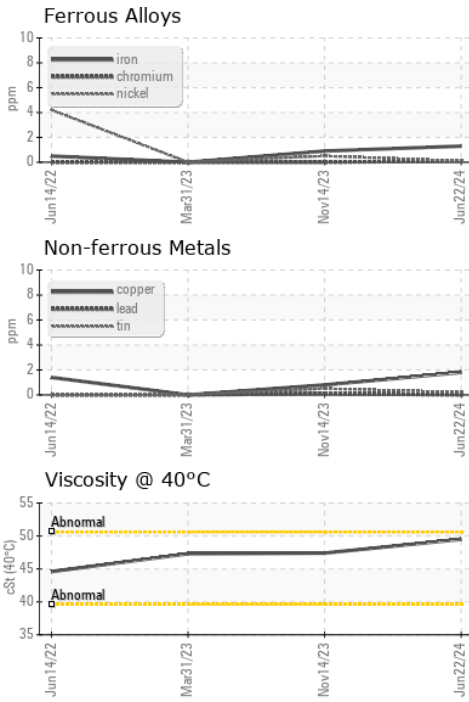

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UHK06236993      **Received** : 15 Jul 2024  
**Lab Number** : 06236993      **Tested** : 17 Jul 2024  
**Unique Number** : 11125827      **Diagnosed** : 17 Jul 2024 - Wes Davis  
**Test Package** : IND 2

**APPLIED AIR SYSTEMS**  
 LAKEVILLE, MN  
 US 55044  
 Contact: SCOTT HARPER  
 sc@appliedairsystems.com  
 T: (952)388-3122  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)