




OIL ANALYSIS REPORT

Sample Rating Trend

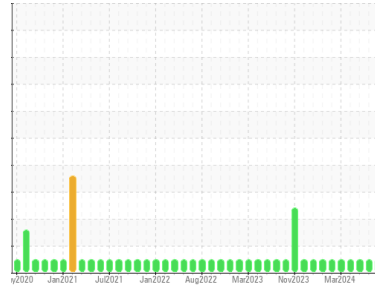

NORMAL



Area
CRANE - T LANGE
Machine Id
T LANGE
Component
Port Genset
Fluid
CHEVRON DELO 400 LE 15W40 (5 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0922341	WC0922387	WC0892633
Sample Date	Client Info			21 Jun 2024	19 May 2024	06 May 2024
Machine Age	hrs	Client Info		37935	37665	37415
Oil Age	hrs	Client Info		250	250	250
Oil Changed	Client Info			Changed	Changed	Changed
Sample Status				NORMAL	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>4.0		<1.0	<1.0	<1.0
Water	WC Method	>0.1		NEG	NEG	NEG
Glycol	WC Method			NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	5	5	6
Chromium	ppm	ASTM D5185m	>4	0	0	<1
Nickel	ppm	ASTM D5185m	>2	0	0	0
Titanium	ppm	ASTM D5185m		<1	<1	<1
Silver	ppm	ASTM D5185m	>5	0	0	0
Aluminum	ppm	ASTM D5185m	>12	3	3	4
Lead	ppm	ASTM D5185m	>17	0	<1	0
Copper	ppm	ASTM D5185m	>70	0	<1	<1
Tin	ppm	ASTM D5185m	>15	<1	0	<1
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		332	364	425
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		128	130	136
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m		685	708	712
Calcium	ppm	ASTM D5185m		1650	1760	1736
Phosphorus	ppm	ASTM D5185m	1200	785	786	792
Zinc	ppm	ASTM D5185m	1300	901	936	934
Sulfur	ppm	ASTM D5185m	3200	3099	3150	3113




CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	5	5	6
Sodium	ppm	ASTM D5185m		2	2	2
Potassium	ppm	ASTM D5185m	>20	0	1	0

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		0.3	0.3	0.3
Nitration	Abs/cm	*ASTM D7624	>20	6.8	6.4	7.0
Sulfation	Abs/.1mm	*ASTM D7415	>30	23.1	22.7	22.7

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	16.6	16.2	16.8
Base Number (BN)	mg KOH/g	ASTM D2896	9.6	9.1	9.3	9.1







OIL ANALYSIS REPORT

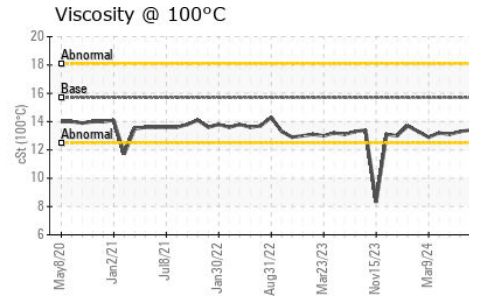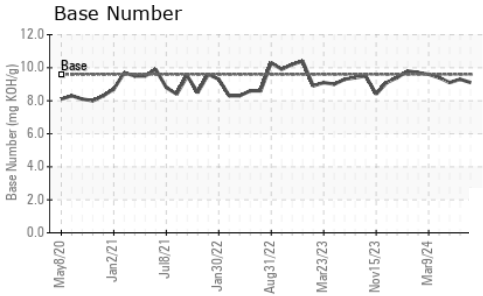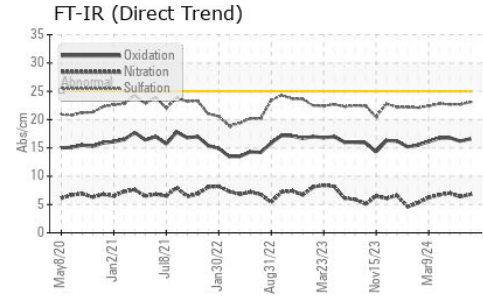

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	15.7	13.4	13.3

GRAPHS

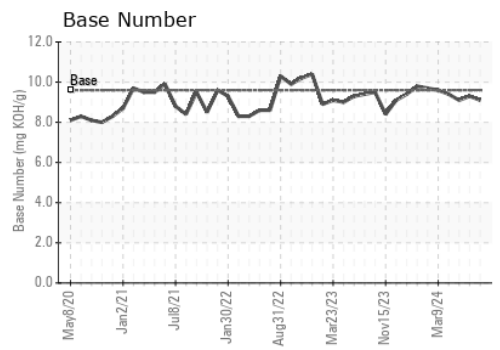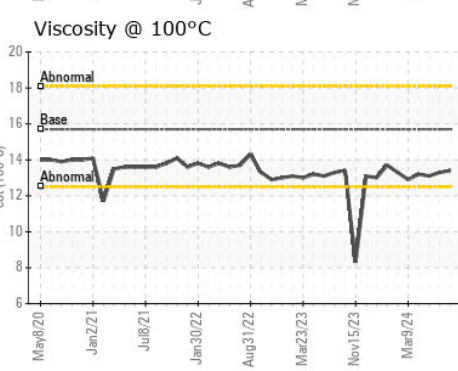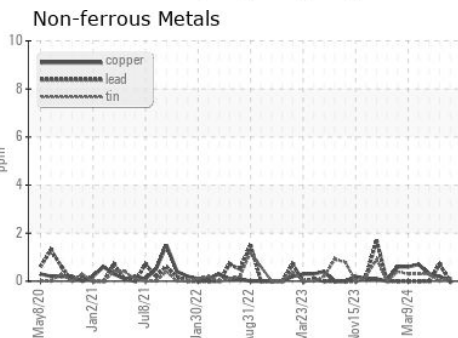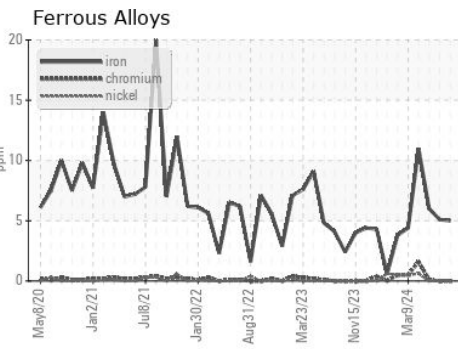

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0922341
Lab Number : 06237314
Unique Number : 11126148
Test Package : FLEET

Received : 15 Jul 2024
Tested : 17 Jul 2024
Diagnosed : 17 Jul 2024 - Wes Davis

ASSOCIATED TERMINALS - CRANE

CONVENT, LA
 US 70723
 Contact: GREG JOSEY
 gjosey@associatedterminals.com
 T:
 F: (225)562-3515