




OIL ANALYSIS REPORT

Sample Rating Trend

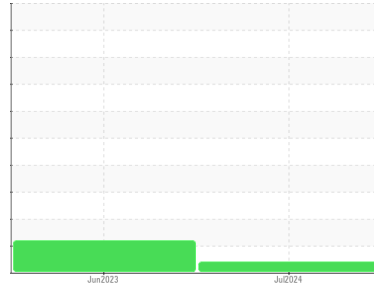

VISCOSITY



Machine Id
BV-MSTAR COUNTRY HOUSE TENANT LLC SGM3258CV
 Component
Diesel Engine
 Fluid
DIESEL ENGINE OIL SAE 15W40 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

Fuel content negligible. There is no indication of any contamination in the oil.

Fluid Condition

The oil viscosity is lower than normal. The BN result indicates that there is suitable alkalinity remaining in the oil. Confirm oil type.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0921732	WC0799865	---
Sample Date	Client Info		15 Jul 2024	29 Jun 2023	---
Machine Age	hrs	Client Info	0	0	---
Oil Age	hrs	Client Info	0	0	---
Oil Changed	Client Info		N/A	N/A	---
Sample Status			ATTENTION	ATTENTION	---

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.2	NEG	NEG	---
Glycol	WC Method		NEG	NEG	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >100	9	5	---
Chromium	ppm	ASTM D5185m >20	<1	<1	---
Nickel	ppm	ASTM D5185m >4	0	0	---
Titanium	ppm	ASTM D5185m	0	<1	---
Silver	ppm	ASTM D5185m >3	0	0	---
Aluminum	ppm	ASTM D5185m >20	3	<1	---
Lead	ppm	ASTM D5185m >40	0	2	---
Copper	ppm	ASTM D5185m >330	3	12	---
Tin	ppm	ASTM D5185m >15	0	2	---
Vanadium	ppm	ASTM D5185m	0	0	---
Cadmium	ppm	ASTM D5185m	2	0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 250	225	38	---
Barium	ppm	ASTM D5185m 10	0	14	---
Molybdenum	ppm	ASTM D5185m 100	83	80	---
Manganese	ppm	ASTM D5185m	2	<1	---
Magnesium	ppm	ASTM D5185m 450	584	942	---
Calcium	ppm	ASTM D5185m 3000	1381	1197	---
Phosphorus	ppm	ASTM D5185m 1150	633	1022	---
Zinc	ppm	ASTM D5185m 1350	849	1256	---
Sulfur	ppm	ASTM D5185m 4250	2633	3898	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	7	7	---
Sodium	ppm	ASTM D5185m >158	2	2	---
Potassium	ppm	ASTM D5185m >20	1	4	---
Fuel	%	ASTM D3524 >5	0.1	▲ 3.0	---

INFRA-RED





	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844 >3	0	0.1	---
Nitration	Abs/cm	*ASTM D7624 >20	5.8	5.3	---
Sulfation	Abs/.1mm	*ASTM D7415 >30	15.6	18.1	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	10.6	13.5	---
Base Number (BN)	mg KOH/g	ASTM D2896 8.5	6.9	10.4	---











OIL ANALYSIS REPORT

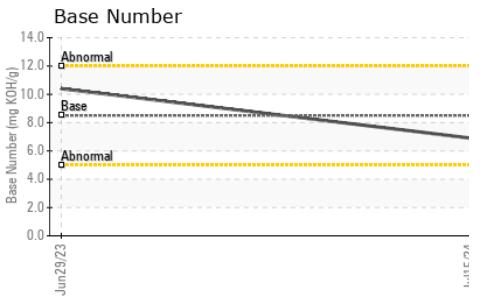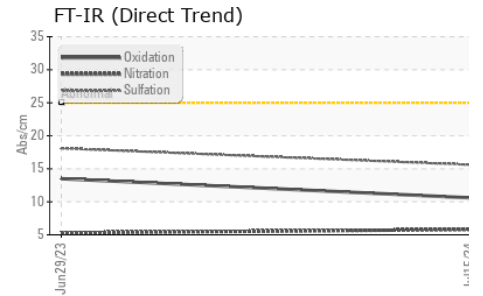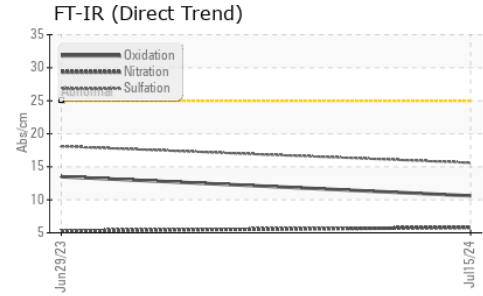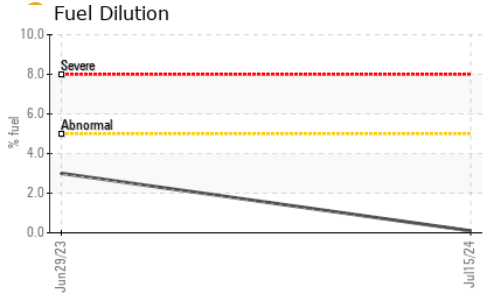

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.2	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.4	● 10.6	● 11.6

GRAPHS

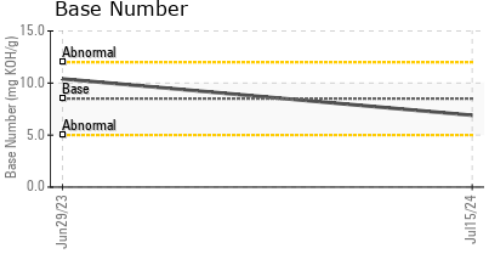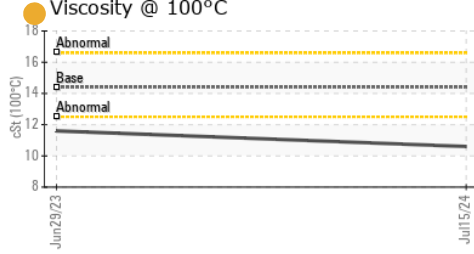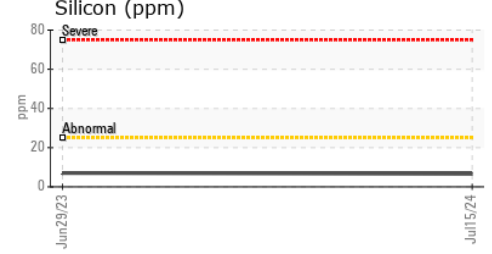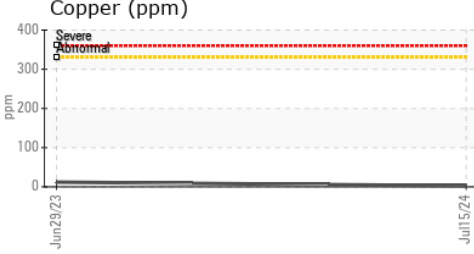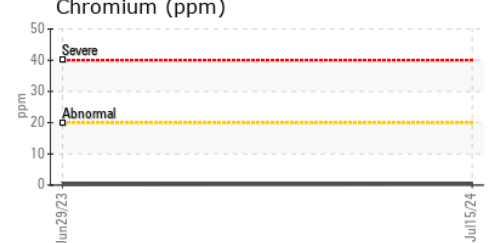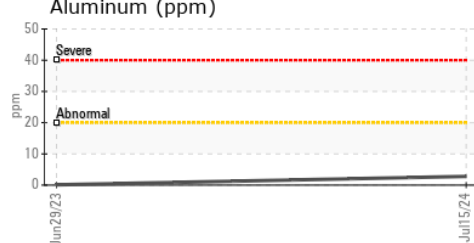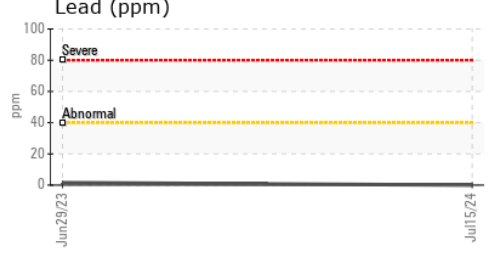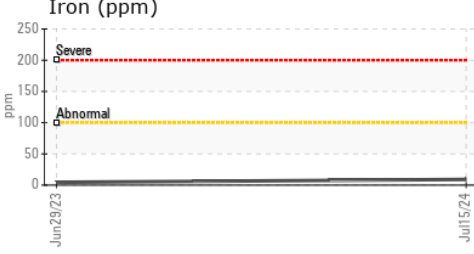

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0921732 **Received** : 16 Jul 2024
Lab Number : 06237607 **Tested** : 18 Jul 2024
Unique Number : 11126441 **Diagnosed** : 18 Jul 2024 - Don Baldrige
Test Package : MOB 1 (Additional Tests: FuelDilution, PercentFuel, TBN)

GEN TECH LTD
 3017 RT 9W
 NEW WINDSOR, NY
 US 12553
 Contact: JOE SAYEGH
 joe@gentechltd.com
 T: (845)568-0500
 F: (845)568-3073

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)