




# OIL ANALYSIS REPORT

Sample Rating Trend

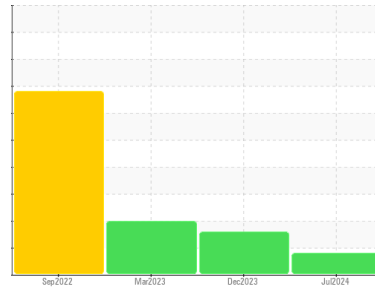

**WEAR**



Area

**HOTLINE/120 MILL**

Machine Id

**120 #2 REEL MTR CENTER BRG 1415-037-0092**

Component

**Center Bearing**

Fluid

**ROYAL PURPLE SYNFILM GT 68 (20 GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

The lead level is abnormal. All other component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>KFS0004504</b>	KFS0004874	KFS0002094
Sample Date	Client Info	<b>12 Jul 2024</b>	19 Dec 2023	03 Mar 2023
Machine Age	hrs	<b>0</b>	0	0
Oil Age	hrs	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

## CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >2	<b>NEG</b>	NEG	NEG

## WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >20	<b>0</b>	<1	<1
Chromium	ppm ASTM D5185m >20	<b>0</b>	<1	0
Nickel	ppm ASTM D5185m >20	<b>0</b>	0	0
Titanium	ppm ASTM D5185m	<b>0</b>	0	0
Silver	ppm ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm ASTM D5185m >20	<b>0</b>	2	2
Lead	ppm ASTM D5185m >20	<b>▲ 21</b>	▲ 23	8
Copper	ppm ASTM D5185m >20	<b>0</b>	0	0
Tin	ppm ASTM D5185m >20	<b>&lt;1</b>	2	<1
Vanadium	ppm ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	<b>0</b>	0	0
Barium	ppm ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm ASTM D5185m	<b>0</b>	0	0
Manganese	ppm ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm ASTM D5185m 90	<b>74</b>	99	88
Calcium	ppm ASTM D5185m	<b>0</b>	3	2
Phosphorus	ppm ASTM D5185m	<b>6</b>	30	<1
Zinc	ppm ASTM D5185m	<b>0</b>	0	0
Sulfur	ppm ASTM D5185m	<b>21648</b>	21175	20303

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >15	<b>&lt;1</b>	1	1
Sodium	ppm ASTM D5185m	<b>&lt;1</b>	<1	<1
Potassium	ppm ASTM D5185m >20	<b>0</b>	<1	0

## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	<b>170</b>	● 17207	▲ 97227
Particles >6µm	ASTM D7647 >2500	<b>28</b>	1420	▲ 22103
Particles >14µm	ASTM D7647 >160	<b>3</b>	63	▲ 998
Particles >21µm	ASTM D7647 >40	<b>1</b>	22	▲ 183
Particles >38µm	ASTM D7647 >10	<b>0</b>	2	10
Particles >71µm	ASTM D7647 >3	<b>0</b>	0	1
Oil Cleanliness	ISO 4406 (c) >20/18/14	<b>15/12/9</b>	● 21/18/13	▲ 24/22/17


## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045	<b>0.33</b>	0.39	0.34











VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	VLITE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 68	<b>67.0</b>	68.0	68.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

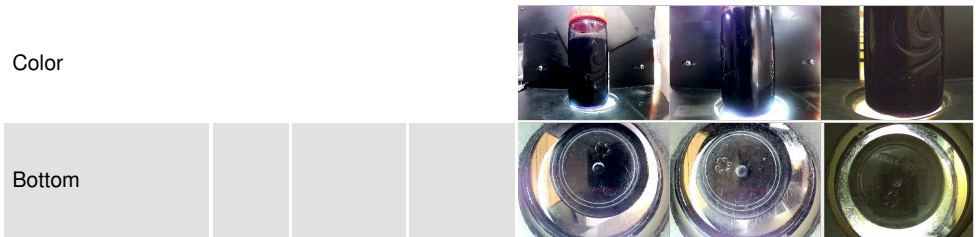

## GRAPHS

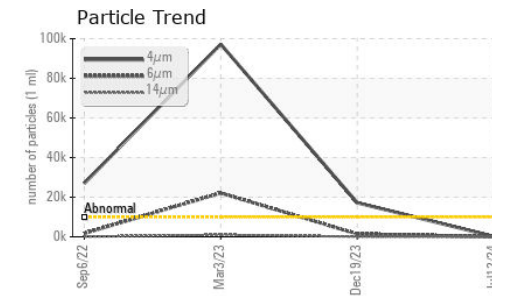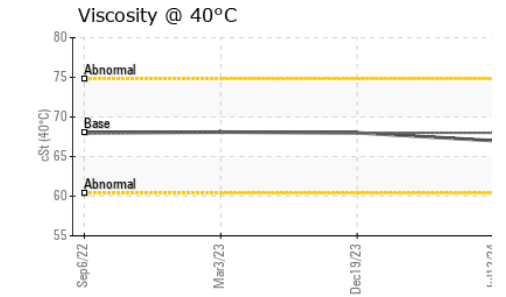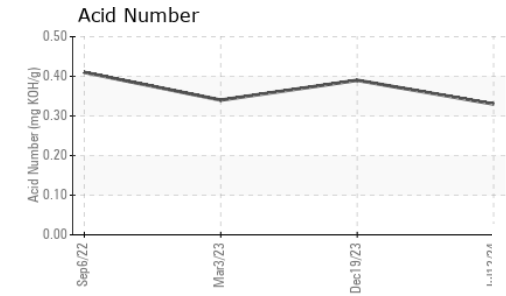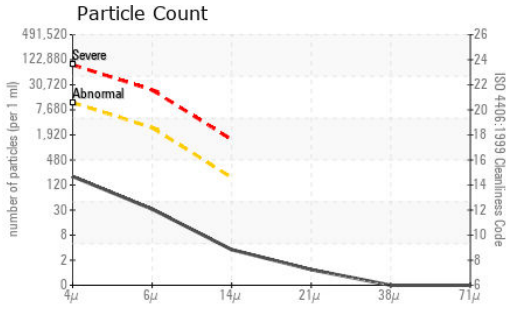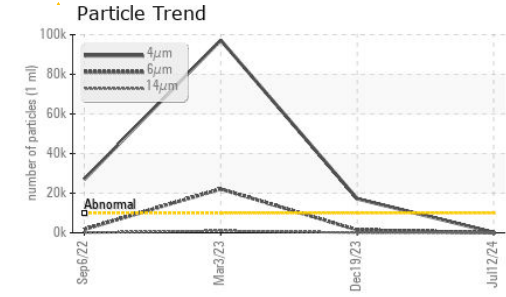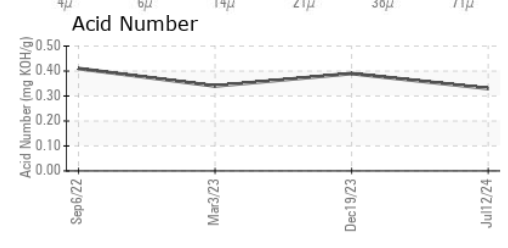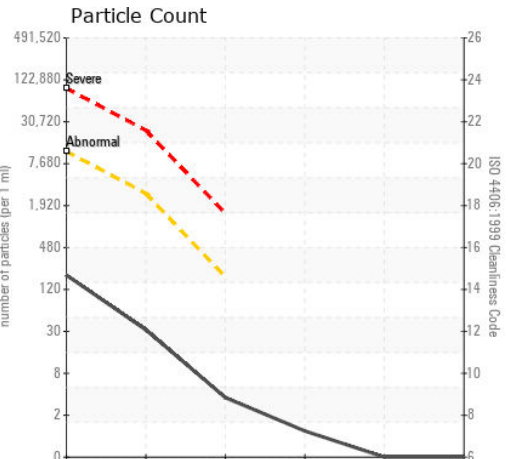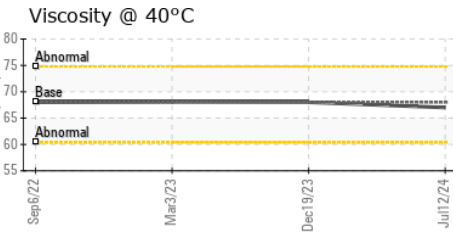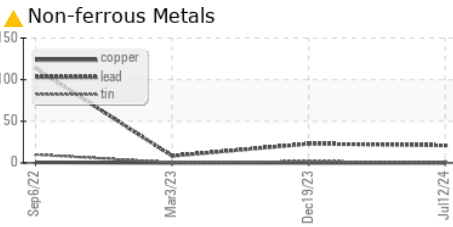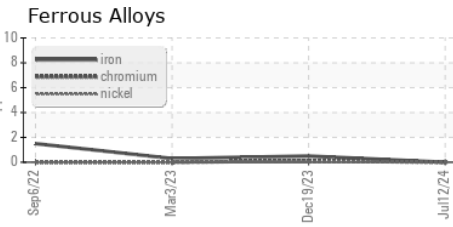

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KFS0004504      **Received** : 16 Jul 2024  
**Lab Number** : 06237744      **Tested** : 17 Jul 2024  
**Unique Number** : 11126578      **Diagnosed** : 18 Jul 2024 - Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: PrtCount )

**CONSTELLIUM**  
 4805 SECOND STREET  
 MUSCLE SHOALS, AL  
 US 35661  
 Contact: Joel Even  
 joel.even@constellium.com  
 T: (256)740-7490  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)