




OIL ANALYSIS REPORT

Sample Rating Trend

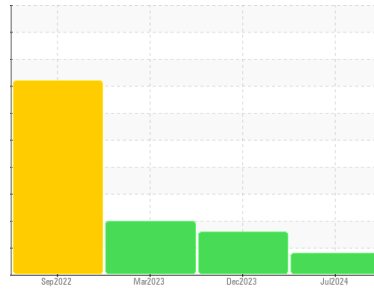

WEAR



Area

HOTLINE/120 MILL

Machine Id

120 #2 REEL MTR SOUTH BRG 1415-037-0091

Component

South Bearing

Fluid

ROYAL PURPLE SYNFILM GT 68 (20 GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

The lead level is abnormal. All other component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KFS0004397	KFS0004875	KFS0002095
Sample Date	Client Info	12 Jul 2024	19 Dec 2023	03 Mar 2023
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		ABNORMAL	ABNORMAL	ABNORMAL

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >2	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >20	0	<1	<1
Chromium	ppm ASTM D5185m >20	0	<1	0
Nickel	ppm ASTM D5185m >20	0	0	0
Titanium	ppm ASTM D5185m	0	0	0
Silver	ppm ASTM D5185m	0	0	0
Aluminum	ppm ASTM D5185m >20	0	2	<1
Lead	ppm ASTM D5185m >20	▲ 28	▲ 34	13
Copper	ppm ASTM D5185m >20	0	0	0
Tin	ppm ASTM D5185m >20	<1	3	1
Vanadium	ppm ASTM D5185m	0	0	0
Cadmium	ppm ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	0	0	0
Barium	ppm ASTM D5185m	0	0	0
Molybdenum	ppm ASTM D5185m	0	0	0
Manganese	ppm ASTM D5185m	0	0	0
Magnesium	ppm ASTM D5185m 90	74	101	87
Calcium	ppm ASTM D5185m	<1	3	2
Phosphorus	ppm ASTM D5185m	4	30	2
Zinc	ppm ASTM D5185m	0	0	0
Sulfur	ppm ASTM D5185m	20753	20287	20216

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >15	<1	2	1
Sodium	ppm ASTM D5185m	<1	<1	1
Potassium	ppm ASTM D5185m >20	0	<1	0

FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	596	▲ 26904	▲ 54937
Particles >6µm	ASTM D7647 >2500	123	1505	▲ 8458
Particles >14µm	ASTM D7647 >160	4	42	▲ 397
Particles >21µm	ASTM D7647 >40	1	11	▲ 79
Particles >38µm	ASTM D7647 >10	1	1	7
Particles >71µm	ASTM D7647 >3	1	0	0
Oil Cleanliness	ISO 4406 (c) >20/18/14	16/14/9	▲ 22/18/13	▲ 23/20/16

FLUID DEGRADATION


method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045	0.35	0.37	0.35

OIL ANALYSIS REPORT











VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	VLITE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	VLITE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 68	67.8	68.0	67.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

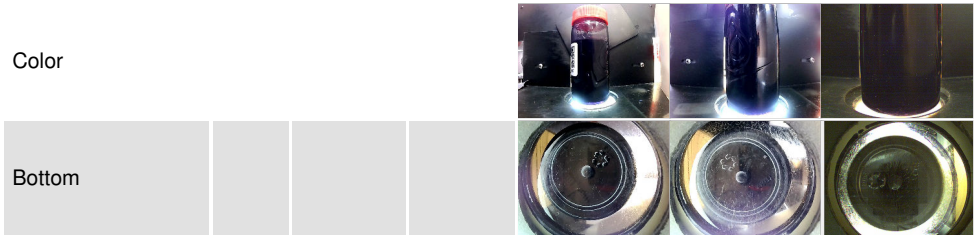

GRAPHS

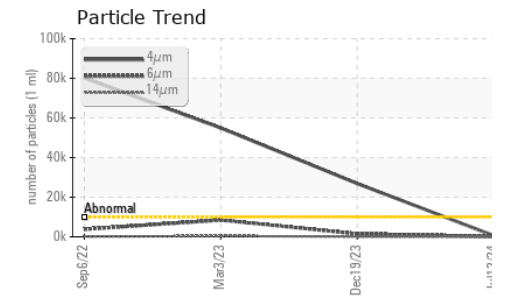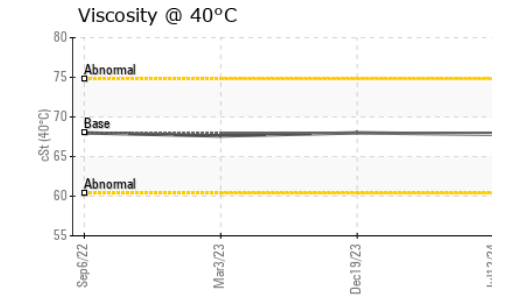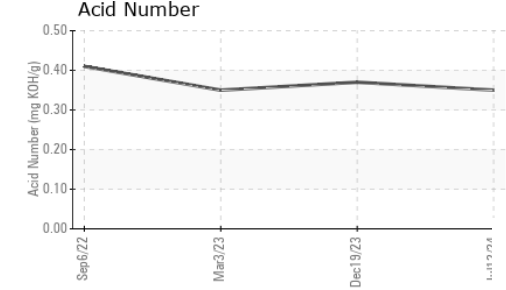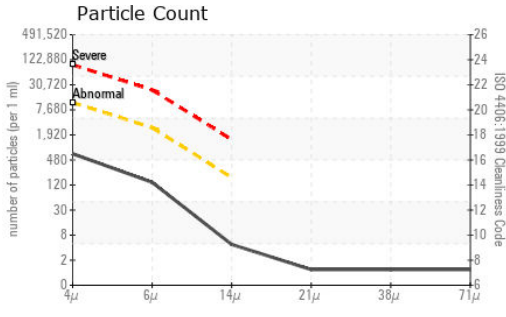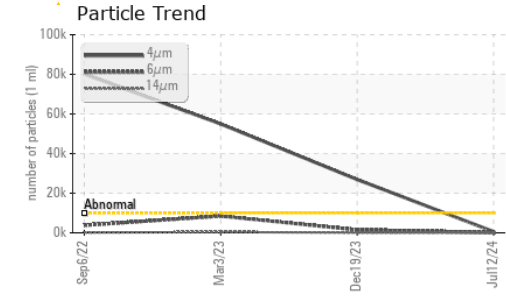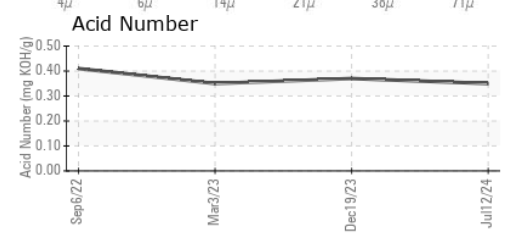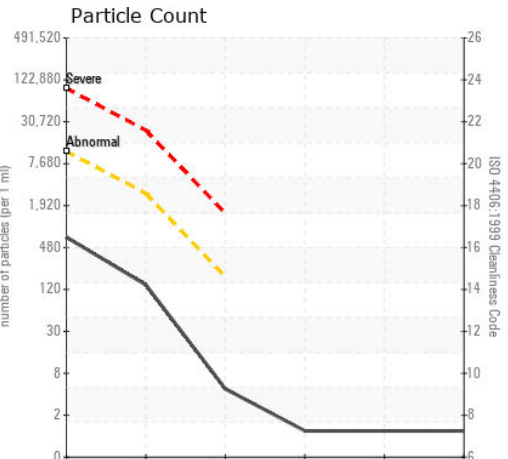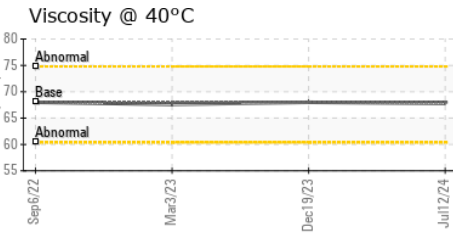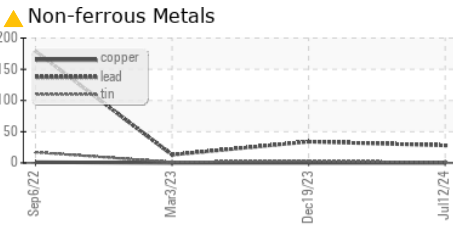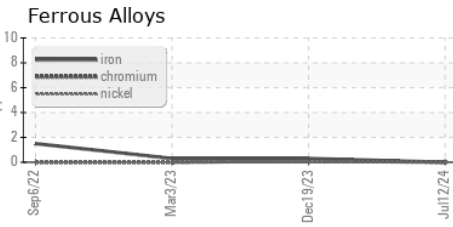

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KFS0004397 **Received** : 16 Jul 2024
Lab Number : 06237745 **Tested** : 17 Jul 2024
Unique Number : 11126579 **Diagnosed** : 18 Jul 2024 - Jonathan Hester
Test Package : IND 2 (Additional Tests: PrtCount)

CONSTELLIUM
 4805 SECOND STREET
 MUSCLE SHOALS, AL
 US 35661
 Contact: Joel Even
 joel.even@constellium.com
 T: (256)740-7490
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)