




# OIL ANALYSIS REPORT

## Sample Rating Trend

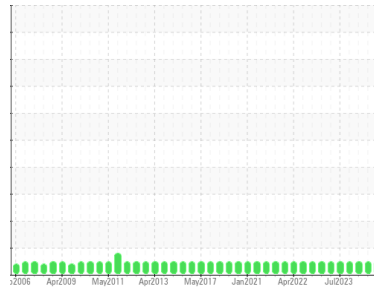

Area  
**SPLITTER 2**  
 Machine Id  
**055CM12001**  
 Component  
**Turbine**  
 Fluid  
**ROYAL PURPLE SYNFILM 32 (500 GAL)**

### DIAGNOSIS

**Recommendation**  
 Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>RP0027273</b>	RP0040976	RP0027293
Sample Date	Client Info	<b>15 Jul 2024</b>	09 Apr 2024	27 Jan 2024
Machine Age	hrs Client Info	<b>0</b>	0	0
Oil Age	hrs Client Info	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

### WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >15	<b>0</b>	0	0
Chromium	ppm ASTM D5185m >4	<b>0</b>	0	<1
Nickel	ppm ASTM D5185m >2	<b>0</b>	0	0
Titanium	ppm ASTM D5185m	<b>0</b>	0	0
Silver	ppm ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm ASTM D5185m >10	<b>0</b>	0	3
Lead	ppm ASTM D5185m	<b>0</b>	0	0
Copper	ppm ASTM D5185m >5	<b>&lt;1</b>	0	1
Tin	ppm ASTM D5185m >5	<b>0</b>	0	0
Vanadium	ppm ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm ASTM D5185m	<b>0</b>	0	0

### ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	<b>0</b>	0	0
Barium	ppm ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm ASTM D5185m	<b>0</b>	0	0
Manganese	ppm ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm ASTM D5185m 90	<b>61</b>	73	96
Calcium	ppm ASTM D5185m	<b>0</b>	1	2
Phosphorus	ppm ASTM D5185m	<b>0</b>	0	0
Zinc	ppm ASTM D5185m	<b>0</b>	0	0

### CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >15	<b>&lt;1</b>	0	0
Sodium	ppm ASTM D5185m	<b>1</b>	<1	0
Potassium	ppm ASTM D5185m >20	<b>0</b>	0	<1
Water	% ASTM D6304 >0.03	<b>0.011</b>	0.011	0.014
ppm Water	ppm ASTM D6304 >300	<b>111</b>	116	149






### FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	<b>7628</b>	710	2404
Particles >6µm	ASTM D7647 >1300	<b>194</b>	144	221
Particles >14µm	ASTM D7647 >160	<b>7</b>	17	12
Particles >21µm	ASTM D7647 >40	<b>2</b>	5	3
Particles >38µm	ASTM D7647 >10	<b>0</b>	1	1
Particles >71µm	ASTM D7647 >3	<b>0</b>	0	1
Oil Cleanliness	ISO 4406 (c) >--/17/14	<b>20/15/10</b>	17/14/11	18/15/11

### FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045	<b>0.34</b>	0.35	0.40


# OIL ANALYSIS REPORT

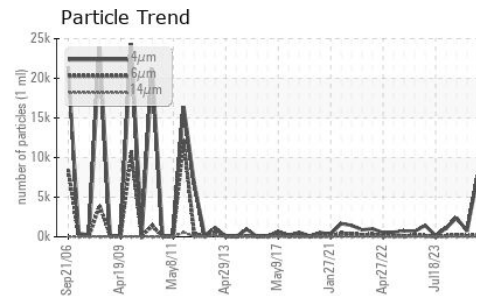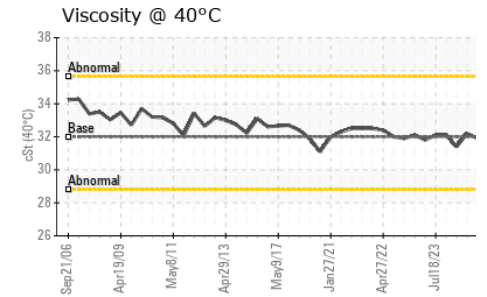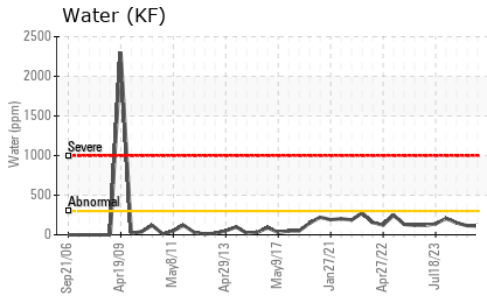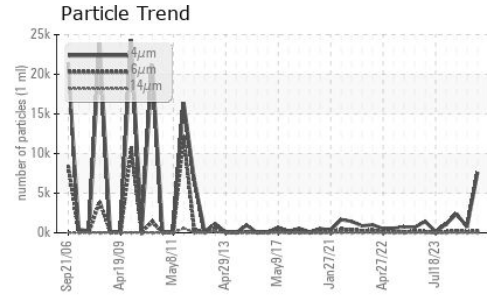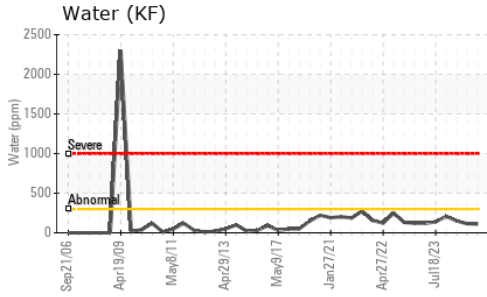






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.03	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	32	31.9	32.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

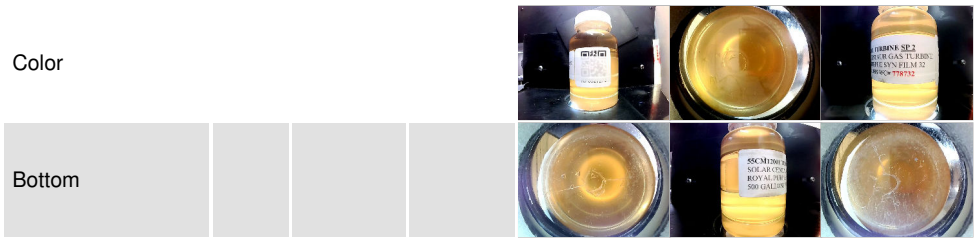

## GRAPHS

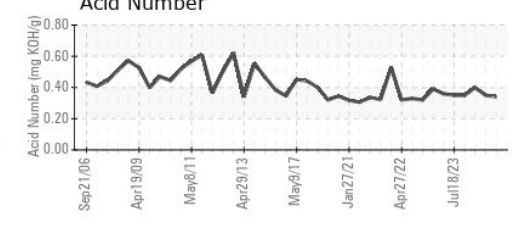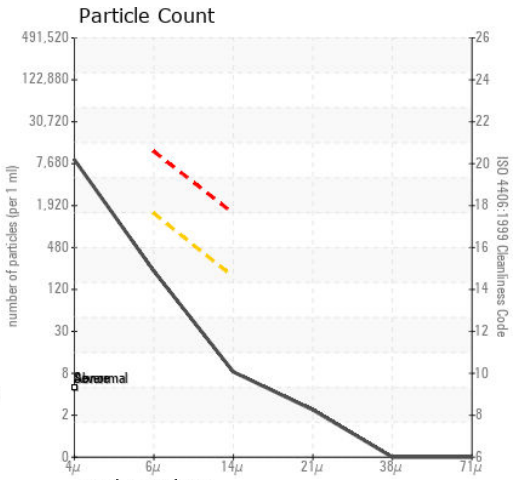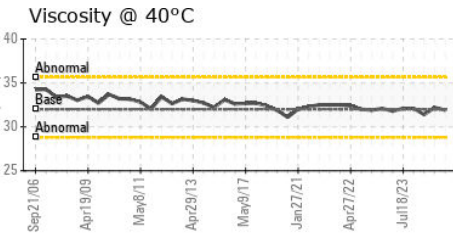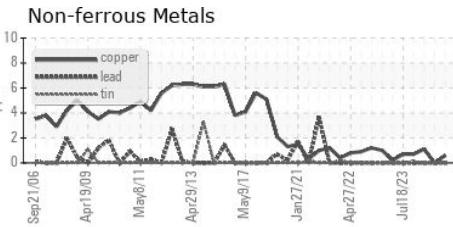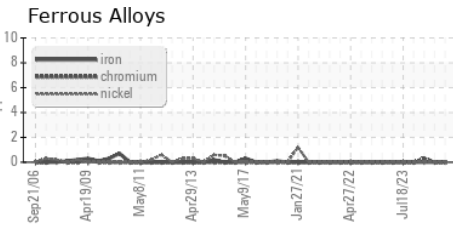

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0027273  
**Lab Number** : 06237784  
**Unique Number** : 11126618  
**Test Package** : IND 2 ( Additional Tests: PrtCount )  
**Received** : 16 Jul 2024  
**Tested** : 17 Jul 2024  
**Diagnosed** : 18 Jul 2024 - Don Baldrige

**ENTERPRISE PRODUCTS**  
 P.O. BOX 573  
 MONT BELVIEU, TX  
 US 77580  
 Contact: TOMMY EDWARDS  
 tedwards@eprod.com  
 T: (281)217-1411  
 F: (281)385-4327

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)