




# OIL ANALYSIS REPORT

Sample Rating Trend

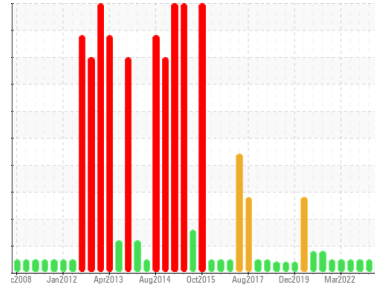

**NORMAL**



Area  
**TM 11**  
 Machine Id  
**TM 11 DRY BROKE AGT REDUCER**  
 Component  
**Gearbox**  
 Fluid  
**ROYAL PURPLE SYNERGY 90/220 (--- GAL)**

**DIAGNOSIS**

**Recommendation**

Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**Contamination**

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

**SAMPLE INFORMATION**

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>RP0038101</b>	RP0037977	RP0034364
Sample Date	Client Info		<b>15 Jul 2024</b>	30 Jan 2024	08 Aug 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

**WEAR METALS**

	method	limit/base	current	history1	history2
PQ	ASTM D8184		<b>23</b>	12	8
Iron	ppm	ASTM D5185m >200	<b>35</b>	23	29
Chromium	ppm	ASTM D5185m >15	<b>0</b>	<1	<1
Nickel	ppm	ASTM D5185m >15	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m	<b>0</b>	<1	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >25	<b>0</b>	<1	<1
Lead	ppm	ASTM D5185m >100	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m >200	<b>0</b>	<1	<1
Tin	ppm	ASTM D5185m >25	<b>0</b>	<1	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

**ADDITIVES**

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>18</b>	32	38
Barium	ppm	ASTM D5185m	<b>0</b>	0	19
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	<1
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m	<b>3</b>	0	<1
Calcium	ppm	ASTM D5185m	<b>2</b>	<1	2
Phosphorus	ppm	ASTM D5185m 370	<b>462</b>	411	424
Zinc	ppm	ASTM D5185m	<b>21</b>	11	50

**CONTAMINANTS**

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	<b>6</b>	4	6
Sodium	ppm	ASTM D5185m	<b>2</b>	2	3
Potassium	ppm	ASTM D5185m >20	<b>0</b>	<1	0
Water	%	ASTM D6304 >0.2	<b>0.028</b>	0.017	0.015
ppm Water	ppm	ASTM D6304 >2000	<b>286</b>	170	159.0






**FLUID CLEANLINESS**

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	<b>18472</b>	8000	3628
Particles >6µm	ASTM D7647	>5000	<b>3234</b>	1129	765
Particles >14µm	ASTM D7647	>640	<b>206</b>	142	157
Particles >21µm	ASTM D7647	>160	<b>36</b>	31	44
Particles >38µm	ASTM D7647	>40	<b>3</b>	0	1
Particles >71µm	ASTM D7647	>10	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>21/19/16	<b>21/19/15</b>	20/17/14	19/17/14

**FLUID DEGRADATION**

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.33	<b>2.06</b>	1.88	1.71


# OIL ANALYSIS REPORT

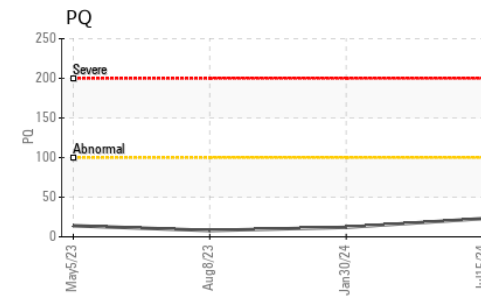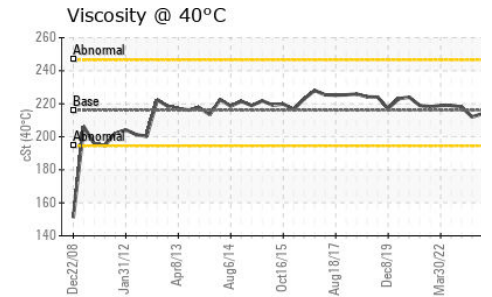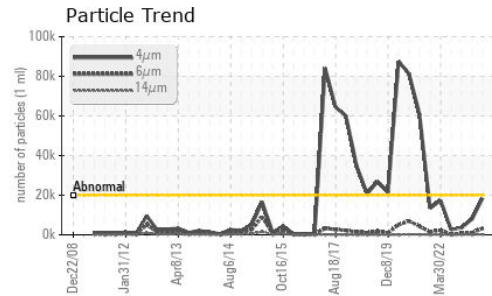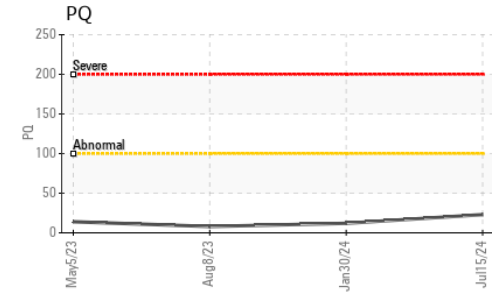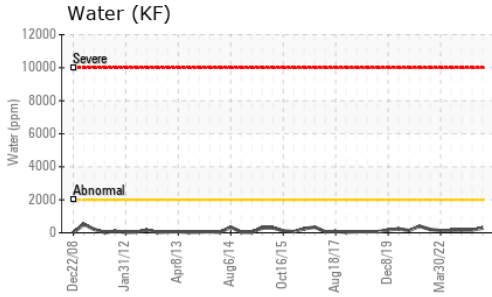






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	216.1	214	212

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

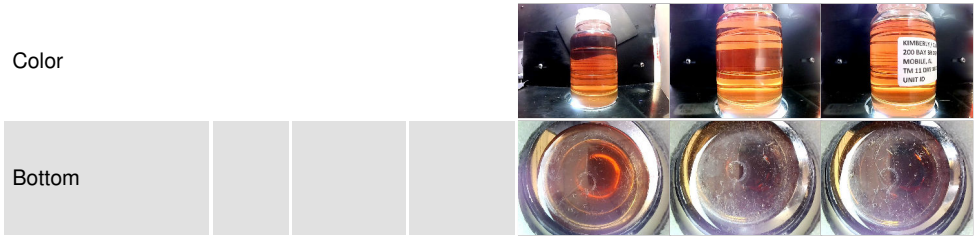

## GRAPHS

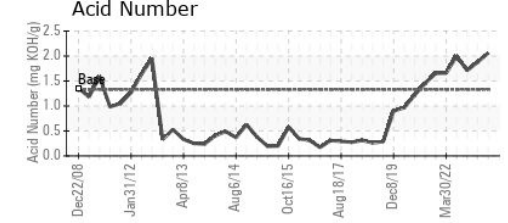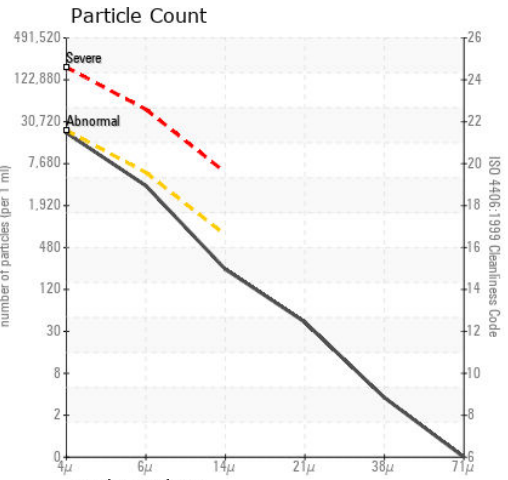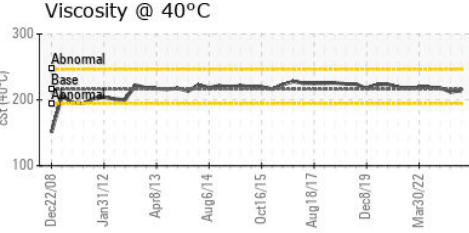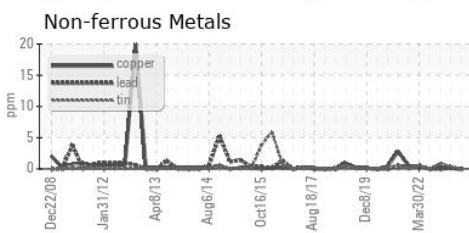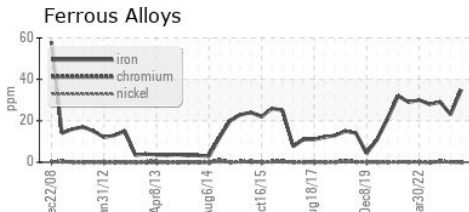

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0038101 **Received** : 16 Jul 2024  
**Lab Number** : 06237789 **Tested** : 17 Jul 2024  
**Unique Number** : 11126623 **Diagnosed** : 18 Jul 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: PQ, PrtCount )

**Kimberly-Clark - Mobile - TM 11**  
 200 BAYBRIDGE RD  
 MOBILE, AL 36610  
 Contact: LARRY WEAVER  
 Larry.D.Weaver@kcc.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F: (251)452-6335