




# OIL ANALYSIS REPORT

## Sample Rating Trend

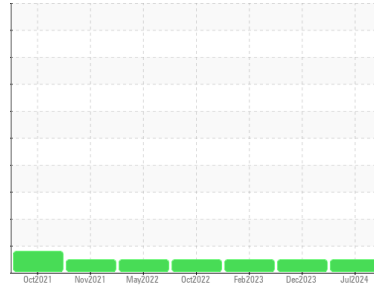

**NORMAL**



Machine Id  
**05 (S/N D12122)**  
 Component  
**Vacuum Pump**  
 Fluid  
**USPI VAC 100 (--- GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system are acceptable.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>USPM37048</b>	USPM31545	USPM26324
Sample Date	Client Info	<b>11 Jul 2024</b>	03 Dec 2023	05 Feb 2023
Machine Age	hrs Client Info	<b>0</b>	0	0
Oil Age	hrs Client Info	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

### WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >20	<b>2</b>	0	<1
Chromium	ppm ASTM D5185m >20	<b>0</b>	0	0
Nickel	ppm ASTM D5185m >20	<b>0</b>	0	0
Titanium	ppm ASTM D5185m	<b>0</b>	0	0
Silver	ppm ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm ASTM D5185m >20	<b>&lt;1</b>	0	0
Lead	ppm ASTM D5185m >20	<b>0</b>	0	0
Copper	ppm ASTM D5185m >20	<b>0</b>	0	0
Tin	ppm ASTM D5185m >20	<b>&lt;1</b>	0	0
Vanadium	ppm ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm ASTM D5185m	<b>0</b>	0	0

### ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm ASTM D5185m 0	<b>0</b>	0	1
Molybdenum	ppm ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm ASTM D5185m 0	<b>0</b>	0	0
Calcium	ppm ASTM D5185m 0	<b>0</b>	0	0
Phosphorus	ppm ASTM D5185m 1800	<b>1290</b>	1424	1379
Zinc	ppm ASTM D5185m 0	<b>0</b>	0	0
Sulfur	ppm ASTM D5185m 0	<b>0</b>	0	0

### CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >15	<b>1</b>	0	<1
Sodium	ppm ASTM D5185m	<b>0</b>	0	0
Potassium	ppm ASTM D5185m >20	<b>0</b>	0	<1
Water	% ASTM D6304 >.1	<b>0.066</b>	0.012	0.021
ppm Water	ppm ASTM D6304 >1000	<b>667</b>	129	210.6

### FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	<b>304</b>	266	341
Particles >6µm	ASTM D7647 >2500	<b>67</b>	88	119
Particles >14µm	ASTM D7647 >640	<b>16</b>	11	11
Particles >21µm	ASTM D7647 >160	<b>7</b>	3	2
Particles >38µm	ASTM D7647 >40	<b>3</b>	0	1
Particles >71µm	ASTM D7647 >10	<b>1</b>	0	0
Oil Cleanliness	ISO 4406 (c) >20/18/16	<b>15/13/11</b>	15/14/11	16/14/11

### FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045 0.05	<b>0.14</b>	0.11	0.06



# OIL ANALYSIS REPORT

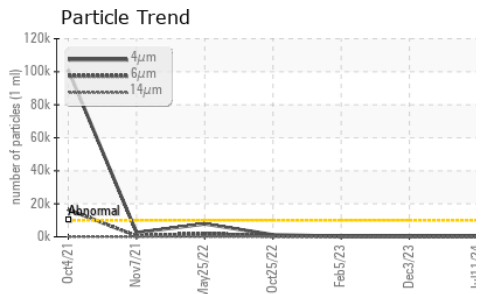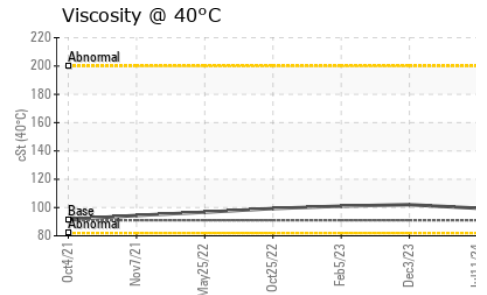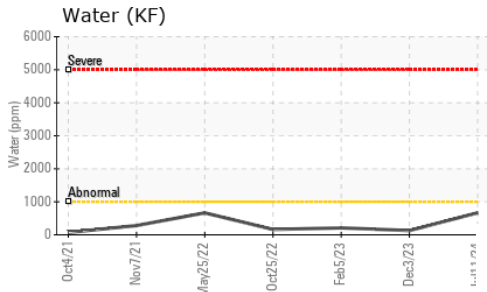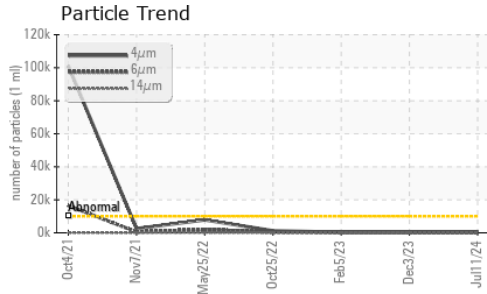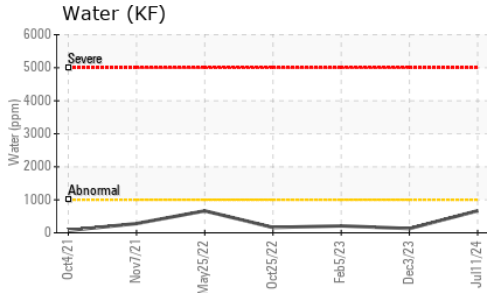


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	VLITE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG






FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 91	99.5	102	101

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color



## GRAPHS

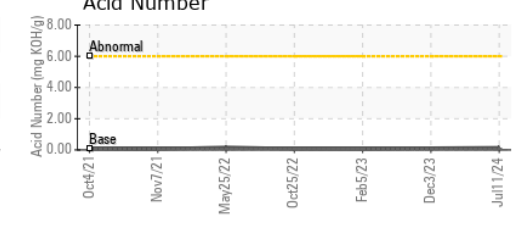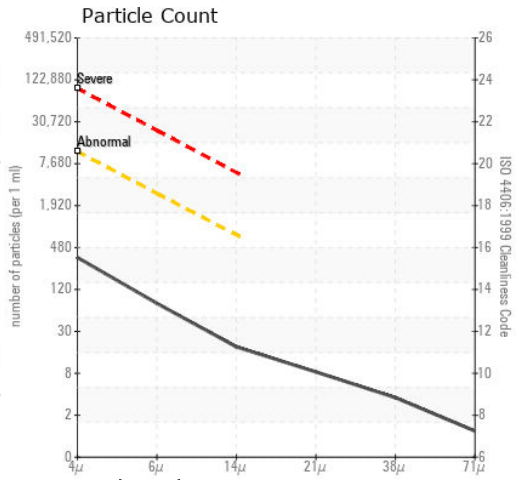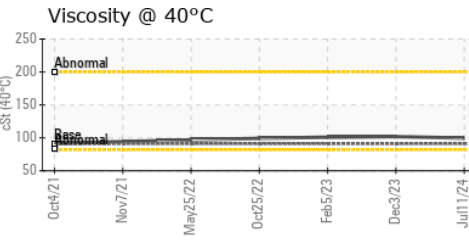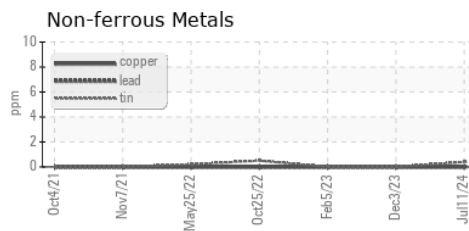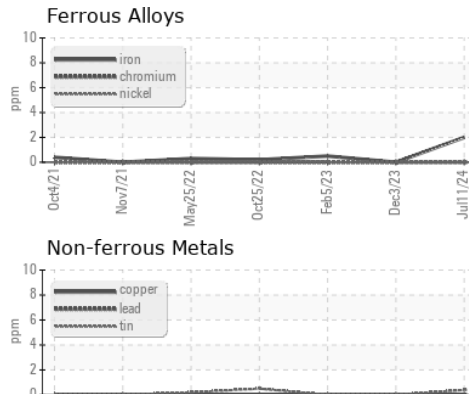

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : USPM37048  
 Lab Number : 06237812  
 Unique Number : 11126646  
 Test Package : IND 2

Received : 16 Jul 2024  
 Tested : 17 Jul 2024  
 Diagnosed : 18 Jul 2024 - Doug Bogart

**KraftHeinz - Avon - Plant 8357**  
 140 SPRING ST  
 AVON, NY  
 US 14414  
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: