


OIL ANALYSIS REPORT

Sample Rating Trend

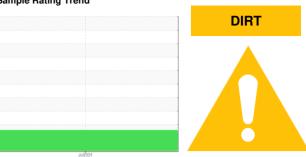

Machine Id

TRANE COSBY HS CH 2

Component
Refrigeration Compressor

REFRIG COMP OIL ISO 46 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

Contamination

Elemental level of silicon (Si) above normal.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMA	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0812080		
Sample Date		Client Info		15 Jul 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	4		
Chromium	ppm	ASTM D5185m	>2	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>3	0		
Lead	ppm	ASTM D5185m	>2	0		
Copper	ppm	ASTM D5185m	>8	2		
Tin	ppm	ASTM D5185m	>4	4		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	5	0		
Barium	ppm	ASTM D5185m	5	0		
Molybdenum	ppm	ASTM D5185m	5	0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	5	<1		
Calcium	ppm	ASTM D5185m	12	0		
Phosphorus	ppm	ASTM D5185m	12	1		
Zinc	ppm	ASTM D5185m	12	0		
Sulfur	ppm	ASTM D5185m	1000	4		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	▲ 31		
Sodium	ppm	ASTM D5185m		1		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>0.01	0.00		
ppm Water	ppm	ASTM D6304	>100	0		
FLUID DEGRADAT	ΓΙΟΝ	method	limit/base	current	history1	history2


0.014

Acid Number (AN)

mg KOH/g ASTM D974 0.10



OIL ANALYSIS REPORT

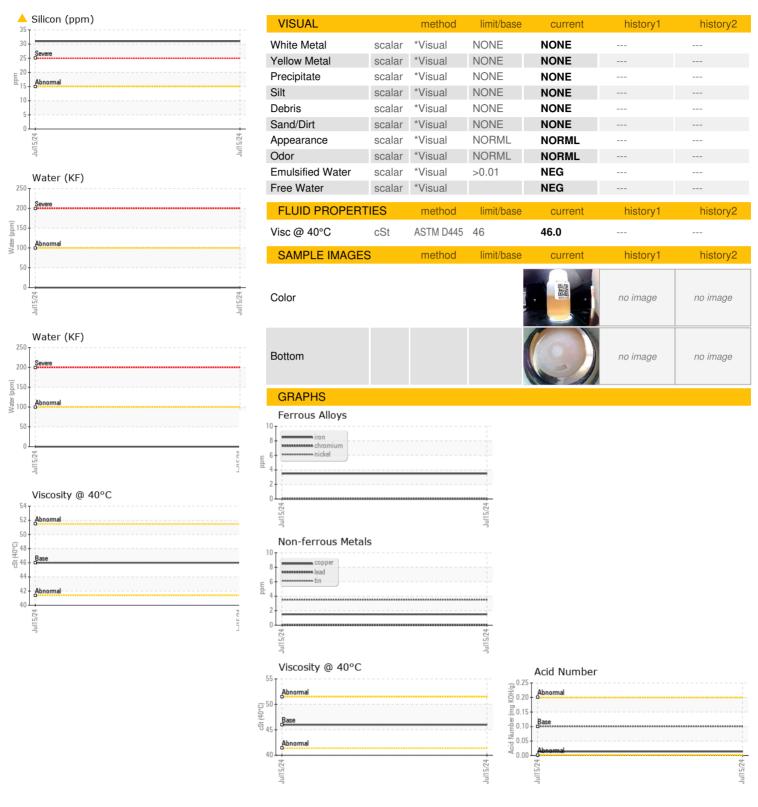





Certificate 12367

Laboratory Sample No. Lab Number : 06237854 Unique Number : 11126688

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : WC0812080

Test Package : IND 2

Received : 16 Jul 2024 **Tested** : 17 Jul 2024

Diagnosed : 19 Jul 2024 - Jonathan Hester

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

DAIKIN APPLIED-RICHMOND

8991 OLD STAPLES MILL ROAD HENRICO, VA

US 23228

Contact: AMANDA CARRIER amanda.carrier@daikinapplied.com

T: (804)747-4822 F: (804)747-6686

Contact/Location: AMANDA CARRIER - MCQRIC