



OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Area

[SV2405100182]

Machine Id

DAIKIN JEPSON UMW C2 (S/N STNU210100068)

Component

Refrigeration Compressor

Fluid

EMKARATE RL 68H (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The water content is negligible. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| SAMPLE INFORMATION | | method | limit/base | current | history1 | history2 |
|--------------------|-------------|-------------|------------|--------------------|----------|----------|
| Sample Number | Client Info | | | WC0631942 | --- | --- |
| Sample Date | Client Info | | | 11 Jun 2024 | --- | --- |
| Machine Age | hrs | Client Info | | 0 | --- | --- |
| Oil Age | hrs | Client Info | | 0 | --- | --- |
| Oil Changed | Client Info | | | N/A | --- | --- |
| Sample Status | | | | NORMAL | --- | --- |

| WEAR METALS | | method | limit/base | current | history1 | history2 |
|-------------|-----|-------------|------------|----------|----------|----------|
| Iron | ppm | ASTM D5185m | >100 | 0 | --- | --- |
| Chromium | ppm | ASTM D5185m | >2 | 0 | --- | --- |
| Nickel | ppm | ASTM D5185m | | 0 | --- | --- |
| Titanium | ppm | ASTM D5185m | | 0 | --- | --- |
| Silver | ppm | ASTM D5185m | >2 | 0 | --- | --- |
| Aluminum | ppm | ASTM D5185m | >50 | 0 | --- | --- |
| Lead | ppm | ASTM D5185m | >2 | 0 | --- | --- |
| Copper | ppm | ASTM D5185m | >100 | 0 | --- | --- |
| Tin | ppm | ASTM D5185m | >4 | 0 | --- | --- |
| Vanadium | ppm | ASTM D5185m | | 0 | --- | --- |
| Cadmium | ppm | ASTM D5185m | | 0 | --- | --- |




| ADDITIVES | | method | limit/base | current | history1 | history2 |
|------------|-----|-------------|------------|--------------|----------|----------|
| Boron | ppm | ASTM D5185m | 0 | 0 | --- | --- |
| Barium | ppm | ASTM D5185m | 0 | 0 | --- | --- |
| Molybdenum | ppm | ASTM D5185m | 0 | 0 | --- | --- |
| Manganese | ppm | ASTM D5185m | | 0 | --- | --- |
| Magnesium | ppm | ASTM D5185m | 0 | <1 | --- | --- |
| Calcium | ppm | ASTM D5185m | 0 | 0 | --- | --- |
| Phosphorus | ppm | ASTM D5185m | 5 | <1 | --- | --- |
| Zinc | ppm | ASTM D5185m | 10 | 0 | --- | --- |
| Sulfur | ppm | ASTM D5185m | 50 | 0 | --- | --- |

| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
|--------------|-----|-------------|------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185m | >50 | 23 | --- | --- |
| Sodium | ppm | ASTM D5185m | | <1 | --- | --- |
| Potassium | ppm | ASTM D5185m | >20 | 0 | --- | --- |
| Water | % | ASTM D6304 | >0.02 | 0.012 | --- | --- |
| ppm Water | ppm | ASTM D6304 | >250 | 126 | --- | --- |

| FLUID DEGRADATION | | method | limit/base | current | history1 | history2 |
|-------------------|----------|-----------|------------|--------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D974 | | 0.014 | --- | --- |



OIL ANALYSIS REPORT

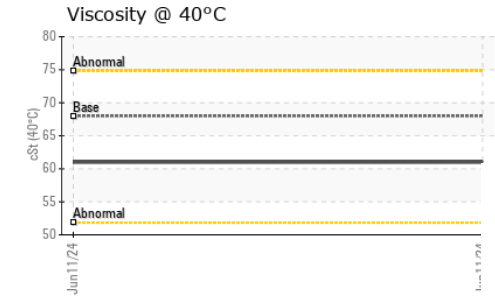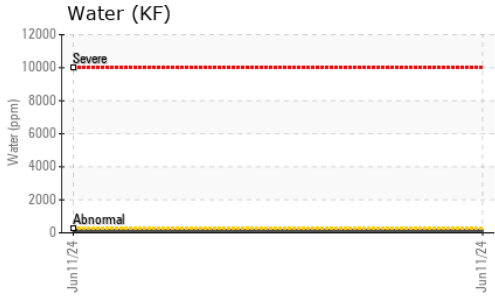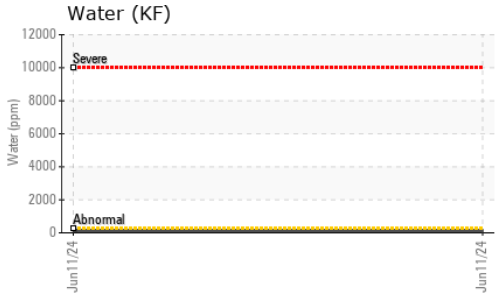





| VISUAL | method | limit/base | current | history1 | history2 | |
|------------------|--------|------------|---------|--------------|----------|-----|
| White Metal | scalar | *Visual | NONE | NONE | --- | --- |
| Yellow Metal | scalar | *Visual | NONE | NONE | --- | --- |
| Precipitate | scalar | *Visual | NONE | NONE | --- | --- |
| Silt | scalar | *Visual | NONE | NONE | --- | --- |
| Debris | scalar | *Visual | NONE | NONE | --- | --- |
| Sand/Dirt | scalar | *Visual | NONE | NONE | --- | --- |
| Appearance | scalar | *Visual | NORML | NORML | --- | --- |
| Odor | scalar | *Visual | NORML | NORML | --- | --- |
| Emulsified Water | scalar | *Visual | >0.02 | NEG | --- | --- |
| Free Water | scalar | *Visual | | NEG | --- | --- |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|--------------|-------------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 68 | 61.0 | --- | --- |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

| | | | |
|--------|--|----------|----------|
| Color | | no image | no image |
| Bottom | | no image | no image |

GRAPHS

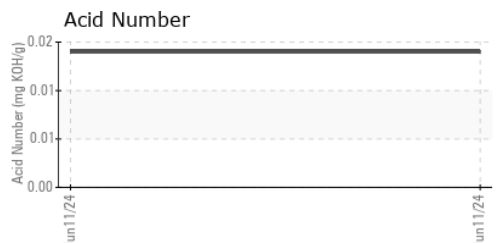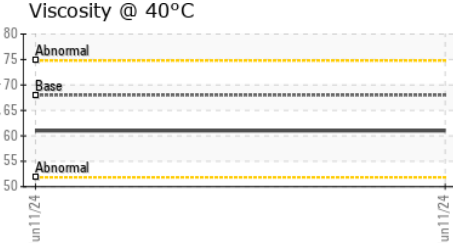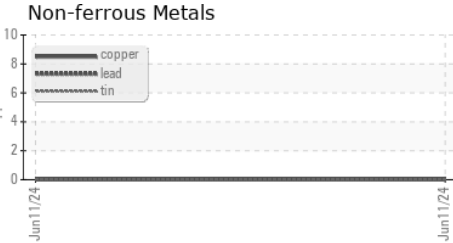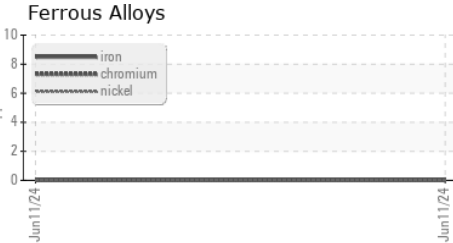

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0631942

Lab Number : **06237862**

Unique Number : 11126696

Test Package : IND 2

Received : 16 Jul 2024

Tested : 17 Jul 2024

Diagnosed : 19 Jul 2024 - Jonathan Hester

DAIKIN APPLIED-RICHMOND

8991 OLD STAPLES MILL ROAD

HENRICO, VA

US 23228

Contact: AMANDA CARRIER

amanda.carrier@daikinapplied.com

T: (804)747-4822

F: (804)747-6686

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)