




# OIL ANALYSIS REPORT

Sample Rating Trend

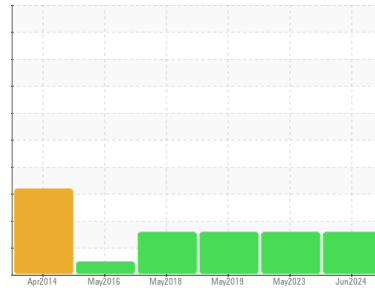

**WATER**



Area

[SV2405100166]

Machine Id

TRANE MARY WASHINGTON COLLEGE CIRC 1 (S/N U11G01142)

Component

Refrigeration Compressor

Fluid

TRANE 68 (3 GAL)

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. We recommend an early resample to monitor this condition.

### Wear

All component wear rates are normal.

### Contamination

There is a trace of moisture present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0631943</b>	WC0632027	WCI2310916
Sample Date	Client Info		<b>11 Jun 2024</b>	05 May 2023	17 May 2019
Machine Age	hrs	Client Info	<b>24156</b>	23570	16624
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>MARGINAL</b>	MARGINAL	MARGINAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	<b>1</b>	2	1
Chromium	ppm	ASTM D5185m >2	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	<1	<1
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >3	<b>0</b>	<1	<1
Lead	ppm	ASTM D5185m >2	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m >8	<b>0</b>	<1	<1
Tin	ppm	ASTM D5185m >4	<b>0</b>	2	0
Antimony	ppm	ASTM D5185m	<b>---</b>	---	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>3</b>	3	5
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	<1
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Magnesium	ppm	ASTM D5185m	<b>&lt;1</b>	2	0
Calcium	ppm	ASTM D5185m	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>4</b>	6	4
Zinc	ppm	ASTM D5185m	<b>11</b>	8	8
Sulfur	ppm	ASTM D5185m	<b>0</b>	11	6

## CONTAMINANTS




	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>4</b>	3	14
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Potassium	ppm	ASTM D5185m >20	<b>0</b>	<1	<1
Water	%	ASTM D6304 >0.01	<b>▲ 0.041</b>	▲ 0.029	▲ 0.030
ppm Water	ppm	ASTM D6304 >100	<b>▲ 412</b>	▲ 295.3	▲ 300

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	<b>0.097</b>	0.072	0.101




# OIL ANALYSIS REPORT

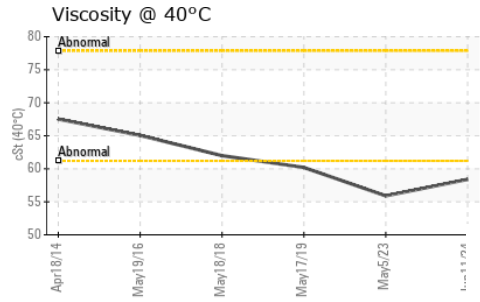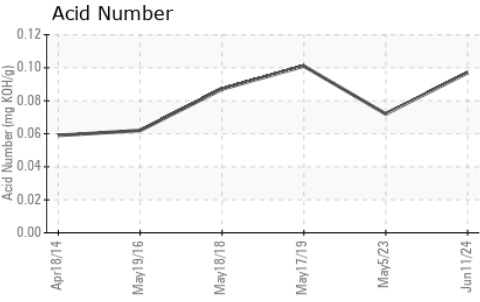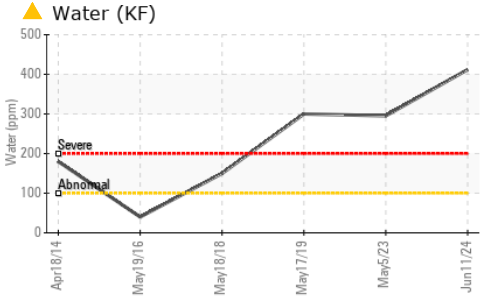





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	<b>58.4</b>	55.9	60.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

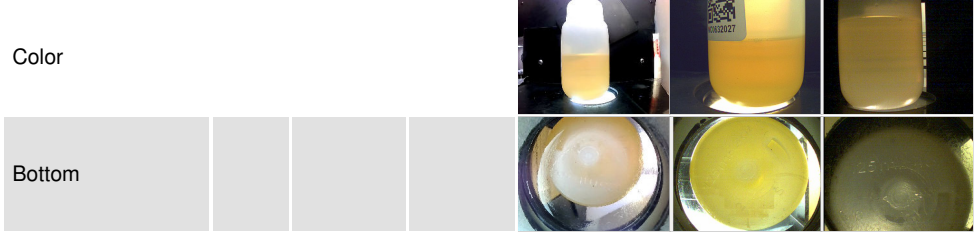

## GRAPHS

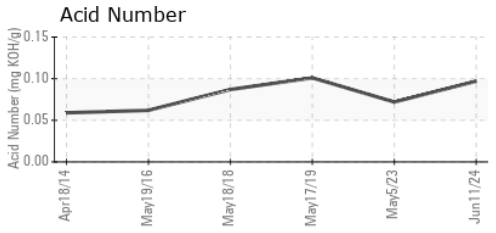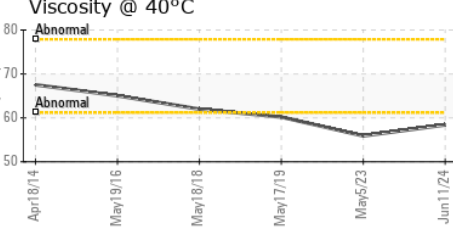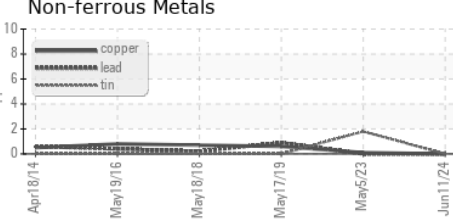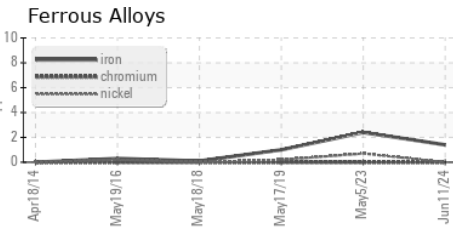

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0631943      **Received** : 16 Jul 2024  
**Lab Number** : 06237863      **Tested** : 17 Jul 2024  
**Unique Number** : 11126697      **Diagnosed** : 19 Jul 2024 - Jonathan Hester  
**Test Package** : IND 2

**DAIKIN APPLIED-RICHMOND**  
 8991 OLD STAPLES MILL ROAD  
 HENRICO, VA 23228  
 Contact: AMANDA CARRIER  
 amanda.carrier@daikinapplied.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)