


# **OIL ANALYSIS REPORT**

Sample Rating Trend



Machine Id

# 101CM12101

Component Refrigeration Compressor

**ROYAL PURPLE SYNFILM 32 (500 GAL)** 

## DIAGNOSIS

#### Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

## Contamination

There is a trace of moisture present in the oil.


## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jul2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		RP0028171		
Sample Date		Client Info		15 Jul 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				MARGINAL		
WEAR METALS		method	limit/base	current	history1	history2
ron	ppm	ASTM D5185m	>8	0		
Chromium	ppm	ASTM D5185m	>2	0		
Nickel	ppm	ASTM D5185m	1	0		
itanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>3	0		
_ead	ppm	ASTM D5185m	>2	0		
Leau Copper	ppm	ASTM D5185m	>8	√ <1		
- Tin	ppm	ASTM D5185m	>o >4	0		
/anadium		ASTM D5185m	2 <del>4</del>	0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES	Pp	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	IIIIII basc	0		1113t01 y Z
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	90	64		
Calcium	ppm	ASTM D5185m	30	<1		
Phosphorus		ASTM D5185m		0		
Zinc	ppm	ASTM D5185m		0		
-				-		
CONTAMINANTS	5	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	2		
Sodium	ppm	ASTM D5185m		2		
Potassium	ppm	ASTM D5185m	>20	0		
Vater	%	ASTM D6304	>0.01	<u> </u>		
ppm Water	ppm	ASTM D6304	>100	<u> </u>		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974		0.32		
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE		
ellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.01	NEG		
ree Water	scalar	*Visual	-	NEG	TOMMY EDWA	RDSENTHOU



# **OIL ANALYSIS REPORT**

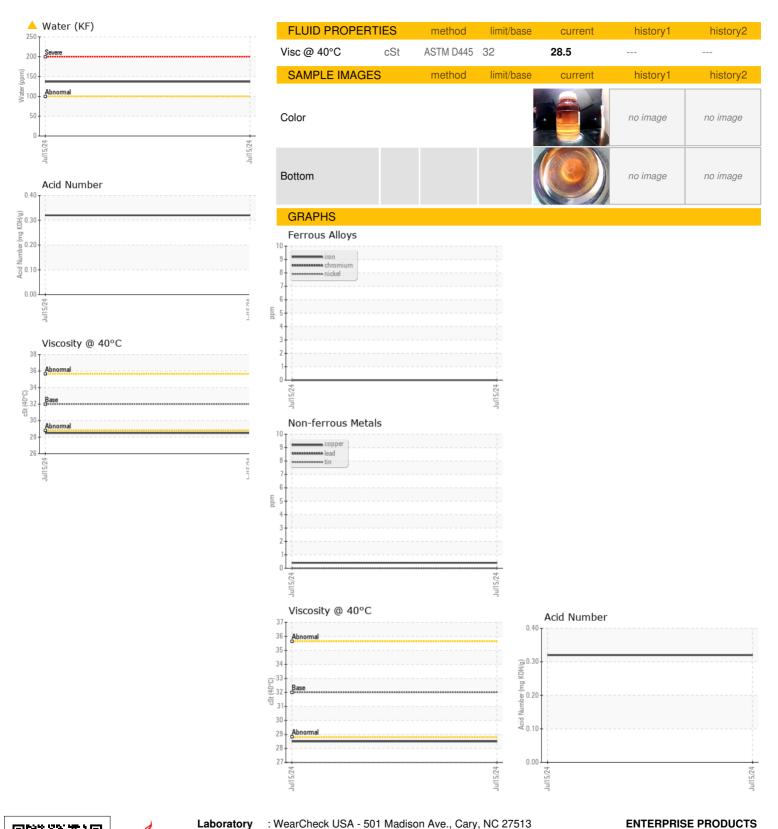





Certificate 12367

Laboratory

Sample No. Lab Number : 06237875 Unique Number : 11126709

: RP0028171

To discuss this sample report, contact Customer Service at 1-800-237-1369.

Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 16 Jul 2024 **Tested** : 17 Jul 2024

Diagnosed

: 19 Jul 2024 - Jonathan Hester

US 77580 Contact: TOMMY EDWARDS tedwards@eprod.com T: (281)217-1411

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (281)385-4327

P.O. BOX 573

MONT BELVIEU, TX