




OIL ANALYSIS REPORT

Sample Rating Trend

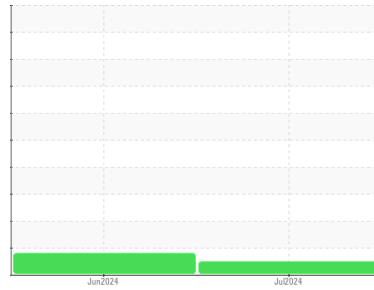

Machine Id
Oil room tote 25
 Component
Bulk Fluid Tank
 Fluid
TURBINE OIL ISO 100 (--- GAL)

DIAGNOSIS

Recommendation
 This is a baseline read-out on the submitted sample.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		RP0042867	RP0042856	---
Sample Date	Client Info		12 Jul 2024	05 Jun 2024	---
Machine Age	hrs	Client Info	0	0	---
Oil Age	hrs	Client Info	0	0	---
Oil Changed	Client Info		Not Changed	Not Changed	---
Sample Status			NORMAL	ATTENTION	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	0	0	---
Chromium	ppm	ASTM D5185m	0	0	---
Nickel	ppm	ASTM D5185m	0	0	---
Titanium	ppm	ASTM D5185m	0	0	---
Silver	ppm	ASTM D5185m	0	0	---
Aluminum	ppm	ASTM D5185m	0	0	---
Lead	ppm	ASTM D5185m	0	0	---
Copper	ppm	ASTM D5185m	0	0	---
Tin	ppm	ASTM D5185m	0	<1	---
Vanadium	ppm	ASTM D5185m	0	0	---
Cadmium	ppm	ASTM D5185m	0	0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 5	0	0	---
Barium	ppm	ASTM D5185m 5	0	1	---
Molybdenum	ppm	ASTM D5185m 5	1	0	---
Manganese	ppm	ASTM D5185m	0	<1	---
Magnesium	ppm	ASTM D5185m 5	4	4	---
Calcium	ppm	ASTM D5185m 10	27	20	---
Phosphorus	ppm	ASTM D5185m 275	54	42	---
Zinc	ppm	ASTM D5185m 7	31	24	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1	<1	---
Sodium	ppm	ASTM D5185m	1	1	---
Potassium	ppm	ASTM D5185m >20	<1	2	---
Water	%	ASTM D6304	0.002	0.00	---
ppm Water	ppm	ASTM D6304	20	0	---






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	3225	7273	---
Particles >6µm	ASTM D7647	>1300	535	1270	---
Particles >14µm	ASTM D7647	>160	21	18	---
Particles >21µm	ASTM D7647	>40	6	4	---
Particles >38µm	ASTM D7647	>10	1	1	---
Particles >71µm	ASTM D7647	>3	1	1	---
Oil Cleanliness	ISO 4406 (c)	>19/17/14	19/16/12	20/17/11	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.13	0.081	0.088	---


OIL ANALYSIS REPORT

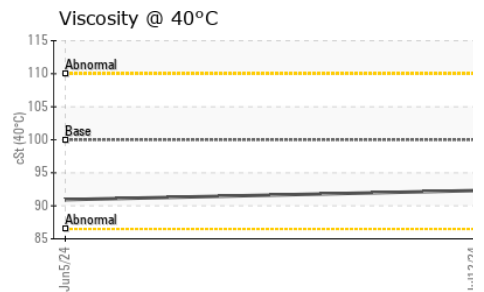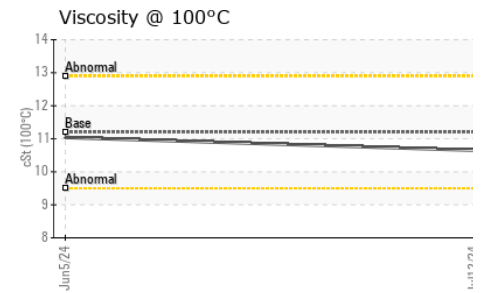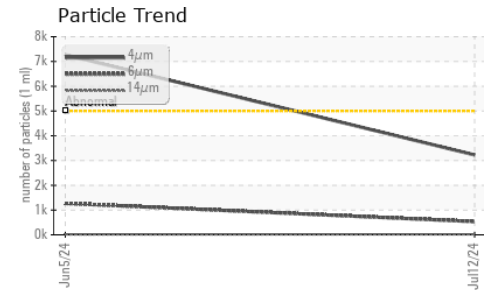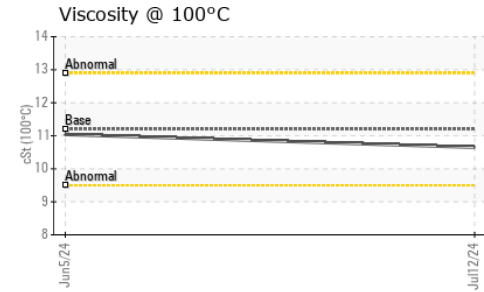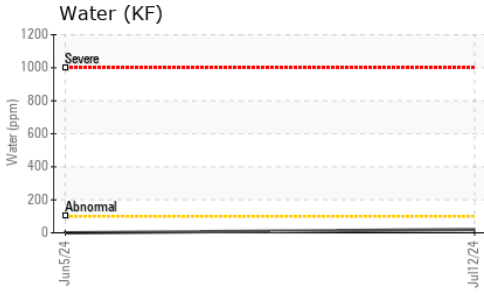






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	NEG	NEG	---
Free Water	scalar	*Visual	NEG	NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	100	92.31	90.93
Visc @ 100°C	cSt	ASTM D445	11.2	10.65	11.04
Viscosity Index (VI)	Scale	ASTM D2270	97	106	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

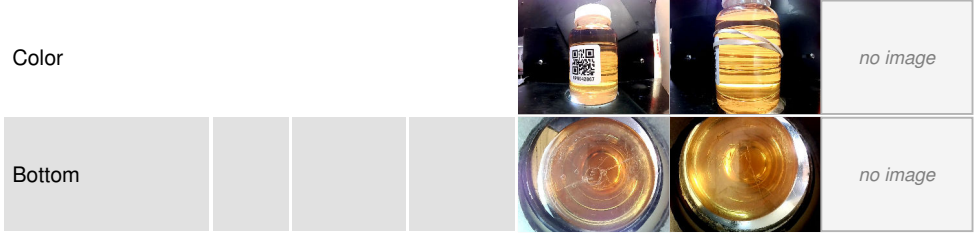

GRAPHS

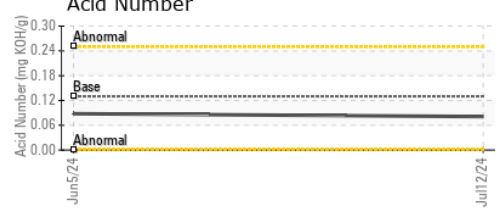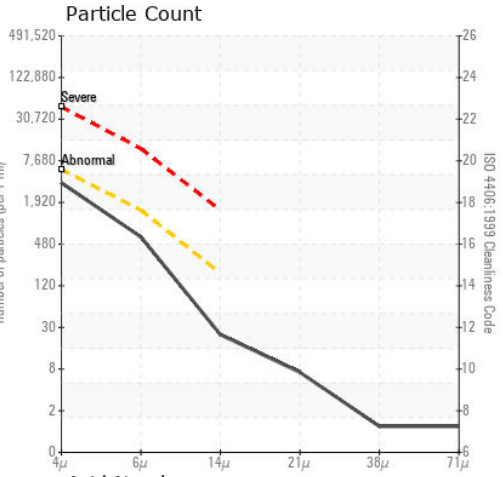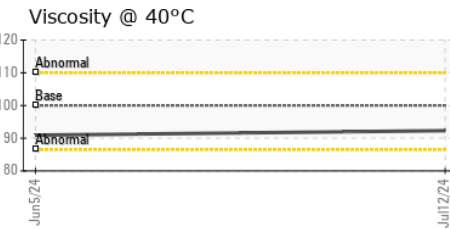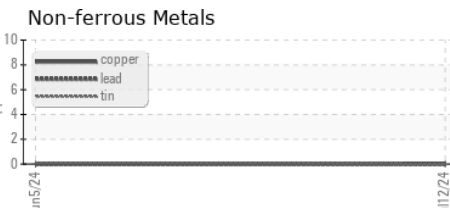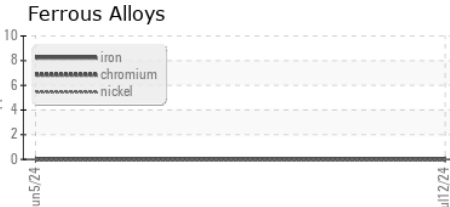

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP0042867 **Received** : 16 Jul 2024
Lab Number : 06238312 **Tested** : 17 Jul 2024
Unique Number : 11127146 **Diagnosed** : 19 Jul 2024 - Jonathan Hester
Test Package : IND 2 (Additional Tests: KV100, PrtCount, VI)

CALUMET
 3333 MIDWAY AVENUE
 SHREVEPORT, LA
 US 71109
 Contact: NICHOLAS LESAGE
 nicholas.lesage@clmt.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)