



OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Area

PSA

Machine Id

[PSA] PSA LUBE TOTE 20

Component

Reciprocating Compressor - Packing/Cylinders

Fluid

TURBINE OIL ISO 100 (--- GAL)

DIAGNOSIS

Recommendation

This is a baseline read-out on the submitted sample.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		RP0042863	---	---
Sample Date	Client Info		12 Jul 2024	---	---
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		Not Chngd	---	---
Sample Status			NORMAL	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	---	---
Chromium	ppm	ASTM D5185m >10	0	---	---
Nickel	ppm	ASTM D5185m	0	---	---
Titanium	ppm	ASTM D5185m	0	---	---
Silver	ppm	ASTM D5185m	0	---	---
Aluminum	ppm	ASTM D5185m >25	0	---	---
Lead	ppm	ASTM D5185m >25	0	---	---
Copper	ppm	ASTM D5185m >50	0	---	---
Tin	ppm	ASTM D5185m >15	0	---	---
Vanadium	ppm	ASTM D5185m	0	---	---
Cadmium	ppm	ASTM D5185m	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 5	0	---	---
Barium	ppm	ASTM D5185m 5	0	---	---
Molybdenum	ppm	ASTM D5185m 5	<1	---	---
Manganese	ppm	ASTM D5185m	0	---	---
Magnesium	ppm	ASTM D5185m 5	3	---	---
Calcium	ppm	ASTM D5185m 10	11	---	---
Phosphorus	ppm	ASTM D5185m 275	33	---	---
Zinc	ppm	ASTM D5185m 7	11	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	2	---	---
Sodium	ppm	ASTM D5185m	2	---	---
Potassium	ppm	ASTM D5185m >20	0	---	---
Water	%	ASTM D6304 >0.1	0.001	---	---
ppm Water	ppm	ASTM D6304 >1000	3	---	---






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	2575	---	---
Particles >6µm	ASTM D7647	>2500	634	---	---
Particles >14µm	ASTM D7647	>320	56	---	---
Particles >21µm	ASTM D7647	>80	13	---	---
Particles >38µm	ASTM D7647	>20	1	---	---
Particles >71µm	ASTM D7647	>4	0	---	---
Oil Cleanliness	ISO 4406 (c)	>20/18/15	19/16/13	---	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.13	0.177	---	---

OIL ANALYSIS REPORT

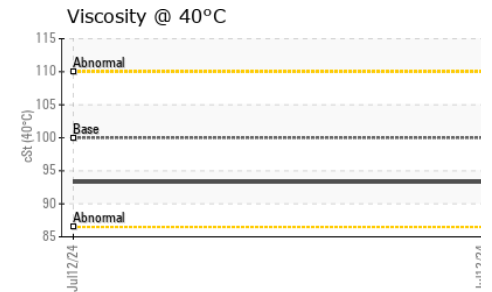
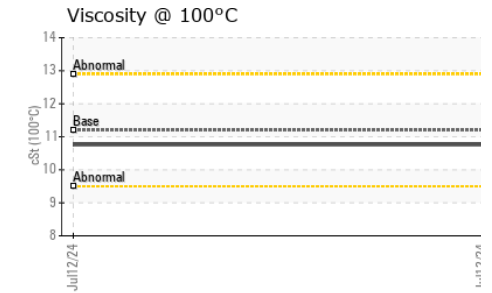
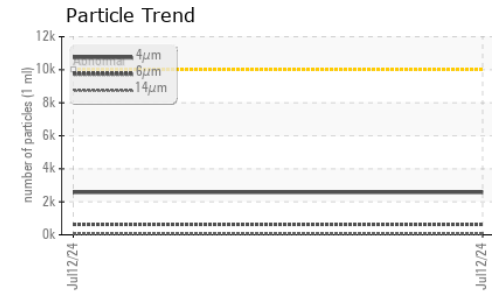
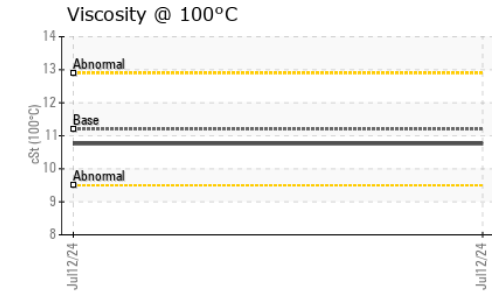
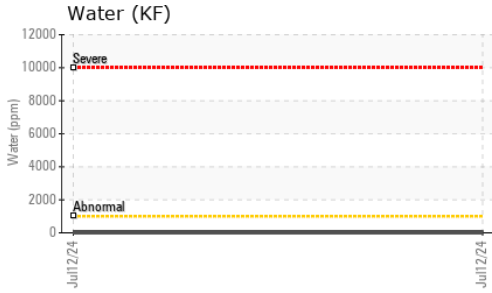


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	100	93.3	---
Visc @ 100°C	cSt	ASTM D445	11.2	10.76	---
Viscosity Index (VI)	Scale	ASTM D2270	97	98	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS

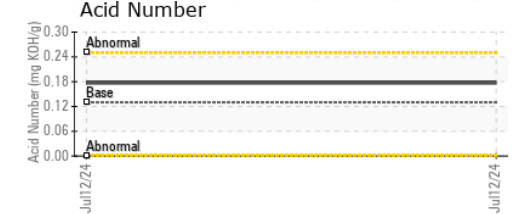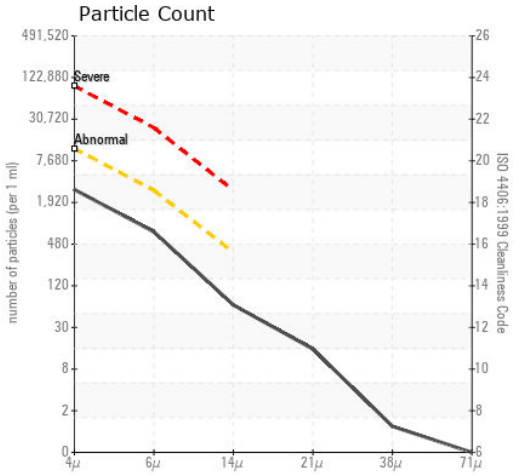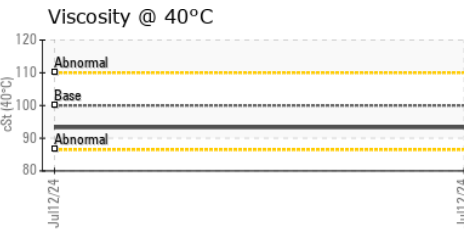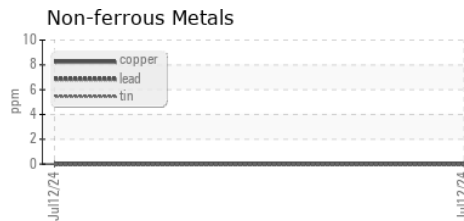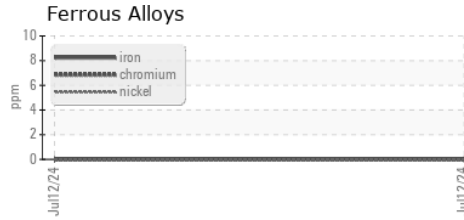

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP0042863 **Received** : 16 Jul 2024
Lab Number : 06238315 **Tested** : 17 Jul 2024
Unique Number : 11127149 **Diagnosed** : 19 Jul 2024 - Jonathan Hester
Test Package : IND 2 (Additional Tests: KV100, PrtCount, VI)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

CALUMET
 3333 MIDWAY AVENUE
 SHREVEPORT, LA
 US 71109
 Contact: NICHOLAS LESAGE
 nicholas.lesage@clmt.com

T:
F: